

ENERGY STAR COMPLIANT 13 SEER SINGLE PACKAGE GAS HEATING/ELECTRIC COOLING, R-410A ROOFTOP 3 – 5 TONS 575V

BUILT TO LAST, EASY TO INSTALL AND SERVICE

- One-piece, high efficiency gas heating and electric cooling with a low profile, prewired, tested, and charged at the factory
- All units are convertible from downflow to horizontal air flow; no special adapter curbs are necessary
- Full perimeter base rail with built-in rigging adapters and fork truck slots
- Pre-painted exterior panels and primer-coated interior panels tested to 500 hours salt spray protection
- Fully insulated cabinet
- Single-stage cooling capacity control
- Redundant gas valve, up to two stages of heating
- Exclusive IGC solid-state control for on-board diagnostics with LED error code designation, burner control logic and energy saving indoor fan motor delay
- High efficiency, gas heat with induced draft flue exhaust design
- Scroll compressors with internal line-break overload protection
- All units have high and low pressure switches
- Two inch disposable fiberglass type return air filters in dedicated rack with tool-less filter access door
- Refrigerant circuits contain a liquid line filter drier to trap dirt and moisture
- Newly-designed indoor refrigerant header for easier maintenance and replacement
- Exclusive non-corrosive composite condensate pan in accordance with ASHRAE 62 Standard, sloping design; side or center drain
- Belt drive evaporator-fan motor and pulley combinations available to meet any application
- Access panels with easy grip handles provide quick and easy access to the blower and blower motor, control box, and compressors.
- “No-strip” screw system has superior holding power and guides screws into position while preventing the screw from stripping the unit’s metal.
- Newly designed terminal board facilitates simple safety circuit troubleshooting and simplified control box arrangement
- Outdoor temperature cooling operation range up to 115°F (46°C) and down to 25°F (-4°C) using winter start kit
- Fixed orifice metering devices on all models to precisely control refrigerant flow
- Large, laminated control wiring and power wiring drawings are affixed to unit to make troubleshooting easy
- Capable of thru-the-base or thru-the-curb gas line routing
- Single point gas and electric connections



WARRANTY

- 10 Year heat exchanger limited warranty
- 5 Year compressor limited warranty
- 1 Year parts limited warranty



ARI Standard
340/360



As an Energy Star® Partner, International Comfort Products has determined that this product meets the ENERGY STAR® guidelines for energy efficiency.

| UNIT PERFORMANCE DATA | | | | | | | | |
|-----------------------|--------------|-----------------|------|------|-------------------|---------|------------------------------|-------------------------|
| UNIT | Nominal Tons | COOLING | | | GAS HEATING | | Unit Dimensions H x W x L | Unit Weight lb. [kg] |
| | | Net Cap. (Btuh) | SEER | EER | Input Cap. (Btuh) | AFUE % | | |
| RGS036S^AA0AAA | 3 | 34,600 | 13.0 | 11.0 | 72,000-115,000 | 80-81.0 | 33-3/8" x 44" x 74-3/8" | 483 [219] |
| RGS048S^AA0AAA | 4 | 45,000 | 13.0 | 11.0 | 72,000-150,000 | 80-81.0 | 33-3/8" x 44" x 74-3/8" | 537 [244] |
| RGS060S^AA0AAA | 5 | 59,000 | 13.0 | 10.8 | 72,000-150,000 | 80-81.0 | 33-3/8" x 44" x 74-3/8" | 569 [258] |

^ See model nomenclature listing for gas heating options.

NOTE: BASE MODEL NUMBERS LISTED. SEE MODEL NOMENCLATURE LISTING FOR ADDITIONAL OPTIONS

TABLE OF CONTENTS

| | PAGE | | PAGE |
|---|------|---|------|
| MODEL NUMBER NOMENCLATURE | 2 | ROOF CURB DETAILS | 12 |
| FEATURES AND BENEFITS | 3 | APPLICATION DATA | 13 |
| FACTORY OPTIONS AND/OR ACCESSORIES | 3 | COOLING TABLES | 14 |
| ACCESSORY LIST | 5 | STATIC PRESSURE ADDERS | 17 |
| ARI COOLING RATING TABLE | 6 | FAN PERFORMANCE | 17 |
| HEAT RATING & SOUND PERFORMANCE TABLES .. | 7 | OUTDOOR AIR INTAKE & EXHAUST PERF | 22 |
| PHYSICAL DATA | 8 | ELECTRICAL & MCA / MOCPS INFO | 23 |
| DIMENSIONS UNIT | 10 | SEQUENCE OF OPERATION | 24 |
| DIMENSIONS WEIGHT & CLEARANCE | 11 | GUIDE SPECIFICATIONS | 25 |

MODEL NOMENCLATURE

| MODEL SERIES | R | G | S | 0 | 6 | 0 | S | D | A | B | 0 | A | A | A |
|---|---|------|------------|--------------------------|---|---|---|------------------|-------------------------------|---------------------------|---|----|----|----|
| Position Number | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 |
| R = Rooftop | | | | | | | | | | | | | | |
| A = Air Conditioning (Cooling Only) G = Gas/Electric | | Type | | | | | | | | | | | | |
| S = Standard ASHRAE 90.1-2010 Efficiency | | | Efficiency | | | | | | | | | | | |
| 036 = 36,000 = 3 Tons 048 = 48,000 = 4 Tons 060 = 60,000 = 5 Tons | | | | NOMINAL COOLING CAPACITY | | | | | | | | | | |
| S = 575-3-60 | | | | | | | | VOLTAGE | | | | | | |
| D = Low Heat E = Medium Heat F = High Heat | | | | | | | | Heating Capacity | | | | | | |
| A = Standard Motor B = High Static Motor | | | | | | | | | Motor Option | | | | | |
| A = None B = Economizer w/Bara-relief, OA Temp sensor | | | | | | | | | Outdoor Air Options / Control | | | | | |
| 0A = No Options | | | | | | | | | | Factory Installed Options | | | | |
| A = Aluminum / Copper Cond & Evap Coil | | | | | | | | | | | Condenser / Evaporator Coil Configuration | | | |
| A = Sales Digit | | | | | | | | | | | | | | |

Table 1 – FACTORY INSTALLED OPTIONS AND FIELD INSTALLED ACCESSORIES

| CATEGORY | ITEM | FACTORY INSTALLED OPTION | FIELD INSTALLED ACCESSORY |
|---|---|---------------------------------|----------------------------------|
| Cabinet | Thru-the-base electrical or gas-line connections | | X |
| Controls | Thermostats, temperature sensors, and subbases | | X |
| | Smoke detector (supply air) | | X |
| | Time Guard II compressor delay control circuit | | X |
| | Phase Monitor | | X |
| | Filter status switch | | X |
| | Fan status switch ¹ | | X |
| Economizer & Outdoor Air Dampers | Economizer (for electro-mechanical controlled RTUs) | X | X |
| | Motorized 2 position outdoor-air damper | | X |
| | Manual outdoor-air damper | | X |
| | Barometric relief ² | | X |
| | Power exhaust | | X |
| Economizer Sensors & IAQ Devices | Single dry bulb temperature sensors ³ | | X |
| | Single enthalpy sensors ³ | | X |
| | Differential enthalpy sensors ³ | | X |
| | CO ₂ sensor (duct, or unit mounted) ³ | | X |
| Gas Heat | Liquid propane (LP) conversion kit | | X |
| | High altitude conversion kit | | X |
| | Flue Shield | | X |
| | Flue Discharge Deflector | | X |
| Indoor Motor & Drive | Multiple motor and drive packages | X | |
| Low Ambient Control | Winter start kit ⁴ | | X |
| | Head pressure controller ⁴ | | X |
| Roof Curbs | Roof curb 14" (356mm) | | X |
| | Roof curb 24" (610mm) | | X |

NOTES:

1. Use in conjunction with specialized thermostat or controls device.
2. Included with economizer.
3. Sensors used to optimize economizer performance.
4. See application data for assistance.

FACTORY OPTIONS AND/OR ACCESSORIES

Economizer (dry–bulb or enthalpy)

Economizers bring in fresh, outside air for ventilation; and provide cool, outside air to cool the building. This is the preferred method of low–ambient cooling. When coupled to CO₂ sensors, Economizers can provide even more savings by coupling the ventilation air to only that amount required based on occupancy.

Economizers are available, installed and tested by the factory, with dry–bulb temperature inputs. Additional sensors are available as accessories to optimize the economizers.

CO₂ Sensor

A CO₂ sensor works with the economizer to intake only the correct amount of outside air for ventilation. As occupants fill the building, the CO₂ sensor detects their presence through increasing CO₂ levels, and opens the economizer appropriately.

When the occupants leave, the CO₂ levels decrease, and the sensor appropriately closes the economizer. This intelligent control of the ventilation air, called Demand Control Ventilation (DCV) reduces the overall load on the rooftop, saving money. CO₂ sensors are available as an accessory.

Louvered Hail Guards

Accessory louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact.

Barometric Relief

Gravity controlled, barometric relief equalizes building pressure and ambient air pressures.

Power Exhaust with Barometric Relief

Superior internal building pressure control. This field–installed accessory may eliminate the need for costly, external pressure control fans.

Time Guard II Control Circuit

This accessory protects the compressor by preventing short–cycling in the event of some other failure, prevents the compressor from restarting for 30 seconds after stopping. Not required with authorized commercial thermostats.

Filter or Fan Status Switches

Accessory differential pressure switches detect a filter clog or indoor fan motor failure. When used in conjunction with a compatible unit controller/thermostat, the switches will activate an alarm to warn the appropriate personnel.

Motorized 2–Position Damper

A 2–position, motorized outdoor air damper is available factory installed and admits up to 100% outside air. Using reliable, gear–driven technology, the 2–position damper opens to allow ventilation air and closes when the rooftop stops, stopping unwanted infiltration.

Manual OA Damper

Accessory manual outdoor air dampers are an economical way to bring in ventilation air.

Head Pressure Controller

The motor controller is a low ambient, head pressure controller kit that is designed to maintain the unit's condenser head pressure during periods of low ambient cooling operation. This device should be used as an alternative to economizer free cooling not when economizer usage is either not appropriate or desired. The controller will either cycle the outdoor–fan motors or operate them at reduced speed to maintain the unit operation, depending on the model.

Winter Start Kit

The accessory winter start kit extends the low ambient limit of the rooftop to 25°F (–9°C). The kit bypasses the low pressure switch, preventing nuisance tripping of the low pressure switch. Other low ambient precautions may still be prudent.

Liquid Propane Heating

Convert rooftop from standard natural gas operation to liquid propane using this field–installed kit.

High Altitude Heating

High altitudes have less oxygen, which means heat exchangers need less fuel. The new gas orifices in this field–installed kit make the necessary adjustment for high altitude applications. They restore the optimal fuel to air mixture and maintain healthy combustion at altitudes above 2000 ft (610m). Kits may not be required in all areas.

Flue Discharge Deflector

The flue discharge deflector is a useful accessory when flue gas recirculation is a concern. By venting the flue discharge upwards, the deflector minimizes the chance for a neighboring unit to intake the flue exhaust.

Flue Discharge Heat Shield

The flue discharge heat shield keeps people from touching the rooftop unit's potentially hot flue discharge. This is especially useful for ground level applications, where more, untrained people could have access to the unit's exterior.

Alternate Motors and Drives

Some applications need larger horsepower motors, some need more airflow, and some need both. A wide selection of motors and pulleys (drives) are available, factory installed, to handle nearly any application.

Thru–the–Base Connections

Thru–the–base connections, available as either an accessory, are necessary to ensure proper connection and seal when routing wire and piping through the rooftop's basepan and curb. These couplings eliminate roof penetration and should be considered for gas lines, main power lines, as well as control power.

ACCESSORIES – RGS036–060

| FLAT ROOF CURBS | | |
|--|---|--------------------------------------|
| Model Number | Description | Use With Model Size |
| CRRFCURB001A01 | 14" High Roof Curb | 036 – 060 |
| CRRFCURB002A01 | 24" High Roof Curb | 036 – 060 |
| ECONOMIZERS | | |
| Model Number | Description | Use With Model Size |
| DNECOMZR020A02 | Vertical Fully Modulating – with W7212 controller | 036 – 060 |
| DNECOMZR024A02 | Horizontal Fully Modulating – with W7212 controller | 036 – 060 |
| POWER EXHAUST | | |
| Model Number | Description | Use With Model Size |
| DNPWREXH030A01 | Vertical Power Exhaust 208/230 volt | 036 – 060 |
| DNPWREXH028A01 | Horizontal Power Exhaust 208/230 (Mounted on return air duct only) | 036 – 060 |
| 575V TRANSFORMER | | |
| Model Number | Description | Use With Model Size |
| HT01AH859 | Transformer for conversion from 575v to 208/230v power exhaust applications. | 036 – 060 |
| MANUAL OUTDOOR AIR DAMPERS | | |
| Model Number | Description | Use With Model Size |
| DNMANDPR001A03 | 25% Open Manual Fresh Air Damper | 036 – 060 |
| CRMANDPR001A02 | 50% Open Manual Fresh Air Damper | 036 – 060 |
| MOTORIZED OUTDOOR AIR DAMPERS | | |
| Model Number | Description | Use With Model Size |
| CRTWOPOS010A00 | Motorized 2 position outdoor air damper (25–100% Outdoor Air) | 036 – 060 |
| LOW AMBIENT CONTROLS * | | |
| Model Number | Description | Use With Model Size |
| 32LT900611 | –20° Low Ambient Control 575–3–60 | 036 – 060 |
| HC40GE463 | Low Ambient control compatible with Condenser Fan Motor 575–3–60 | 036 – 060 |
| * See usage tables in kit instructions. | | |
| THROUGH-THE-BOTTOM/CURB POWER CONNECTION | | |
| Model Number | Description | Use With Model Size |
| CRBTMPWR001A01 | Thru-the-bottom electrical + thru-the curb Gas | 036 – 060 |
| CRBTMPWR003A01 | Thru-the-bottom electrical and Gas | 036 – 060 |
| ECONOMIZER SENSORS | | |
| Model Number | Description | Use With Model Size |
| DNTEMPSN002A00 | Single (dry bulb) Control | ALL Economizers With W7212 Contoller |
| DNCBDIOX005A00 | CO2 Sensor and aspirator box for use in return airstream. | ALL Economizers With W7212 Contoller |
| DNENTDIF004A00 | Return Air Enthalpy Sensor | ALL Economizers With W7212 Contoller |
| AXB078ENT | Enthalpy Control | ALL |
| LP GAS CONVERSION KITS | | |
| Model Number | Description | Use With Model Size |
| CRLPELEV001A00 | LP and Hi Altitude conversion kit. Contains spuds sizes 31, 32, 33, 35, and 36. | 036 – 060 |
| CRLPELEV002A00 | LP and Hi Altitude conversion kit. Contains spuds sizes 37, 38, 39, 44, and 45. | 036 – 060 |
| CRLPELEV003A00 | LP and Hi Altitude conversion kit. Contains spuds sizes 46, 47, 48, 49, and 50. | 036 – 060 |
| CRLPELEV004A00 | LP and Hi Altitude conversion kit. Contains spuds sizes 51, 52, 53, 54, and 55. | 036 – 060 |
| HEATING UPGRADE KITS | | |
| Model Number | Description | Use With Model Size |
| CRFLUEDS001A00 | Flue Discharge Deflector | 036 – 060 |
| CRFLUEHD001A01 | Flue Exhaust Heat Shield | 036 – 060 |

ACCESSORIES – RGS036–060 (cont.)

| CONTROL UPGRADE KITS | | |
|----------------------|--|---------------------|
| Model Number | Description | Use With Model Size |
| CRSTATUS001A00 | Fan/Filter Status Switch | 036 – 060 |
| NRTIMEGD001A00 | Time Guard II | 036 – 060 |
| KA99ZT003 | Remote keyed attenuator / test / reset station | 036 – 060 |
| HAIL GUARDS | | |
| Model Number | Description | Use With Model Size |
| DNLVHLGD011A00 | Louvered Condenser Coil Hail Guard | 036 |
| DNLVHLGD012A00 | Louvered Condenser Coil Hail Guard | 048 – 060 |
| PHASE MONITOR | | |
| Model Number | Description | Use With Model Size |
| DNPULSE3001A01 | Electronic Phase Monitor | ALL |

Table 2 – ARI COOLING RATING TABLE

| UNIT RGS | NOM. CAPACITY (TONS) | NET COOLING CAPACITY (MBH) | TOTAL POWER (KW) | SEER | EER | IPLV | IEER |
|----------|----------------------|----------------------------|------------------|------|------|------|------|
| 036 | 3 | 34.6 | 3.1 | 13.0 | 11.0 | – | – |
| 048 | 4 | 45.0 | 4.0 | 13.0 | 11.0 | – | – |
| 060 | 5 | 59.0 | 5.5 | 13.0 | 10.8 | – | – |

LEGEND

- ARI – Air-Conditioning & Refrigeration Institute
- ASHRAE – American Society of Heating, Refrigerating and Air Conditioning, Inc.
- EER – Energy Efficiency Ratio
- IEER – Integrated Energy Efficiency Ratio
- SEER – Seasonal Energy Efficiency Ratio
- IPLV – Integrated Part Load Value



This product has been designed and manufactured to meet Energy Star® criteria for energy efficiency. However, proper refrigerant charge and proper air flow are critical to achieve rated capacity and efficiency. Installation of this product should follow all manufacturer's refrigerant charging and air flow instructions. **Failure to confirm proper charge and air flow may reduce energy efficiency and shorten equipment life.**

NOTES:

1. Rated and certified under ARI Standard 210/240–06 or 340/360–04, as appropriate.
2. Ratings are based on:
Cooling Standard: 80°F (27°C) db, 67°F (19°C) wb indoor air temp and 95°F (35°C) db outdoor air temp.
IPLV Standard: 80°F (27°C) db, 67°F (19°C) wb indoor air temp and 80°F (27°C) db outdoor air temp.
IEER Standard: Procedure described in ARI Standard 340/360.
3. All RGS units comply with ASHRAE 90.1 2001, 2004 Energy Standard for minimum SEER and EER requirements.
4. RGS units comply with US Energy Policy Act (2005). To evaluate code compliance requirements, refer to state and local codes or visit the following website: <http://bcap-energy.org>.



Table 3 – HEATING RATING TABLE – NATURAL GAS & LIQUID PROPANE

| UNIT RGS | Gas Heat | Heat Exchanger | | Temp Rise (deg F) | Thermal Efficiency (%) | AFUE (%) | |
|-------------|----------|------------------------------|------------------------------|-------------------|------------------------|----------|-----|
| | | Input / Output Stage 1 (MBH) | Input / Output Stage 2 (MBH) | | | | |
| Three Phase | 036 | LOW | – | 72.0 / 59.0 | 25 – 55 | 82% | 81% |
| | | MED | 82 / 66 | 115.0 / 93.0 | 55 – 85 | 80% | 80% |
| | | HIGH | – | – | – | – | – |
| | 048 | LOW | – | 72.0 / 59.0 | 25 – 55 | 82% | 81% |
| | | MED | – | 115.0 / 93.0 | 35 – 65 | 81% | 80% |
| | | HIGH | 120 / 96 | 150.0 / 120.0 | 50 – 80 | 80% | 80% |
| | 060 | LOW | – | 72.0 / 59.0 | 25 – 55 | 82% | 81% |
| | | MED | – | 115.0 / 93.0 | 35 – 65 | 81% | 80% |
| | | HIGH | 120 / 96 | 150.0 / 120.0 | 50 – 80 | 80% | 80% |

NOTE:

Heat ratings are for natural gas heat exchangers operated at or below 2000 ft. For information on LP or altitudes above 2000 ft (610m), see the Application Data section of this book. Accessory LP/High Altitude kits are also available.

Table 4 – SOUND PERFORMANCE TABLE

| UNIT RGS | OUTDOOR SOUND (dB) | | | | | | | | | |
|----------|--------------------|------------|------|------|------|------|------|------|------|------|
| | Cooling Stages | A-Weighted | 63 | 125 | 250 | 500 | 1000 | 2000 | 4000 | 8000 |
| 036 | 1 | 80 | 90.6 | 80.9 | 80.2 | 76.0 | 74.6 | 71.3 | 68.5 | 63.9 |
| 048 | 1 | 81 | 90.9 | 84.6 | 79.5 | 77.9 | 76.5 | 71.1 | 66.9 | 62.5 |
| 060 | 1 | 78 | 84.0 | 82.2 | 76.3 | 74.8 | 72.5 | 68.8 | 65.6 | 61.8 |

LEGEND

dB – Decibel

NOTES:

1. Outdoor sound data is measure in accordance with ARI standard 270–95.
2. Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure depends on specific environmental factors which normally do not match individual applications. Sound power values are independent of the environment and therefore more accurate.
3. A-weighted sound ratings filter out very high and very low frequencies, to better approximate the response of “average” human ear. A-weighted measurements are taken in accordance with ARI standard 270–95.



Table 5 – MINIMUM – MAXIMUM AIRFLOW RATINGS – NATURAL GAS & LIQUID PROPANE

| UNIT RGS | HEAT LEVEL | COOLING | | HEATING | |
|----------|------------|---------|---------|---------|---------|
| | | Minimum | Maximum | Minimum | Maximum |
| 036 | LOW | | | 990 | 2190 |
| | MED | 900 | 1500 | 1000 | 1550 |
| | HIGH | | | – | – |
| 048 | LOW | | | 990 | 2190 |
| | MED | 1200 | 2000 | 1330 | 2460 |
| | HIGH | | | 1390 | 2220 |
| 060 | LOW | | | 990 | 2190 |
| | MED | 1500 | 2500 | 1330 | 2460 |
| | HIGH | | | 1390 | 2220 |

Table 6 – PHYSICAL DATA (COOLING) 3 – 5 TONS

| | | RGS036S | RGS048S | RGS060S |
|------------------------------------|------------------------|-----------------|-----------------|-----------------|
| Refrigeration System | | | | |
| # Circuits / # Comp. / Type | | 1 / 1 / Scroll | 1 / 1 / Scroll | 1 / 1 / Scroll |
| R-410A charge lbs-oz. | | 5-10 | 8-8 | 10-11 |
| Oil (oz) | | 25 | 42 | 42 |
| Metering Device | | | Fixed | |
| High-press. Trip / Reset (psig) | | 630 / 505 | 630 / 505 | 630 / 505 |
| Low-press. Trip / Reset (psig) | | 54 / 117 | 54 / 117 | 54 / 117 |
| Evap. Coil | | | | |
| Material | | Cu / Al | Cu / Al | Cu / Al |
| Coil type | | 3/8" RTPF * | 3/8" RTPF * | 3/8" RTPF * |
| Rows / FPI | | 2 / 15 | 2 / 15 | 4 / 15 |
| Total Face Area (ft ²) | | 5.5 | 5.5 | 5.5 |
| Condensate Drain Conn. Size | | 3/4" | 3/4" | 3/4" |
| Evap. Fan and Motor | | | | |
| Standard Static 3 phase | Motor Qty / Drive Type | 1 / Belt | 1 / Belt | 1 / Belt |
| | Max BHP | 1.2 | 1.2 | 1.2 |
| | RPM Range | 560-854 | 560-854 | 770-1175 |
| | Motor Frame Size | 48 | 48 | 48 |
| | Fan Qty / Type | 1 / Centrifugal | 1 / Centrifugal | 1 / Centrifugal |
| | Fan Diameter (in) | 10 x 10 | 10 x 10 | 10 x 10 |
| High Static 3 phase | Motor Qty / Drive Type | 1 / Belt | 1 / Belt | 1 / Belt |
| | Max BHP | 2.4 | 2.4 | 2.9 |
| | RPM Range | 1035-1466 | 1035-1466 | 1303-1687 |
| | Motor Frame Size | 56 | 56 | 56 |
| | Fan Qty / Type | 1 / Centrifugal | 1 / Centrifugal | 1 / Centrifugal |
| | Fan Diameter (in) | 10 x 10 | 10 x 10 | 10 x 10 |
| Cond. Coil | | | | |
| Material | | Cu / Al | Cu / Al | Cu / Al |
| Coil type | | 3/8" RTPF * | 3/8" RTPF * | 3/8" RTPF * |
| Rows / FPI | | 1 / 17 | 2 / 17 | 2 / 17 |
| Total Face Area (ft ²) | | 14.6 | 12.6 | 16.5 |
| Cond. fan / motor | | | | |
| Qty / Motor Drive Type | | 1/ Direct | 1/ Direct | 1/ Direct |
| Motor HP / RPM | | 1/4 / 1100 | 1/4 / 1100 | 1/4 / 1100 |
| Fan diameter (in) | | 22 | 22 | 22 |
| Filters | | | | |
| RA Filter # / Size (in) | | 2 / 16 x 25 x 2 | 2 / 16 x 25 x 2 | 2 / 16 x 25 x 2 |
| OA inlet screen # / Size (in) | | 1 / 20 x 24 x 1 | 1 / 20 x 24 x 1 | 1 / 20 x 24 x 1 |



* RTPF – Round Tube Plate Fin Coil Design


Table 7 – PHYSICAL DATA (HEATING) 3 – 5 TONS

| | | RGS036S | RGS048S | RGS060S |
|--|--|-------------------|-------------------|-------------------|
| Gas Connection | | | | |
| | # of Gas Valves | 1 | 1 | 1 |
| | Nat. gas supply line press (in. w.g.)/(PSIG) | 4–13 / 0.18–0.47 | 4–13 / 0.18–0.47 | 4–13 / 0.18–0.47 |
| | LP supply line press (in. w.g.)/(PSIG) | 11–13 / 0.40–0.47 | 11–13 / 0.40–0.47 | 11–13 / 0.40–0.47 |
| Heat Anticipator Setting (Amps) | | | | |
| | 1st stage | 0.14 | 0.14 | 0.14 |
| | 2nd stage | 0.14 | 0.14 | 0.14 |
| Natural Gas, Propane Heat | | | | |
| LOW | Connection size | 1/2" NPT | 1/2" NPT | 1/2" NPT |
| | # of stages / # of burners (total) | 1 / 2 | 1 / 2 | 1 / 2 |
| | Rollout switch opens / Closes | 195 / 115 | 195 / 115 | 195 / 115 |
| | Temperature rise (min/max) | 25 / 55 | 25 – 55 | 25 – 55 |
| MED | Connection size | 1/2" NPT | 1/2" NPT | 1/2" NPT |
| | # of stages / # of burners (total) | 1 or 2 / 3 | 1 / 3 | 1 / 3 |
| | Rollout switch opens / Closes | 195 / 115 | 195 / 115 | 195 / 115 |
| | Temperature rise (min/max) | 55 / 85 | 35 / 65 | 35 / 65 |
| HIGH | Connection size | 1/2" NPT | 1/2" NPT | 1/2" NPT |
| | # of stages / # of burners (total) | – | 1 or 2 / 3 | 1 or 2 / 3 |
| | Rollout switch opens / Closes | – | 195 / 115 | 195 / 115 |
| | Temperature rise (min/max) | – | 50 / 80 | 50 / 80 |

BASE UNIT DIMENSIONS – RGS036–060

NOTES:

1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN () ARE IN MILLIMETERS.
2.  CENTER OF GRAVITY
3.  DIRECTION OF AIR FLOW

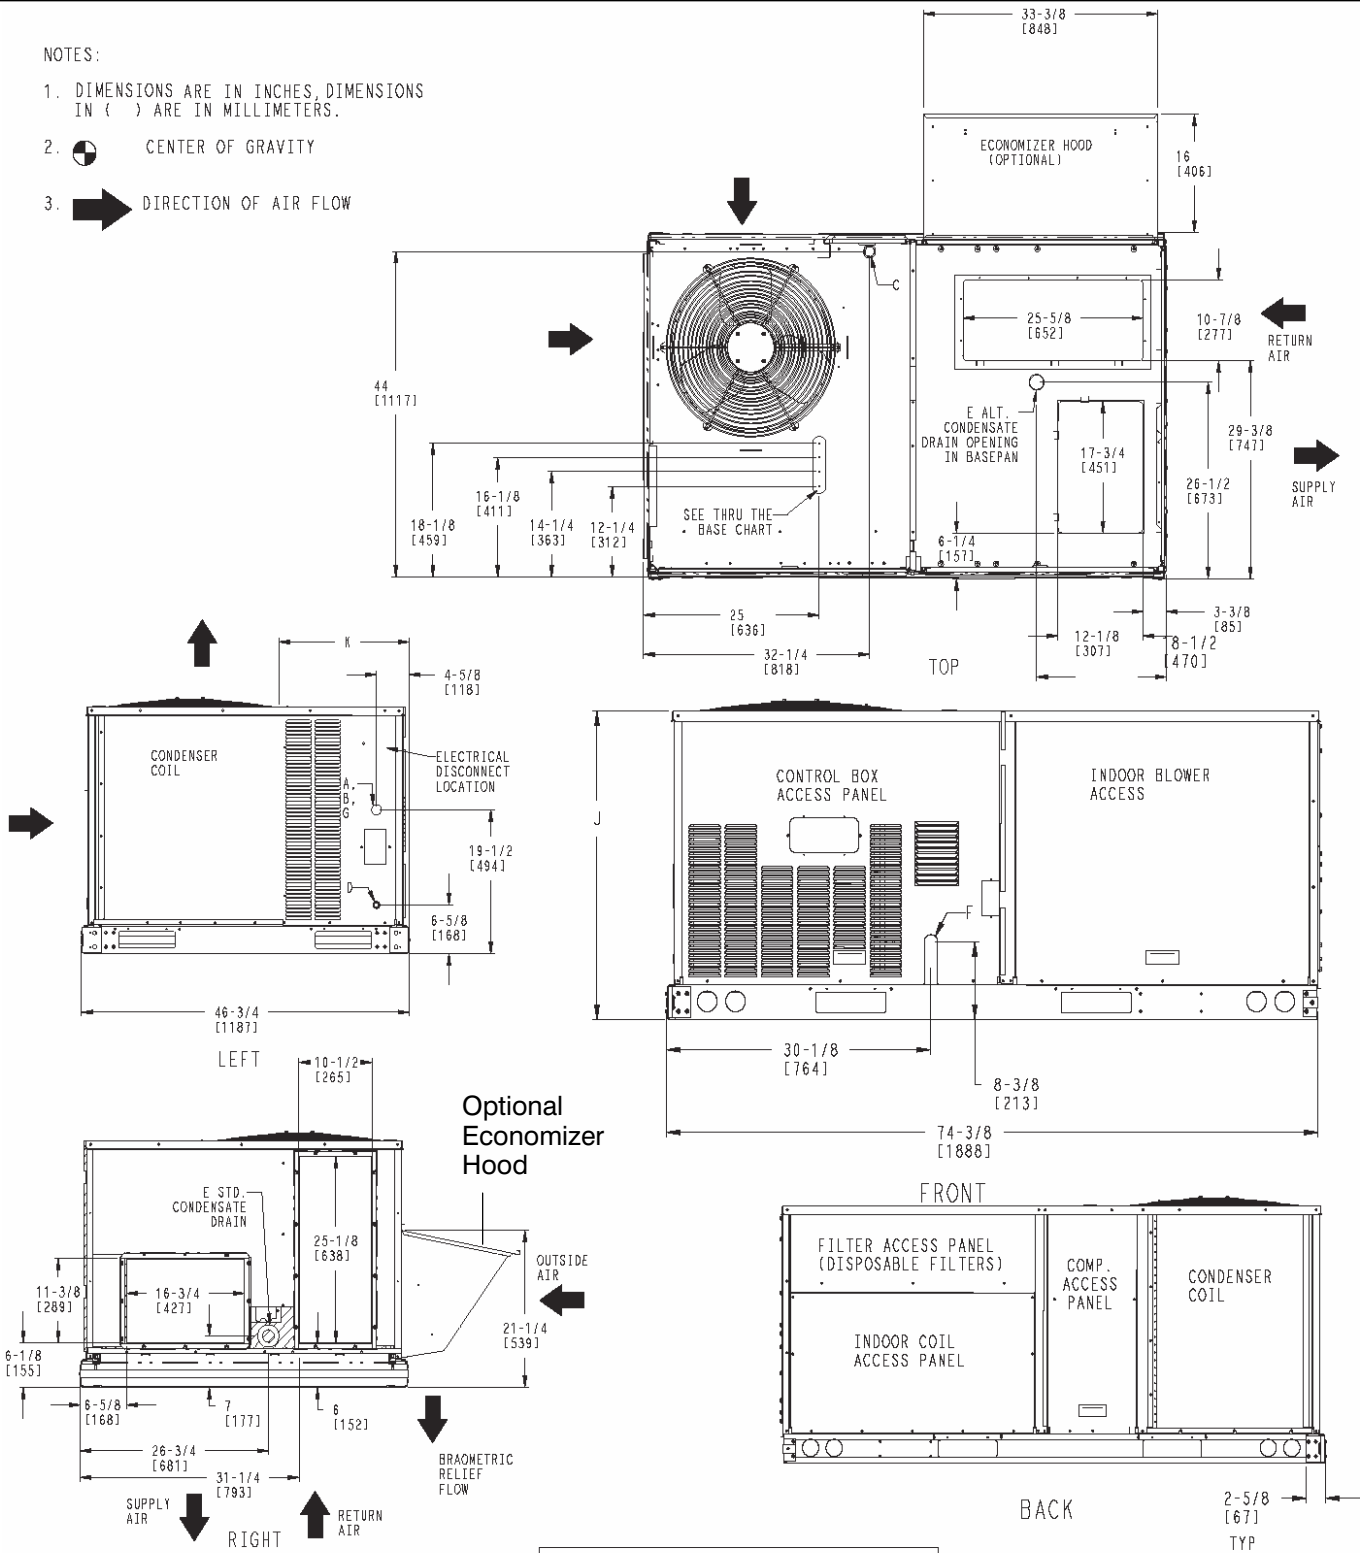

| CONNECTION SIZES | | |
|------------------|-----------------|---------------------------|
| A | 1 3/8" DIA [35] | FIELD POWER SUPPLY HOLE |
| B | 2" [50] DIA | POWER SUPPLY KNOCKOUT |
| C | 1 3/4" DIA [51] | GUAGE ACCESS PLUG |
| D | 7/8" DIA [22] | FIELD CONTROL WIRING HOLE |
| E | 3/4"-14 NPT | CONDENSATE DRAIN |
| F | 1/2"-14 NPT | GAS CONNECTION |
| G | 2 1/2" DIA [64] | POWER SUPPLY KNOCK-OUT |


| THRU THE BASE CHART THESE HOLES REQ'D FOR USE CRBTMPWR001A01, 3A01 | | |
|--|--------|---------------|
| 1/2" | ACC. | 7/8" (22.2) |
| 1/2" | 24V | 7/8" (22.2) |
| 3/4" (001, 003) | POWER* | 1 1/8" (28.4) |
| (003) 1/2" FTP | GAS | 1 1/4" (31.8) |

* SELECT EITHER 3/4" OR 1 1/4" FOR POWER, DEPENDING ON WIRE SIZE

| UNIT | J | K |
|------|--------------|--------------|
| 036 | 33 3/8 [847] | 18 5/8 [472] |
| 048 | 33 3/8 [847] | 14 7/8 [377] |
| 060 | 33 3/8 [847] | 14 7/8 [377] |


WEIGHT & CLEARANCE DIMENSIONS – RGS036–060

| UNIT | BASE UNIT WEIGHT | | Corner Weight A | | Corner Weight B | | Corner Weight C | | Corner Weight D | | Center of Gravity In [mm] | | Height In [mm] |
|--------|------------------|-----|-----------------|----|-----------------|----|-----------------|----|-----------------|----|---------------------------|----------|----------------|
| | LBS | KG | LBS | KG | LBS | KG | LBS | KG | LBS | KG | X | Y | Z |
| RGS036 | 483 | 219 | 111 | 50 | 125 | 57 | 131 | 59 | 116 | 53 | 39 [991] | 23 [584] | 16–3/8 [416] |
| RGS048 | 537 | 244 | 124 | 56 | 139 | 63 | 145 | 66 | 129 | 59 | 39 [991] | 23 [584] | 17 [432] |
| RGS060 | 569 | 258 | 131 | 59 | 147 | 67 | 154 | 70 | 137 | 62 | 39 [991] | 23 [584] | 17–1/4 [438] |

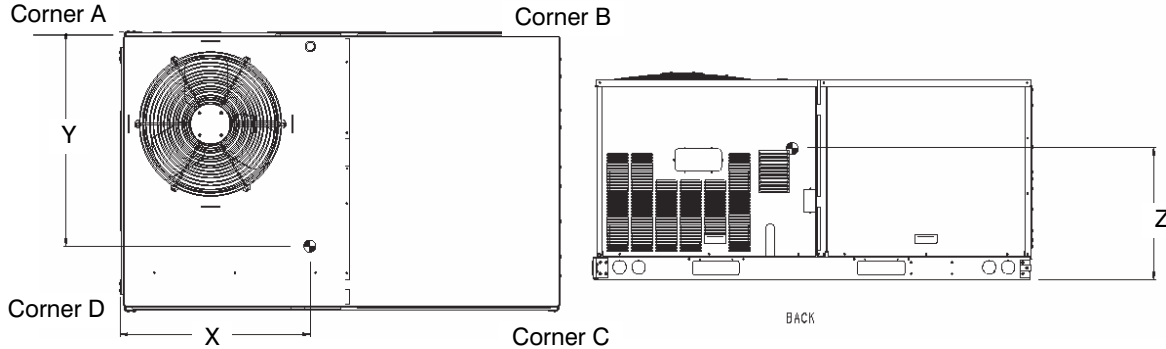

UNIT CLEARANCES

| LOC | DIMENSION | CONDITION |
|-----|---------------|--|
| A | 48" (1219 mm) | Unit disconnect is mounted on panel |
| | 18" (457 mm) | No disconnect, convenience outlet |
| | 18" (457 mm) | Recommended service clearance |
| | 12" (305 mm) | Minimum clearance |
| B | 42" (1067 mm) | Surface behind servicer is grounded (e.g., metal, masonry wall) |
| | 36" (914 mm) | Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass) |
| | Special | Check for sources of flue products within 10-ft of unit fresh air intake hood |
| C | 36" (914 mm) | Side condensate drain is used |
| | 18" (457 mm) | Minimum clearance |
| D | 48" (1219 mm) | No flue discharge accessory installed, surface is combustible material |
| | 42" (1067 mm) | Surface behind servicer is grounded (e.g., metal, masonry wall, another unit) |
| | 36" (914 mm) | Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass) |
| | Special | Check for adjacent units or building fresh air intakes within 10-ft of this unit's flue outlet |

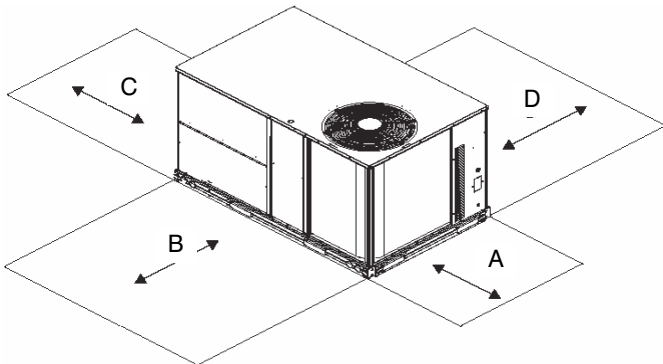


ROOF CURB DETAILS – RGS036–060

| RoofCurb Accessory | A | Unit Size |
|--------------------|-------------|------------|
| CRRFCURB001A01 | 1' 2" [356] | RGS036–060 |
| CRRFCURB002A01 | 2' 0" [610] | |

NOTES:

1. Roofcurb accessory is shipped disassembled.
2. Insulated panels, 1" thick polyurethane foam, 1–3/4# density.
3. Dimensions in. [] in millimeters.
4. Roofcurb 16ga steel.
5. Attach ductwork to curb (Flanges of duct rest on curb)
6. Service clearance 4' on each side.
7. ➡ Direction of airflow.
8. Connector pkg. CRBTMPWR001A01 is for thru–the–curb connections.
Pkg. CRBTMPWR003A01 is for thru–the–bottom connections.

| Connector Pkg. Acc. | B | C | D Alt. Drain Hole | Gas | Power | Control | Accessory Power |
|---------------------|-------------------|-------------|-------------------|-----------------|---------------|-----------------|-----------------|
| CRBTMPWR001A01 | 1' 9–11/16" [551] | 1' 4" [406] | 11–3/4" [44.5] | 3/4" [19] NPT | 3/4" [19] NPT | 1/2" [12.7] NPT | 1/2" [12.7] NPT |
| CRBTMPWR003A01 | | | | 1/2" [12.7] NPT | | | |

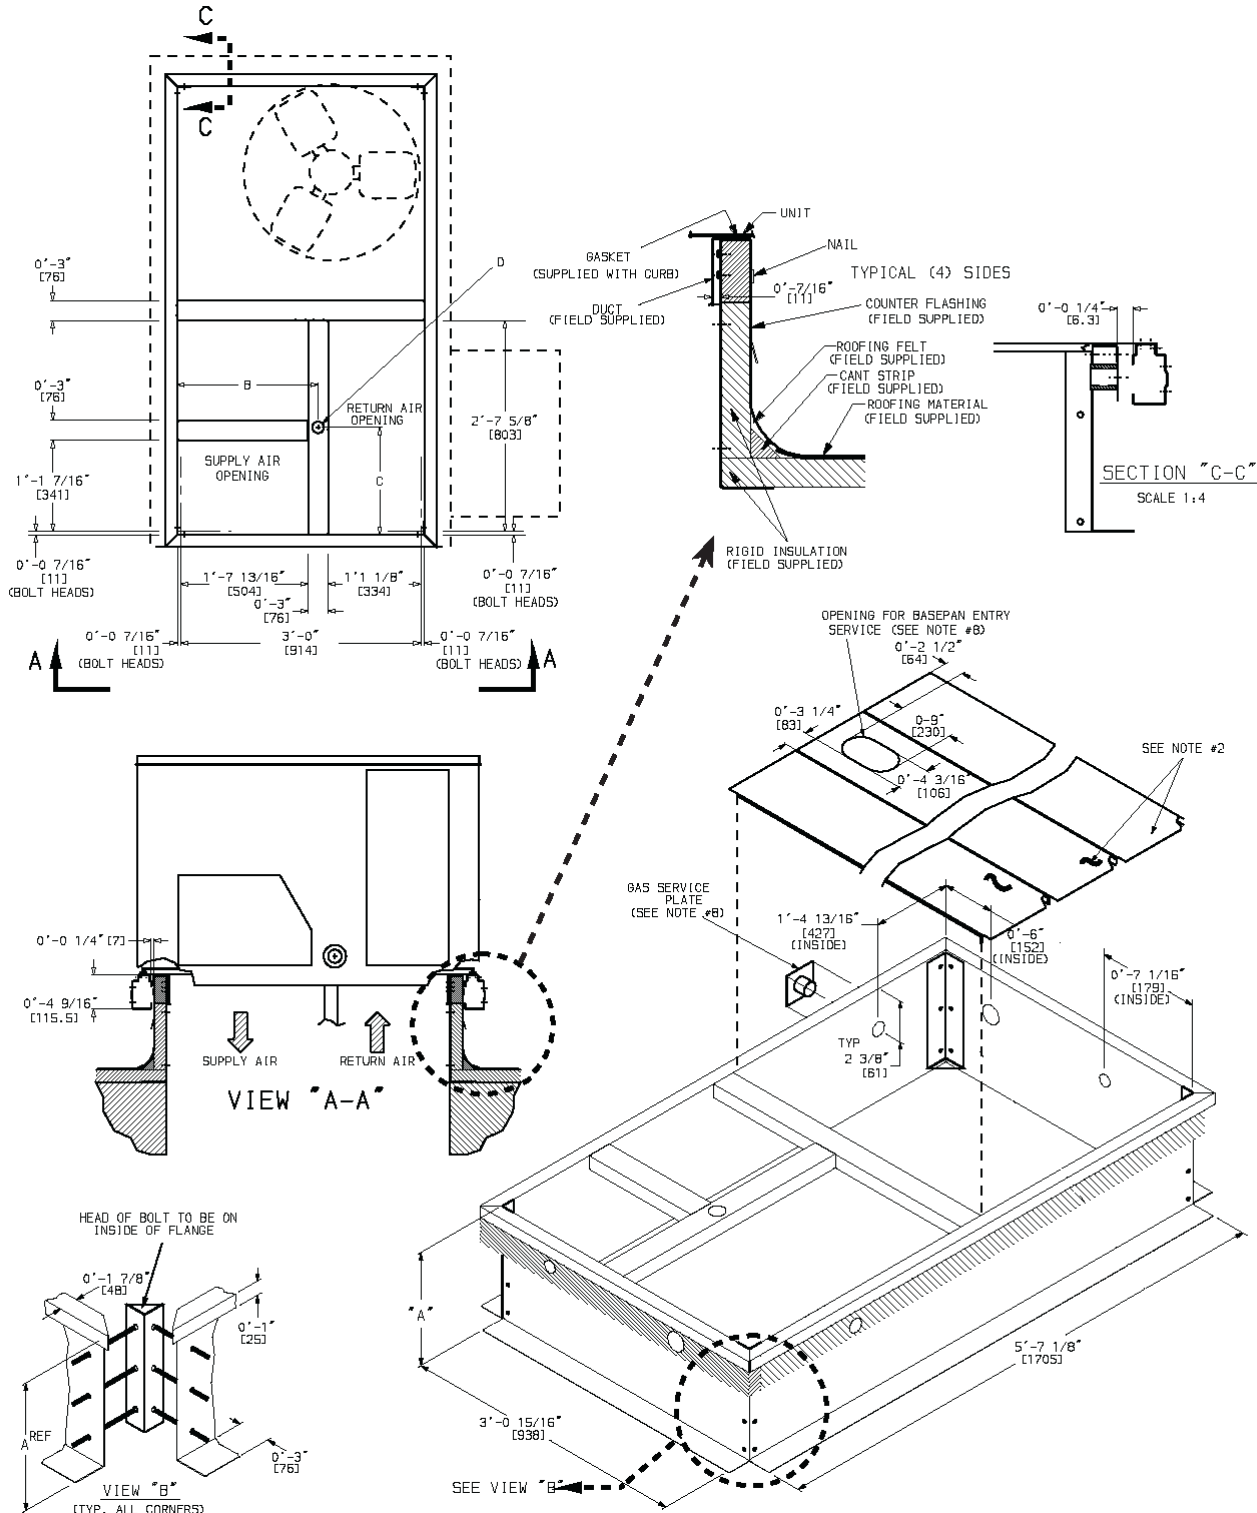

APPLICATION DATA

Min operating ambient temp (cooling):

In mechanical cooling mode, this rooftop can safely operate down to an outdoor ambient temperature of 25°F (-4°C), with an accessory winter start kit; 40°F (4°C) standard min operating temperature. It is possible to provide cooling at lower outdoor ambient temperatures by using less outside air, economizers, and/or accessory low ambient kits.

Max operating ambient temp (cooling):

The maximum operating ambient temperature for cooling mode is 115°F (46°C). While cooling operation above 115°F (46°C) may be possible, it could cause either a reduction in performance, reliability, or a protective action by the unit's internal safety devices.

Min mixed air temp (heating):

Using the factory settings, the minimum temperatures for the mixed air (the combined temperature of the warm return air and the cold outdoor air) entering the dimpled, gas heat exchangers are:

Aluminized

50°F (10°C) continuous

45°F (7°C) intermittent

Operating at lower mixed-air temperatures may be possible, if a field-supplied, outdoor air thermostat initiates both heat stages when the temperature is less than the minimum temperatures listed above. Please contact your local representative for assistance.

Min and max airflow (heating and cooling):

To maintain safe and reliable operation of this rooftop, operate within the heating airflow limits during heating mode and cooling airflow limits during cooling mode. Operating above the max may cause blow-off, undesired airflow noise, or airflow related problems with the rooftop unit. Operating below the min may cause problems with coil freeze-up and unsafe heating operation. Heating and cooling limitations differ when evaluating operating CFM, the minimum value is the HIGHER of the cooling and heating minimum CFM values published in Table 6 and the maximum value is the LOWER of the cooling and heating minimum values published in Table 6.

Heating-to-cooling changeover:

This unit will automatically change from heating to cooling mode when using a thermostat with an auto-change-over feature.

Airflow:

All units are draw-through in cooling mode and blow-through in heating mode.

Outdoor air application strategies:

Economizers reduce operating expenses and compressor run time by providing a free source of cooling and a means of ventilation to match application changing needs. In fact, they should be considered for most applications. Also, consider the various economizer control methods and their benefits, as well as sensors required to accomplish your application goals. Please contact your local sales representative for assistance.

Motor limits, break horsepower (BHP):

Due to the internal unit design, air path, and specially designed motors, the full horsepower (maximum continuous BHP) band, as listed in Table 7, can be used with the utmost confidence. There is no need for extra safety factors, the motors are designed and rigorously tested to use the entire, listed BHP

range without either nuisance tripping or premature motor failure.

Liquid propane heating:

Liquid propane (LP) has different physical qualities than natural gas. As a result, LP requires different fuel to air mixture. To optimize the fuel/air mixture for LP, different burner orifices in an easy to install accessory kits are available from your dealer. To select the correct burner orifices or determine the heat capacity for an LP application, use either the selection software, or the unit's service manual.

High altitude heating:

High altitudes have less oxygen, which affects the fuel/air mixture in heat exchangers. In order to maintain a proper fuel/air mixture, heat exchangers operating in altitudes above 2000 ft (610m) require different orifices. To select the correct burner orifices or determine the heat capacity for a high altitude application, use either the selection software, or the unit's service manual.

High altitudes have less oxygen, which means heat exchangers need less fuel. The new gas orifices in this field-installed kit make the necessary adjustment for high altitude applications. They restore the optimal fuel to air mixture and maintain healthy combustion on altitudes above 2000 ft (610m).

NOTE: Typical natural gas heating value ranges from 975 to 1050 Btu/ft³ at sea level nationally. The heating value goes down approximately 1.7% per every thousand feet elevation. Standard factory orifices can typically be used up to 2000 ft (610m) elevation without any operational issues.

Sizing a rooftop

While an air conditioner needs to have enough capacity to meet the design loads, it doesn't need excess capacity. In fact, excess capacity typically results in very poor partload performance and humidity control.

Using higher design temperatures than ASHRAE recommends for your location, adding "safety factors" to the calculated load, are all signs of oversizing air conditioners. Oversizing the air conditioner leads to short cycling (quick on-off cycles) which results in poor humidity control, reduced efficiency, higher utility bills, larger indoor temperature swings, excessive noise, and increased wear and tear on the air conditioner.

Rather than oversizing an air conditioner, engineers should "right-size" or even slightly undersize air conditioners. Correctly sizing an air conditioner controls humidity better; promotes efficiency; reduces utility bills; extends equipment life, and maintains even, comfortable temperatures. Please contact your local representative for assistance.

Low ambient applications

The optional economizer can adequately cool your space by bringing in fresh, cool outside air. In fact, when so equipped, accessory low-ambient kit may not be necessary. In low ambient conditions, unless the outdoor air is excessively humid or contaminated, economizer-based "free cooling" is the preferred less costly and energy conscious method.

In low ambient applications where outside air might not be desired (such as contaminated or excessively humid outdoor environments), your rooftop can operate to ambient temperatures down to -20°F (-29°C) using the recommended accessory low ambient controller.

Table 8 – COOLING CAPACITIES 3 TONS

| RGS036 | | | | AMBIENT TEMPERATURE | | | | | | | | | | | |
|----------|----------|-----|------|---------------------|------|------|----------|------|------|----------|------|------|----------|------|------|
| | | | | 85 | | | 95 | | | 105 | | | 115 | | |
| | | | | EAT (db) | | | EAT (db) | | | EAT (db) | | | EAT (db) | | |
| | | | | 75 | 80 | 85 | 75 | 80 | 85 | 75 | 80 | 85 | 75 | 80 | 85 |
| 900 Cfm | EAT (wb) | 58 | TC | 28.1 | 28.1 | 31.7 | 26.3 | 26.3 | 29.8 | 24.5 | 24.5 | 27.7 | 22.6 | 22.6 | 25.5 |
| | | | SHC | 24.4 | 28.1 | 31.7 | 22.9 | 26.3 | 29.8 | 21.3 | 24.5 | 27.7 | 19.6 | 22.6 | 25.5 |
| | | 62 | TC | 30.3 | 30.3 | 31.0 | 27.8 | 27.8 | 29.8 | 25.1 | 25.1 | 28.4 | 22.6 | 22.6 | 26.5 |
| | | | SHC | 22.6 | 26.8 | 31.0 | 21.5 | 25.7 | 29.8 | 20.2 | 24.3 | 28.4 | 18.7 | 22.6 | 26.5 |
| | | 67 | TC | 35.5 | 35.5 | 35.5 | 33.1 | 33.1 | 33.1 | 30.5 | 30.5 | 30.5 | 27.5 | 27.5 | 27.5 |
| | SHC | | 19.5 | 23.7 | 27.9 | 18.5 | 22.7 | 26.9 | 17.4 | 21.6 | 25.8 | 16.2 | 20.4 | 24.6 | |
| | 72 | TC | 39.0 | 39.0 | 39.0 | 37.1 | 37.1 | 37.1 | 35.1 | 35.1 | 35.1 | 32.7 | 32.7 | 32.7 | |
| | | SHC | 15.3 | 19.5 | 23.7 | 14.5 | 18.8 | 23.0 | 13.7 | 17.9 | 22.2 | 12.9 | 17.1 | 21.3 | |
| | 76 | TC | - | 41.4 | 41.4 | - | 39.6 | 39.6 | - | 37.6 | 37.6 | - | 35.4 | 35.4 | |
| | | SHC | - | 16.0 | 21.0 | - | 15.4 | 20.2 | - | 14.6 | 19.3 | - | 13.8 | 18.3 | |
| 1050 Cfm | EAT (wb) | 58 | TC | 30.2 | 30.2 | 34.2 | 28.4 | 28.4 | 32.2 | 26.5 | 26.5 | 30.0 | 24.5 | 24.5 | 27.7 |
| | | | SHC | 26.3 | 30.2 | 34.2 | 24.7 | 28.4 | 32.2 | 23.1 | 26.5 | 30.0 | 21.3 | 24.5 | 27.7 |
| | | 62 | TC | 31.9 | 31.9 | 34.2 | 29.4 | 29.4 | 32.8 | 26.7 | 26.7 | 31.2 | 24.5 | 24.5 | 28.8 |
| | | | SHC | 24.6 | 29.4 | 34.2 | 23.4 | 28.1 | 32.8 | 22.0 | 26.6 | 31.2 | 20.3 | 24.5 | 28.8 |
| | | 67 | TC | 36.7 | 36.7 | 36.7 | 34.8 | 34.8 | 34.8 | 32.2 | 32.2 | 32.2 | 29.1 | 29.1 | 29.1 |
| | SHC | | 20.6 | 25.4 | 30.2 | 19.8 | 24.6 | 29.4 | 18.8 | 23.6 | 28.4 | 17.6 | 22.4 | 27.2 | |
| | 72 | TC | 40.1 | 40.1 | 40.1 | 38.2 | 38.2 | 38.2 | 36.1 | 36.1 | 36.1 | 33.7 | 33.7 | 33.7 | |
| | | SHC | 15.7 | 20.5 | 25.3 | 15.0 | 19.8 | 24.6 | 14.2 | 19.0 | 23.8 | 13.4 | 18.2 | 23.0 | |
| | 76 | TC | - | 42.4 | 42.4 | - | 40.6 | 40.6 | - | 38.5 | 38.5 | - | 36.2 | 36.2 | |
| | | SHC | - | 16.6 | 22.2 | - | 15.9 | 21.3 | - | 15.2 | 20.4 | - | 14.4 | 19.5 | |
| 1200 Cfm | EAT (wb) | 58 | TC | 32.2 | 32.2 | 36.4 | 30.4 | 30.4 | 34.3 | 28.4 | 28.4 | 32.1 | 26.3 | 26.3 | 29.7 |
| | | | SHC | 28.0 | 32.2 | 36.4 | 26.4 | 30.4 | 34.3 | 24.7 | 28.4 | 32.1 | 22.8 | 26.3 | 29.7 |
| | | 62 | TC | 33.3 | 33.3 | 37.0 | 30.8 | 30.8 | 35.5 | 28.4 | 28.4 | 33.4 | 26.3 | 26.3 | 30.9 |
| | | | SHC | 26.4 | 31.7 | 37.0 | 25.1 | 30.3 | 35.5 | 23.4 | 28.4 | 33.4 | 21.7 | 26.3 | 30.9 |
| | | 67 | TC | 37.7 | 37.7 | 37.7 | 35.6 | 35.6 | 35.6 | 33.4 | 33.4 | 33.4 | 30.4 | 30.4 | 30.4 |
| | SHC | | 21.7 | 27.0 | 32.4 | 20.9 | 26.3 | 31.6 | 20.0 | 25.4 | 30.8 | 18.8 | 24.2 | 29.6 | |
| | 72 | TC | 40.9 | 40.9 | 40.9 | 39.0 | 39.0 | 39.0 | 36.9 | 36.9 | 36.9 | 34.4 | 34.4 | 34.4 | |
| | | SHC | 16.1 | 21.5 | 26.8 | 15.4 | 20.8 | 26.1 | 14.7 | 20.0 | 25.4 | 13.8 | 19.2 | 24.5 | |
| | 76 | TC | - | 43.1 | 43.1 | - | 41.3 | 41.3 | - | 39.1 | 39.1 | - | 36.8 | 36.8 | |
| | | SHC | - | 17.1 | 23.1 | - | 16.4 | 22.3 | - | 15.7 | 21.4 | - | 14.9 | 20.5 | |
| 1350 Cfm | EAT (wb) | 58 | TC | - | - | - | 32.1 | 32.1 | 36.3 | 30.0 | 30.0 | 34.0 | 27.9 | 27.9 | 31.5 |
| | | | SHC | - | - | - | 27.9 | 32.1 | 36.3 | 26.1 | 30.0 | 34.0 | 24.2 | 27.9 | 31.5 |
| | | 62 | TC | 28.4 | 28.4 | 30.5 | 32.2 | 32.2 | 37.8 | 30.1 | 30.1 | 35.3 | 27.9 | 27.9 | 32.8 |
| | | | SHC | 17.6 | 24.1 | 30.5 | 26.6 | 32.2 | 37.8 | 24.8 | 30.1 | 35.3 | 23.0 | 27.9 | 32.8 |
| | | 67 | TC | 33.2 | 33.2 | 33.2 | 36.4 | 36.4 | 36.4 | 34.1 | 34.1 | 34.1 | 31.5 | 31.5 | 32.0 |
| | SHC | | 15.0 | 21.4 | 27.9 | 21.9 | 27.8 | 33.7 | 21.0 | 26.9 | 32.9 | 20.0 | 26.0 | 32.0 | |
| | 72 | TC | 37.5 | 37.5 | 37.5 | 39.7 | 39.7 | 39.7 | 37.5 | 37.5 | 37.5 | 35.0 | 35.0 | 35.0 | |
| | | SHC | 11.8 | 18.3 | 24.8 | 15.8 | 21.7 | 27.5 | 15.0 | 20.9 | 26.8 | 14.2 | 20.1 | 26.0 | |
| | 76 | TC | - | 40.1 | 40.1 | - | 41.8 | 41.8 | - | 39.6 | 39.6 | - | 37.3 | 37.3 | |
| | | SHC | - | 15.3 | 22.7 | - | 16.8 | 23.2 | - | 16.1 | 22.3 | - | 15.3 | 21.5 | |
| 1500 Cfm | EAT (wb) | 58 | TC | 28.1 | 28.1 | 34.2 | 33.7 | 33.7 | 38.1 | 31.6 | 31.6 | 35.7 | 29.3 | 29.3 | 33.2 |
| | | | SHC | 21.9 | 28.1 | 34.2 | 29.3 | 33.7 | 38.1 | 27.4 | 31.6 | 35.7 | 25.5 | 29.3 | 33.2 |
| | | 62 | TC | 30.3 | 30.3 | 33.8 | 33.7 | 33.7 | 39.6 | 31.6 | 31.6 | 37.1 | 29.4 | 29.4 | 34.5 |
| | | | SHC | 19.8 | 26.8 | 33.8 | 27.8 | 33.7 | 39.6 | 26.1 | 31.6 | 37.1 | 24.2 | 29.4 | 34.5 |
| | | 67 | TC | 35.5 | 35.5 | 35.5 | 36.9 | 36.9 | 36.9 | 34.6 | 34.6 | 34.9 | 32.0 | 32.0 | 34.0 |
| | SHC | | 16.7 | 23.7 | 30.7 | 22.8 | 29.2 | 35.7 | 21.9 | 28.4 | 34.9 | 21.0 | 27.5 | 34.0 | |
| | 72 | TC | 39.0 | 39.0 | 39.0 | 40.2 | 40.2 | 40.2 | 38.0 | 38.0 | 38.0 | 35.5 | 35.5 | 35.5 | |
| | | SHC | 12.4 | 19.5 | 26.6 | 16.1 | 22.5 | 28.8 | 15.4 | 21.7 | 28.1 | 14.6 | 21.0 | 27.4 | |
| | 76 | TC | - | 41.4 | 41.4 | - | 42.2 | 42.2 | - | 40.0 | 40.0 | - | - | - | |
| | | SHC | - | 16.0 | 24.3 | - | 17.2 | 24.0 | - | 16.5 | 23.2 | - | - | - | |

LEGEND:

- Do not operate
- Cfm - Cubic feet per minute (supply air)
- EAT(db) - Entering air temperature (dry bulb)
- EAT(wb) - Entering air temperature (wet bulb)
- SHC - Sensible heat capacity
- TC - Total cooling capacity

Table 9 – COOLING CAPACITIES 4 TONS

| RGS048 | | | | AMBIENT TEMPERATURE | | | | | | | | | | | |
|----------|----------|----|-----|---------------------|------|------|----------|------|------|----------|------|------|----------|------|------|
| | | | | 85 | | | 95 | | | 105 | | | 115 | | |
| | | | | EAT (db) | | | EAT (db) | | | EAT (db) | | | EAT (db) | | |
| | | | | 75 | 80 | 85 | 75 | 80 | 85 | 75 | 80 | 85 | 75 | 80 | 85 |
| 1200 Cfm | EAT (wb) | 58 | TC | - | - | - | - | - | - | 36.1 | 36.1 | 40.7 | 34.3 | 34.3 | 38.6 |
| | | | SHC | - | - | - | - | - | - | 31.5 | 36.1 | 40.7 | 29.9 | 34.3 | 38.6 |
| | | 62 | TC | 43.1 | 43.1 | 43.1 | 40.8 | 40.8 | 40.8 | 38.4 | 38.4 | 39.4 | 35.9 | 35.9 | 38.2 |
| | | | SHC | 31.2 | 36.4 | 41.7 | 30.1 | 35.3 | 40.6 | 28.9 | 34.1 | 39.4 | 27.8 | 33.0 | 38.2 |
| | | 67 | TC | 47.4 | 47.4 | 47.4 | 45.2 | 45.2 | 45.2 | 42.9 | 42.9 | 42.9 | 40.3 | 40.3 | 40.3 |
| | | | SHC | 25.9 | 31.2 | 36.4 | 25.0 | 30.2 | 35.5 | 23.9 | 29.2 | 34.4 | 22.9 | 28.2 | 33.4 |
| | | 72 | TC | 51.1 | 51.1 | 51.1 | 49.1 | 49.1 | 49.1 | 46.8 | 46.8 | 46.8 | 43.9 | 43.9 | 43.9 |
| | | | SHC | 20.1 | 25.5 | 30.9 | 19.4 | 24.7 | 30.1 | 18.4 | 23.7 | 29.0 | 17.4 | 22.7 | 28.0 |
| | | 76 | TC | - | 53.3 | 53.3 | - | 51.5 | 51.5 | - | 49.2 | 49.2 | - | 45.9 | 45.9 |
| | | | SHC | - | 20.8 | 27.4 | - | 20.2 | 26.8 | - | 19.3 | 25.7 | - | 18.3 | 24.6 |
| 1400 cfm | EAT (wb) | 58 | TC | 41.9 | 41.9 | 47.3 | 40.1 | 40.1 | 45.3 | 38.2 | 38.2 | 43.2 | 36.3 | 36.3 | 41.0 |
| | | | SHC | 36.6 | 41.9 | 47.3 | 35.0 | 40.1 | 45.3 | 33.3 | 38.2 | 43.2 | 31.7 | 36.3 | 41.0 |
| | | 62 | TC | 44.6 | 44.6 | 45.4 | 42.3 | 42.3 | 44.2 | 39.8 | 39.8 | 42.9 | 37.3 | 37.3 | 41.6 |
| | | | SHC | 33.4 | 39.4 | 45.4 | 32.3 | 38.3 | 44.2 | 31.0 | 37.0 | 42.9 | 29.8 | 35.7 | 41.6 |
| | | 67 | TC | 48.7 | 48.7 | 48.7 | 46.6 | 46.6 | 46.6 | 44.2 | 44.2 | 44.2 | 41.4 | 41.4 | 41.4 |
| | | | SHC | 27.3 | 33.2 | 39.2 | 26.4 | 32.3 | 38.3 | 25.3 | 31.3 | 37.3 | 24.2 | 30.2 | 36.2 |
| | | 72 | TC | 52.2 | 52.2 | 52.2 | 50.3 | 50.3 | 50.3 | 47.8 | 47.8 | 47.8 | 44.8 | 44.8 | 44.8 |
| | | | SHC | 20.6 | 26.7 | 32.7 | 19.9 | 25.9 | 32.0 | 18.9 | 24.9 | 30.9 | 17.9 | 23.8 | 29.7 |
| | | 76 | TC | - | 54.1 | 54.1 | - | 52.3 | 52.3 | - | 49.9 | 49.9 | - | 46.4 | 46.4 |
| | | | SHC | - | 21.5 | 29.0 | - | 20.8 | 28.0 | - | 19.9 | 26.9 | - | 18.8 | 25.7 |
| 1600 Cfm | EAT (wb) | 58 | TC | 44.0 | 44.0 | 49.6 | 42.1 | 42.1 | 47.4 | 40.1 | 40.1 | 45.2 | 38.1 | 38.1 | 43.0 |
| | | | SHC | 38.3 | 44.0 | 49.6 | 36.7 | 42.1 | 47.4 | 34.9 | 40.1 | 45.2 | 33.2 | 38.1 | 43.0 |
| | | 62 | TC | 45.7 | 45.7 | 48.6 | 43.5 | 43.5 | 47.5 | 41.0 | 41.0 | 46.0 | 38.5 | 38.5 | 44.4 |
| | | | SHC | 35.3 | 42.0 | 48.6 | 34.2 | 40.8 | 47.5 | 32.9 | 39.4 | 46.0 | 31.6 | 38.0 | 44.4 |
| | | 67 | TC | 49.8 | 49.8 | 49.8 | 47.6 | 47.6 | 47.6 | 45.1 | 45.1 | 45.1 | 42.3 | 42.3 | 42.3 |
| | | | SHC | 28.4 | 35.0 | 41.6 | 27.6 | 34.2 | 40.9 | 26.5 | 33.2 | 39.9 | 25.4 | 32.1 | 38.7 |
| | | 72 | TC | 53.0 | 53.0 | 53.0 | 51.1 | 51.1 | 51.1 | 48.6 | 48.6 | 48.6 | 45.4 | 45.4 | 45.4 |
| | | | SHC | 21.0 | 27.6 | 34.3 | 20.3 | 27.0 | 33.6 | 19.4 | 26.0 | 32.6 | 18.3 | 24.8 | 31.3 |
| | | 76 | TC | - | 54.6 | 54.6 | - | 52.8 | 52.8 | - | 50.4 | 50.4 | - | 46.8 | 46.8 |
| | | | SHC | - | 22.0 | 29.9 | - | 21.3 | 29.0 | - | 20.3 | 27.9 | - | 19.2 | 26.6 |
| 1800 Cfm | EAT (wb) | 58 | TC | 44.0 | 44.0 | 50.3 | 42.1 | 42.1 | 48.1 | 40.1 | 40.1 | 45.9 | 38.0 | 38.0 | 43.5 |
| | | | SHC | 37.6 | 44.0 | 50.3 | 36.0 | 42.1 | 48.1 | 34.3 | 40.1 | 45.9 | 32.6 | 38.0 | 43.5 |
| | | 62 | TC | 45.7 | 45.7 | 49.5 | 43.5 | 43.5 | 48.3 | 41.0 | 41.0 | 46.8 | 38.4 | 38.4 | 45.2 |
| | | | SHC | 34.5 | 42.0 | 49.5 | 33.4 | 40.8 | 48.3 | 32.1 | 39.4 | 46.8 | 30.8 | 38.0 | 45.2 |
| | | 67 | TC | 49.8 | 49.8 | 49.8 | 47.6 | 47.6 | 47.6 | 45.1 | 45.1 | 45.1 | 42.3 | 42.3 | 42.3 |
| | | | SHC | 27.6 | 35.0 | 42.5 | 26.8 | 34.2 | 41.7 | 25.7 | 33.2 | 40.7 | 24.6 | 32.1 | 39.5 |
| | | 72 | TC | 53.0 | 53.0 | 53.0 | 51.1 | 51.1 | 51.1 | 48.6 | 48.6 | 48.6 | 45.4 | 45.4 | 45.4 |
| | | | SHC | 20.2 | 27.6 | 35.1 | 19.5 | 27.0 | 34.4 | 18.5 | 26.0 | 33.4 | 17.5 | 24.8 | 32.1 |
| | | 76 | TC | - | 54.6 | 54.6 | - | 52.8 | 52.8 | - | 50.4 | 50.4 | - | 46.8 | 46.8 |
| | | | SHC | - | 22.0 | 30.9 | - | 21.3 | 30.0 | - | 20.3 | 28.9 | - | 19.2 | 27.5 |
| 2000 Cfm | EAT (wb) | 58 | TC | 46.9 | 46.9 | 52.9 | 45.0 | 45.0 | 50.8 | 42.9 | 42.9 | 48.4 | 40.7 | 40.7 | 45.9 |
| | | | SHC | 40.9 | 46.9 | 52.9 | 39.3 | 45.0 | 50.8 | 37.4 | 42.9 | 48.4 | 35.5 | 40.7 | 45.9 |
| | | 62 | TC | 47.5 | 47.5 | 54.0 | 45.3 | 45.3 | 52.5 | 43.0 | 43.0 | 50.3 | 40.7 | 40.7 | 47.7 |
| | | | SHC | 38.5 | 46.3 | 54.0 | 37.3 | 44.9 | 52.5 | 35.6 | 43.0 | 50.3 | 33.8 | 40.7 | 47.7 |
| | | 67 | TC | 51.2 | 51.2 | 51.2 | 49.1 | 49.1 | 49.1 | 46.5 | 46.5 | 46.5 | 43.5 | 43.5 | 43.5 |
| | | | SHC | 30.5 | 38.3 | 46.0 | 29.8 | 37.6 | 45.5 | 28.7 | 36.6 | 44.5 | 27.5 | 35.4 | 43.2 |
| | | 72 | TC | 54.0 | 54.0 | 54.0 | 52.1 | 52.1 | 52.1 | 49.7 | 49.7 | 49.7 | 46.2 | 46.2 | 46.2 |
| | | | SHC | 21.7 | 29.2 | 36.8 | 21.1 | 28.7 | 36.4 | 20.1 | 27.8 | 35.4 | 18.9 | 26.4 | 33.9 |
| | | 76 | TC | - | 55.2 | 55.2 | - | 53.5 | 53.5 | - | 51.0 | 51.0 | - | 47.3 | 47.3 |
| | | | SHC | - | 22.7 | 31.4 | - | 22.0 | 30.6 | - | 21.1 | 29.6 | - | 19.9 | 28.1 |

LEGEND:

- Do not operate
- Cfm - Cubic feet per minute (supply air)
- EAT(db) - Entering air temperature (dry bulb)
- EAT(wb) - Entering air temperature (wet bulb)
- SHC - Sensible heat capacity
- TC - Total cooling capacity

Table 10 – COOLING CAPACITIES 5 TONS

| RGS060 | | | | AMBIENT TEMPERATURE | | | | | | | | | | | |
|----------|----------|-----|------|---------------------|------|------|----------|------|------|----------|------|------|----------|------|------|
| | | | | 85 | | | 95 | | | 105 | | | 115 | | |
| | | | | EAT (db) | | | EAT (db) | | | EAT (db) | | | EAT (db) | | |
| | | | | 75 | 80 | 85 | 75 | 80 | 85 | 75 | 80 | 85 | 75 | 80 | 85 |
| 1500 Cfm | EAT (wb) | 58 | TC | 52.9 | 52.9 | 60.0 | 49.9 | 49.9 | 56.6 | 46.6 | 46.6 | 52.9 | 43.1 | 43.1 | 48.9 |
| | | | SHC | 45.8 | 52.9 | 60.0 | 43.2 | 49.9 | 56.6 | 40.4 | 46.6 | 52.9 | 37.3 | 43.1 | 48.9 |
| | | 62 | TC | 56.2 | 56.2 | 57.6 | 52.2 | 52.2 | 55.7 | 47.8 | 47.8 | 53.5 | 43.2 | 43.2 | 51.0 |
| | | | SHC | 41.8 | 49.7 | 57.6 | 39.9 | 47.8 | 55.7 | 37.8 | 45.6 | 53.5 | 35.5 | 43.2 | 51.0 |
| | | 67 | TC | 62.4 | 62.4 | 62.4 | 58.8 | 58.8 | 58.8 | 54.4 | 54.4 | 54.4 | 49.5 | 49.5 | 49.5 |
| | SHC | | 34.8 | 42.8 | 50.7 | 33.2 | 41.2 | 49.1 | 31.4 | 39.3 | 47.3 | 29.4 | 37.3 | 45.3 | |
| | 72 | TC | 68.2 | 68.2 | 68.2 | 64.8 | 64.8 | 64.8 | 60.8 | 60.8 | 60.8 | 56.2 | 56.2 | 56.2 | |
| | | SHC | 27.2 | 35.2 | 43.2 | 25.9 | 33.9 | 41.9 | 24.4 | 32.4 | 40.4 | 22.6 | 30.6 | 38.6 | |
| | 76 | TC | - | 71.1 | 71.1 | - | 69.0 | 69.0 | - | 65.4 | 65.4 | - | 60.9 | 60.9 | |
| | | SHC | - | 28.4 | 36.6 | - | 27.6 | 35.9 | - | 26.3 | 34.6 | - | 24.8 | 33.0 | |
| 1750 Cfm | EAT (wb) | 58 | TC | 56.5 | 56.5 | 64.0 | 53.3 | 53.3 | 60.4 | 49.8 | 49.8 | 56.5 | 46.1 | 46.1 | 52.3 |
| | | | SHC | 48.9 | 56.5 | 64.0 | 46.1 | 53.3 | 60.4 | 43.1 | 49.8 | 56.5 | 39.9 | 46.1 | 52.3 |
| | | 62 | TC | 58.5 | 58.5 | 63.4 | 54.4 | 54.4 | 61.3 | 49.9 | 49.9 | 58.9 | 46.1 | 46.1 | 54.4 |
| | | | SHC | 45.2 | 54.3 | 63.4 | 43.2 | 52.2 | 61.3 | 41.0 | 49.9 | 58.9 | 37.9 | 46.1 | 54.4 |
| | | 67 | TC | 64.3 | 64.3 | 64.3 | 60.5 | 60.5 | 60.5 | 56.2 | 56.2 | 56.2 | 51.3 | 51.3 | 51.3 |
| | SHC | | 36.9 | 46.1 | 55.2 | 35.3 | 44.5 | 53.7 | 33.6 | 42.8 | 51.9 | 31.6 | 40.8 | 49.9 | |
| | 72 | TC | 69.5 | 69.5 | 69.5 | 66.5 | 66.5 | 66.5 | 62.4 | 62.4 | 62.4 | 57.7 | 57.7 | 57.7 | |
| | | SHC | 27.8 | 36.9 | 45.9 | 26.7 | 35.9 | 45.1 | 25.2 | 34.5 | 43.7 | 23.5 | 32.8 | 42.0 | |
| | 76 | TC | - | 72.2 | 72.2 | - | 70.1 | 70.1 | - | 66.6 | 66.6 | - | - | - | |
| | | SHC | - | 29.3 | 38.9 | - | 28.6 | 38.2 | - | 27.4 | 36.8 | - | - | - | |
| 2000 Cfm | EAT (wb) | 58 | TC | 59.3 | 59.3 | 67.3 | 56.1 | 56.1 | 63.6 | 52.5 | 52.5 | 59.5 | 48.6 | 48.6 | 55.1 |
| | | | SHC | 51.4 | 59.3 | 67.3 | 48.6 | 56.1 | 63.6 | 45.4 | 52.5 | 59.5 | 42.1 | 48.6 | 55.1 |
| | | 62 | TC | 60.1 | 60.1 | 68.5 | 56.2 | 56.2 | 66.3 | 52.5 | 52.5 | 62.0 | 48.7 | 48.7 | 57.4 |
| | | | SHC | 48.1 | 58.3 | 68.5 | 46.2 | 56.2 | 66.3 | 43.1 | 52.5 | 62.0 | 39.9 | 48.7 | 57.4 |
| | | 67 | TC | 65.7 | 65.7 | 65.7 | 61.9 | 61.9 | 61.9 | 57.5 | 57.5 | 57.5 | 52.6 | 52.6 | 54.4 |
| | SHC | | 38.8 | 49.1 | 59.5 | 37.3 | 47.7 | 58.1 | 35.6 | 46.0 | 56.4 | 33.6 | 44.0 | 54.4 | |
| | 72 | TC | 70.1 | 70.1 | 70.1 | 67.6 | 67.6 | 67.6 | 63.6 | 63.6 | 63.6 | 58.9 | 58.9 | 58.9 | |
| | | SHC | 28.3 | 38.1 | 48.0 | 27.4 | 37.7 | 48.0 | 26.0 | 36.4 | 46.7 | 24.3 | 34.7 | 45.2 | |
| | 76 | TC | - | 72.9 | 72.9 | - | 70.8 | 70.8 | - | 67.4 | 67.4 | - | - | - | |
| | | SHC | - | 30.1 | 40.7 | - | 29.3 | 39.9 | - | 28.2 | 38.7 | - | - | - | |
| 2250 Cfm | EAT (wb) | 58 | TC | 61.5 | 61.5 | 69.8 | 58.4 | 58.4 | 66.2 | 54.8 | 54.8 | 62.1 | 50.8 | 50.8 | 57.6 |
| | | | SHC | 53.2 | 61.5 | 69.8 | 50.5 | 58.4 | 66.2 | 47.4 | 54.8 | 62.1 | 43.9 | 50.8 | 57.6 |
| | | 62 | TC | 61.6 | 61.6 | 72.6 | 58.4 | 58.4 | 68.9 | 54.8 | 54.8 | 64.6 | 50.8 | 50.8 | 59.9 |
| | | | SHC | 50.6 | 61.6 | 72.6 | 47.9 | 58.4 | 68.9 | 45.0 | 54.8 | 64.6 | 41.7 | 50.8 | 59.9 |
| | | 67 | TC | 66.8 | 66.8 | 66.8 | 63.0 | 63.0 | 63.0 | 58.5 | 58.5 | 60.6 | 53.6 | 53.6 | 58.6 |
| | SHC | | 40.5 | 52.0 | 63.4 | 39.1 | 50.7 | 62.3 | 37.4 | 49.0 | 60.6 | 35.5 | 47.0 | 58.6 | |
| | 72 | TC | 70.8 | 70.8 | 70.8 | 68.5 | 68.5 | 68.5 | 64.5 | 64.5 | 64.5 | 59.8 | 59.8 | 59.8 | |
| | | SHC | 28.7 | 39.5 | 50.2 | 28.0 | 39.3 | 50.5 | 26.7 | 38.1 | 49.6 | 25.0 | 36.6 | 48.1 | |
| | 76 | TC | - | 73.4 | 73.4 | - | 71.2 | 71.2 | - | 67.9 | 67.9 | - | - | - | |
| | | SHC | - | 30.7 | 42.1 | - | 30.0 | 41.4 | - | 28.9 | 40.4 | - | - | - | |
| 2500 Cfm | EAT (wb) | 58 | TC | 63.3 | 63.3 | 71.8 | 60.1 | 60.1 | 68.2 | 56.5 | 56.5 | 64.1 | 52.6 | 52.6 | 59.6 |
| | | | SHC | 54.8 | 63.3 | 71.8 | 52.1 | 60.1 | 68.2 | 49.0 | 56.5 | 64.1 | 45.5 | 52.6 | 59.6 |
| | | 62 | TC | 63.4 | 63.4 | 74.7 | 60.2 | 60.2 | 71.0 | 56.6 | 56.6 | 66.7 | 52.6 | 52.6 | 62.1 |
| | | | SHC | 52.0 | 63.4 | 74.7 | 49.4 | 60.2 | 71.0 | 46.5 | 56.6 | 66.7 | 43.2 | 52.6 | 62.1 |
| | | 67 | TC | 67.6 | 67.6 | 67.6 | 63.8 | 63.8 | 66.2 | 59.3 | 59.3 | 64.6 | 54.4 | 54.4 | 62.5 |
| | SHC | | 42.1 | 54.6 | 67.1 | 40.9 | 53.5 | 66.2 | 39.2 | 51.9 | 64.6 | 37.2 | 49.8 | 62.5 | |
| | 72 | TC | 71.3 | 71.3 | 71.3 | 69.0 | 69.0 | 69.0 | 65.1 | 65.1 | 65.1 | 60.4 | 60.4 | 60.4 | |
| | | SHC | 29.1 | 40.7 | 52.2 | 28.5 | 40.7 | 52.9 | 27.3 | 39.7 | 52.2 | 25.7 | 38.3 | 50.9 | |
| | 76 | TC | - | 73.8 | 73.8 | - | 71.4 | 71.4 | - | 68.3 | 68.3 | - | - | - | |
| | | SHC | - | 31.2 | 43.3 | - | 30.5 | 42.6 | - | 29.6 | 41.9 | - | - | - | |

LEGEND:

- Do not operate
- Cfm - Cubic feet per minute (supply air)
- EAT(db) - Entering air temperature (dry bulb)
- EAT(wb) - Entering air temperature (wet bulb)
- SHC - Sensible heat capacity
- TC - Total cooling capacity

Table 11 – STATIC PRESSURE ADDERS (Factory Options and/or Accessories)

Economizer

| 3 – 5 TONS | | | | | | | | | | | |
|------------------------|------------|------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
| CFM | 600 | 800 | 1000 | 1250 | 1500 | 1750 | 2000 | 2250 | 2500 | 2750 | 3000 |
| Vertical Economizer | 0.01 | 0.02 | 0.04 | 0.05 | 0.07 | 0.09 | 0.12 | 0.15 | 0.18 | 0.22 | 0.26 |
| Horizontal Economizer* | 0.02 | 0.03 | 0.04 | 0.06 | 0.08 | 0.10 | 0.13 | 0.15 | 0.18 | 0.23 | 0.28 |

* Available as field installed accessories only.

GENERAL FAN PERFORMANCE NOTES

1. Interpolation is permissible. Do not extrapolate.
2. External static pressure is the static pressure difference between the return duct and the supply duct plus the static pressure caused by any FIOPs or accessories.
3. Tabular data accounts for pressure loss due to clean filters, unit casing, and wet coils. Factory options and accessories may add static pressure losses, as shown in Table 11. Selection software is available, through your salesperson, to help you select the best motor/drive combination for your application.
4. The Fan Performance tables offer motor/drive recommendations. In cases when two motor/drive combinations would work, recommend the lower horsepower option.
5. For information on the electrical properties of motors, please see the Electrical information section of this book.
6. For more information on the performance limits of motors, see the application data section of this book.

FAN PERFORMANCE

Table 12 – RGS036, 3 TON HORIZONTAL SUPPLY

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|-------------|------------------------|------|-----|------|---|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | Field-Supplied Drive ¹ | | Standard Static Option | | | | High Static Option with Field Supplied Drive ² | | | |
| 900 | 553 | 0.14 | 681 | 0.22 | 782 | 0.32 | 870 | 0.42 | 948 | 0.53 |
| 975 | 575 | 0.16 | 700 | 0.25 | 801 | 0.35 | 888 | 0.46 | 965 | 0.57 |
| 1050 | 597 | 0.18 | 720 | 0.28 | 820 | 0.38 | 906 | 0.49 | 983 | 0.61 |
| 1125 | 620 | 0.21 | 741 | 0.31 | 839 | 0.42 | 925 | 0.54 | 1001 | 0.66 |
| 1200 | 643 | 0.23 | 762 | 0.34 | 859 | 0.46 | 944 | 0.58 | 1020 | 0.71 |
| 1275 | 667 | 0.27 | 783 | 0.38 | 879 | 0.50 | 963 | 0.63 | 1038 | 0.76 |
| 1350 | 691 | 0.30 | 805 | 0.42 | 900 | 0.55 | 983 | 0.68 | 1057 | 0.82 |
| 1425 | 715 | 0.34 | 827 | 0.47 | 920 | 0.60 | 1002 | 0.74 | 1076 | 0.88 |
| 1500 | 740 | 0.38 | 849 | 0.52 | 941 | 0.66 | 1023 | 0.80 | 1096 | 0.95 |

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|------|------|------|------|--------------------|------|------|------|------|
| | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | High Static Option with Field Supplied Drive ² | | | | | High Static Option | | | | |
| 900 | 1019 | 0.64 | 1084 | 0.76 | 1146 | 0.89 | 1203 | 1.02 | 1258 | 1.16 |
| 975 | 1036 | 0.69 | 1101 | 0.81 | 1162 | 0.94 | 1219 | 1.08 | 1274 | 1.22 |
| 1050 | 1053 | 0.74 | 1118 | 0.86 | 1179 | 1.00 | 1236 | 1.14 | 1290 | 1.28 |
| 1125 | 1071 | 0.79 | 1135 | 0.92 | 1196 | 1.06 | 1253 | 1.20 | 1307 | 1.35 |
| 1200 | 1089 | 0.84 | 1153 | 0.98 | 1213 | 1.12 | 1270 | 1.27 | 1324 | 1.42 |
| 1275 | 1107 | 0.90 | 1171 | 1.04 | 1231 | 1.19 | 1287 | 1.34 | 1341 | 1.50 |
| 1350 | 1126 | 0.96 | 1189 | 1.11 | 1249 | 1.26 | 1305 | 1.42 | 1358 | 1.58 |
| 1425 | 1144 | 1.03 | 1208 | 1.18 | 1267 | 1.34 | 1323 | 1.50 | 1376 | 1.66 |
| 1500 | 1163 | 1.10 | 1226 | 1.25 | 1285 | 1.41 | 1341 | 1.58 | 1394 | 1.75 |

NOTE: For more information, see General Fan Performance Notes.

1. Recommend using field-supplied blower pulley (part number KR11AG006) and belt (part number KR30AE039)
2. Recommend using field-supplied motor pulley (part number KR11HY150 - 575V) and belt (part number KR29AF035)

Table 13 – RGS036, 3 TON VERTICAL SUPPLY

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|-------------|------------------------|------|-----|------|---|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | Field-Supplied Drive ¹ | | Standard Static Option | | | | High Static Option with Field Supplied Drive ² | | | |
| 900 | 567 | 0.15 | 688 | 0.22 | 786 | 0.30 | 871 | 0.37 | 947 | 0.44 |
| 975 | 591 | 0.17 | 710 | 0.26 | 807 | 0.34 | 891 | 0.42 | 966 | 0.49 |
| 1050 | 615 | 0.20 | 732 | 0.29 | 828 | 0.38 | 911 | 0.47 | 985 | 0.55 |
| 1125 | 641 | 0.23 | 755 | 0.33 | 849 | 0.42 | 931 | 0.52 | 1005 | 0.61 |
| 1200 | 666 | 0.26 | 778 | 0.37 | 871 | 0.47 | 952 | 0.57 | 1025 | 0.67 |
| 1275 | 693 | 0.29 | 802 | 0.41 | 893 | 0.53 | 974 | 0.63 | 1046 | 0.74 |
| 1350 | 719 | 0.33 | 826 | 0.46 | 916 | 0.58 | 995 | 0.70 | 1067 | 0.81 |
| 1425 | 746 | 0.38 | 850 | 0.51 | 939 | 0.64 | 1017 | 0.76 | 1088 | 0.89 |
| 1500 | 773 | 0.42 | 875 | 0.57 | 963 | 0.70 | 1040 | 0.84 | 1110 | 0.96 |

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|------|------|------|------|--------------------|------|------|------|------|
| | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | High Static Option with Field Supplied Drive ² | | | | | High Static Option | | | | |
| 900 | 1016 | 0.51 | 1080 | 0.57 | 1139 | 0.64 | 1195 | 0.71 | 1249 | 0.77 |
| 975 | 1034 | 0.57 | 1098 | 0.64 | 1157 | 0.72 | 1213 | 0.79 | 1266 | 0.86 |
| 1050 | 1053 | 0.63 | 1116 | 0.71 | 1176 | 0.79 | 1231 | 0.87 | 1284 | 0.95 |
| 1125 | 1073 | 0.70 | 1135 | 0.79 | 1194 | 0.87 | 1250 | 0.96 | 1302 | 1.04 |
| 1200 | 1093 | 0.77 | 1155 | 0.87 | 1213 | 0.96 | 1268 | 1.05 | 1321 | 1.14 |
| 1275 | 1113 | 0.85 | 1174 | 0.95 | 1232 | 1.05 | 1287 | 1.15 | 1339 | 1.25 |
| 1350 | 1133 | 0.92 | 1194 | 1.03 | 1252 | 1.14 | 1307 | 1.25 | 1358 | 1.35 |
| 1425 | 1154 | 1.01 | 1215 | 1.12 | 1272 | 1.24 | 1326 | 1.35 | 1378 | 1.46 |
| 1500 | 1175 | 1.09 | 1235 | 1.22 | 1292 | 1.34 | 1346 | 1.46 | 1397 | 1.58 |

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

1. Recommend using field-supplied blower pulley (part number KR11AG006) and belt (part number KR30AE039)
2. Recommend using field-supplied motor pulley (part number KR11HY150 - 575V) and belt (part number KR29AF035)

FAN PERFORMANCE (CONT.)

Table 14 – RGS048, 4 TON HORIZONTAL SUPPLY

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|------|------|------|------|---|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | Standard Static Option | | | | | High Static Option with Field Supplied Drive ² | | | | |
| 1200 | 643 | 0.23 | 762 | 0.34 | 859 | 0.46 | 944 | 0.58 | 1020 | 0.71 |
| 1300 | 675 | 0.28 | 790 | 0.40 | 886 | 0.52 | 969 | 0.65 | 1044 | 0.78 |
| 1400 | 707 | 0.33 | 819 | 0.45 | 913 | 0.58 | 996 | 0.72 | 1070 | 0.86 |
| 1500 | 740 | 0.38 | 849 | 0.52 | 941 | 0.66 | 1023 | 0.80 | 1096 | 0.95 |
| 1600 | 773 | 0.45 | 879 | 0.59 | 970 | 0.73 | 1050 | 0.88 | 1123 | 1.04 |
| 1700 | 807 | 0.52 | 910 | 0.67 | 999 | 0.82 | 1078 | 0.98 | 1150 | 1.14 |
| 1800 | 841 | 0.59 | 942 | 0.75 | 1029 | 0.91 | 1106 | 1.08 | 1177 | 1.25 |
| 1900 | 875 | 0.68 | 974 | 0.85 | 1059 | 1.02 | 1135 | 1.19 | 1205 | 1.37 |
| 2000 | 910 | 0.77 | 1006 | 0.95 | 1090 | 1.13 | 1165 | 1.31 | 1234 | 1.49 |

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|------|------|------|------|--------------------|------|------|------|------|
| | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | High Static Option with Field Supplied Drive ² | | | | | High Static Option | | | | |
| 1200 | 1089 | 0.84 | 1153 | 0.98 | 1213 | 1.12 | 1270 | 1.27 | 1324 | 1.42 |
| 1300 | 1113 | 0.92 | 1177 | 1.06 | 1237 | 1.21 | 1293 | 1.36 | 1347 | 1.52 |
| 1400 | 1138 | 1.01 | 1201 | 1.15 | 1261 | 1.31 | 1317 | 1.47 | 1370 | 1.63 |
| 1500 | 1163 | 1.10 | 1226 | 1.25 | 1285 | 1.41 | 1341 | 1.58 | 1394 | 1.75 |
| 1600 | 1189 | 1.20 | 1252 | 1.36 | 1310 | 1.53 | 1365 | 1.70 | 1418 | 1.87 |
| 1700 | 1216 | 1.31 | 1277 | 1.48 | 1335 | 1.65 | 1390 | 1.83 | 1442 | 2.01 |
| 1800 | 1242 | 1.42 | 1303 | 1.60 | 1361 | 1.78 | 1415 | 1.96 | 1467 | 2.15 |
| 1900 | 1270 | 1.55 | 1330 | 1.73 | 1387 | 1.92 | 1441 | 2.11 | 1493 | 2.30 |
| 2000 | 1297 | 1.68 | 1357 | 1.87 | 1414 | 2.07 | 1467 | 2.26 | - | - |

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

1. Recommend using field-supplied blower pulley (part no. KR11AZ506), motor pulley (part no. KR11HY181) and belt (part no. KR30AE041).
2. Recommend using field-supplied motor pulley (part number KR11HY150 - 575V) and belt (part number KR29AF035).

Table 15 – RGS048, 4 TON VERTICAL SUPPLY

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|------|------|------|------|---|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | Standard Static Option | | | | | High Static Option with Field Supplied Drive ² | | | | |
| 1200 | 666 | 0.26 | 778 | 0.37 | 871 | 0.47 | 952 | 0.57 | 1025 | 0.67 |
| 1300 | 701 | 0.31 | 810 | 0.43 | 901 | 0.54 | 981 | 0.65 | 1053 | 0.76 |
| 1400 | 737 | 0.36 | 842 | 0.49 | 931 | 0.62 | 1010 | 0.74 | 1081 | 0.86 |
| 1500 | 773 | 0.42 | 875 | 0.57 | 963 | 0.70 | 1040 | 0.84 | 1110 | 0.96 |
| 1600 | 810 | 0.49 | 909 | 0.65 | 994 | 0.79 | 1070 | 0.94 | 1140 | 1.08 |
| 1700 | 847 | 0.57 | 943 | 0.73 | 1027 | 0.89 | 1101 | 1.05 | 1170 | 1.20 |
| 1800 | 885 | 0.66 | 978 | 0.83 | 1060 | 1.00 | 1133 | 1.16 | 1200 | 1.32 |
| 1900 | 923 | 0.75 | 1014 | 0.94 | 1093 | 1.11 | 1165 | 1.29 | 1231 | 1.46 |
| 2000 | 962 | 0.85 | 1049 | 1.05 | 1127 | 1.24 | 1198 | 1.42 | 1263 | 1.61 |

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|------|------|------|------|--------------------|------|------|------|------|
| | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | High Static Option with Field Supplied Drive ² | | | | | High Static Option | | | | |
| 1200 | 1093 | 0.77 | 1155 | 0.87 | 1213 | 0.96 | 1268 | 1.05 | 1321 | 1.14 |
| 1300 | 1119 | 0.87 | 1181 | 0.98 | 1239 | 1.08 | 1294 | 1.18 | 1346 | 1.28 |
| 1400 | 1147 | 0.98 | 1208 | 1.09 | 1265 | 1.21 | 1320 | 1.32 | 1371 | 1.43 |
| 1500 | 1175 | 1.09 | 1235 | 1.22 | 1292 | 1.34 | 1346 | 1.46 | 1397 | 1.58 |
| 1600 | 1204 | 1.21 | 1263 | 1.35 | 1320 | 1.48 | 1373 | 1.61 | 1424 | 1.74 |
| 1700 | 1233 | 1.34 | 1292 | 1.49 | 1348 | 1.63 | 1401 | 1.77 | 1451 | 1.91 |
| 1800 | 1262 | 1.48 | 1321 | 1.64 | 1376 | 1.79 | 1428 | 1.94 | 1479 | 2.09 |
| 1900 | 1293 | 1.63 | 1350 | 1.79 | 1405 | 1.96 | 1457 | 2.12 | 1506 | 2.28 |
| 2000 | 1323 | 1.79 | 1380 | 1.96 | 1434 | 2.13 | 1486 | 2.31 | - | - |

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

1. Recommend using field-supplied blower pulley (part no. KR11AZ506), motor pulley (part no. KR11HY181) and belt (part no. KR30AE041).
2. Recommend using field-supplied motor pulley (part number KR11HY150 - 575V) and belt (part number KR29AF035).

FAN PERFORMANCE (CONT.)

Table 16 – RGS060, 5 TON HORIZONTAL SUPPLY

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|---|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | Standard Static Option | | | | | | | | High Static Option with Field Supplied Drive ¹ | |
| 1500 | 800 | 0.39 | 904 | 0.49 | 999 | 0.60 | 1087 | 0.72 | 1169 | 0.85 |
| 1625 | 849 | 0.48 | 947 | 0.59 | 1038 | 0.70 | 1122 | 0.83 | 1201 | 0.96 |
| 1750 | 899 | 0.59 | 992 | 0.70 | 1078 | 0.82 | 1159 | 0.95 | 1235 | 1.08 |
| 1875 | 950 | 0.70 | 1038 | 0.82 | 1120 | 0.95 | 1198 | 1.08 | 1271 | 1.22 |
| 2000 | 1001 | 0.84 | 1085 | 0.96 | 1163 | 1.09 | 1238 | 1.23 | 1309 | 1.38 |
| 2125 | 1053 | 0.99 | 1133 | 1.12 | 1208 | 1.26 | 1280 | 1.40 | 1348 | 1.55 |
| 2250 | 1106 | 1.16 | 1182 | 1.29 | 1254 | 1.44 | 1323 | 1.59 | 1389 | 1.74 |
| 2375 | 1159 | 1.34 | 1231 | 1.49 | 1300 | 1.64 | 1367 | 1.80 | 1430 | 1.96 |
| 2500 | 1212 | 1.55 | 1281 | 1.70 | 1348 | 1.86 | 1412 | 2.02 | 1473 | 2.19 |

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|--------------------|-------------|
| | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | High Static Option with Field Supplied Drive ¹ | | | | | | | | High Static Option | |
| 1500 | 1247 | 0.98 | 1320 | 1.13 | 1390 | 1.28 | 1457 | 1.44 | 1522 | 1.61 |
| 1625 | 1276 | 1.10 | 1348 | 1.24 | 1416 | 1.40 | 1481 | 1.56 | 1544 | 1.73 |
| 1750 | 1308 | 1.22 | 1377 | 1.38 | 1444 | 1.53 | 1507 | 1.70 | 1569 | 1.87 |
| 1875 | 1342 | 1.37 | 1409 | 1.52 | 1473 | 1.69 | 1536 | 1.86 | 1596 | 2.03 |
| 2000 | 1377 | 1.53 | 1442 | 1.69 | 1505 | 1.86 | 1565 | 2.03 | 1624 | 2.21 |
| 2125 | 1414 | 1.71 | 1477 | 1.87 | 1538 | 2.04 | 1597 | 2.22 | 1654 | 2.40 |
| 2250 | 1452 | 1.91 | 1514 | 2.08 | 1573 | 2.25 | 1630 | 2.43 | 1686 | 2.62 |
| 2375 | 1492 | 2.12 | 1551 | 2.30 | 1609 | 2.48 | 1665 | 2.66 | 1719 | 2.85 |
| 2500 | 1533 | 2.36 | 1591 | 2.54 | 1647 | 2.73 | - | - | - | - |

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

1. Recommend using field-supplied motor pulley (part number KR11HY161) blower pulley (part no. KR11AZ406), and belt (part number KR29AF038)

Table 17 – RGS060, 5 TON VERTICAL SUPPLY

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|------|------|------|------|------|---|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | Standard Static Option | | | | | | High Static Option with Field Supplied Drive ¹ | | | |
| 1500 | 848 | 0.42 | 968 | 0.55 | 1069 | 0.68 | 1158 | 0.80 | 1238 | 0.94 |
| 1625 | 897 | 0.51 | 1013 | 0.65 | 1111 | 0.79 | 1198 | 0.93 | 1277 | 1.07 |
| 1750 | 947 | 0.61 | 1059 | 0.76 | 1155 | 0.91 | 1240 | 1.06 | 1318 | 1.21 |
| 1875 | 997 | 0.72 | 1105 | 0.89 | 1199 | 1.05 | 1283 | 1.21 | 1359 | 1.37 |
| 2000 | 1048 | 0.85 | 1153 | 1.03 | 1244 | 1.20 | 1326 | 1.37 | 1401 | 1.54 |
| 2125 | 1100 | 1.00 | 1201 | 1.19 | 1290 | 1.37 | 1370 | 1.55 | 1444 | 1.73 |
| 2250 | 1152 | 1.16 | 1250 | 1.36 | 1336 | 1.55 | 1415 | 1.75 | 1487 | 1.94 |
| 2375 | 1205 | 1.34 | 1299 | 1.55 | 1384 | 1.76 | 1460 | 1.96 | 1532 | 2.17 |
| 2500 | 1258 | 1.54 | 1349 | 1.76 | 1431 | 1.98 | 1506 | 2.20 | 1576 | 2.41 |

| CFM | AVAILABLE EXTERNAL STATIC PRESSURE (in. wg) | | | | | | | | | |
|------|---|------|-------------|-------------|-------------|-------------|--------------------|-------------|-------------|-------------|
| | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| | High Static Option with Field Supplied Drive ¹ | | | | | | High Static Option | | | |
| 1500 | 1312 | 1.07 | 1380 | 1.20 | 1445 | 1.34 | 1506 | 1.48 | 1564 | 1.62 |
| 1625 | 1350 | 1.21 | 1418 | 1.35 | 1482 | 1.50 | 1542 | 1.64 | 1600 | 1.79 |
| 1750 | 1390 | 1.36 | 1457 | 1.51 | 1520 | 1.67 | 1580 | 1.83 | 1637 | 1.98 |
| 1875 | 1430 | 1.53 | 1496 | 1.69 | 1559 | 1.86 | 1618 | 2.02 | 1675 | 2.19 |
| 2000 | 1471 | 1.72 | 1536 | 1.89 | 1598 | 2.06 | 1657 | 2.24 | 1713 | 2.41 |
| 2125 | 1513 | 1.92 | 1577 | 2.10 | 1638 | 2.28 | 1696 | 2.47 | 1752 | 2.65 |
| 2250 | 1555 | 2.13 | 1619 | 2.33 | 1679 | 2.52 | 1736 | 2.72 | - | - |
| 2375 | 1598 | 2.37 | 1661 | 2.57 | 1720 | 2.78 | - | - | - | - |
| 2500 | 1642 | 2.63 | 1704 | 2.84 | - | - | - | - | - | - |

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

1. Recommend using field-supplied motor pulley (part number KR11HY161) blower pulley (part no. KR11AZ406), and belt (part number KR29AF038)

FAN PERFORMANCE (CONT.)

Table 18 – PULLEY ADJUSTMENT

| UNIT | | MOTOR/DRIVE COMBO | MOTOR PULLEY TURNS OPEN | | | | | | | | | | |
|--------|---------|-------------------|-------------------------|------|------|------|------|------|------|------|------|------|------|
| | | | 0.0 | 0.5 | 1.0 | 1.5 | 2.0 | 2.5 | 3.0 | 3.5 | 4.0 | 4.5 | 5.0 |
| RGS036 | 3 phase | Standard Static | 854 | 825 | 795 | 766 | 736 | 707 | 678 | 648 | 619 | 589 | 560 |
| | | High Static | 1466 | 1423 | 1380 | 1337 | 1294 | 1251 | 1207 | 1164 | 1121 | 1078 | 1035 |
| RGS048 | 3 phase | Standard Static | 854 | 825 | 795 | 766 | 736 | 707 | 678 | 648 | 619 | 589 | 560 |
| | | High Static | 1466 | 1423 | 1380 | 1337 | 1294 | 1251 | 1207 | 1164 | 1121 | 1078 | 1035 |
| RGS060 | 3 phase | Standard Static | 1175 | 1135 | 1094 | 1054 | 1013 | 973 | 932 | 892 | 851 | 811 | 770 |
| | | High Static | 1687 | 1649 | 1610 | 1572 | 1533 | 1495 | 1457 | 1418 | 1380 | 1341 | 1303 |

NOTE: Do not adjust pulley further than 5 turns open.

■ – Factory settings

Table 19 – R-410A Rooftop Indoor Fan System Standard, Optional High Static and Field Installed Medium Static Drive Options

| UNIT MODEL NUMBER | RGS036S | RGS048S | RGS060S |
|--|-------------------|-----------|-----------|
| UNIT TONNAGE | 3 | 4 | 5 |
| INDOOR FAN (Standard static) | | | |
| ID Fan Motor (Standard Static) | Voltage-Ph | | |
| Indoor Motor Part No. | 575-3 | HC52EE575 | HC52EE575 |
| Indoor Motor Max Continuous BHP | 575-3 | 1 | 1 |
| ID Fan Wheel, Shaft, Bearings, Drive (Belt Drive Standard Static) | | | |
| Motor Pulley Part No. | 575-3 | KR11HY150 | KR11HY150 |
| Motor Pulley Pitch Diameter A min (in.) | 575-3 | 1.9 | 1.9 |
| Motor Pulley Pitch Diameter A max (in.) | 575-3 | 2.9 | 2.9 |
| ID Fan Motor (Medium Static) ** | | | |
| Indoor Motor Part No. | 575-3 | HC52EE575 | HC52EE575 |
| Indoor Motor Capacitor | 575-3 | HC91CL015 | HC91CL015 |
| Indoor Motor Max Continuous BHP | 575-3 | 1 | 1 |
| ID Fan Wheel, Shaft, Bearings, Drive (Medium Static) | | | |
| Motor Pulley Part No. | 575-3 | KR11HY150 | KR11HY150 |
| Motor Pulley Pitch Diameter A min (in) | 575-3 | 1.9 | 1.9 |
| Motor Pulley Pitch Diameter A max (in) | 575-3 | 2.9 | 2.9 |
| ** Medium static motor and drives available from FAST parts | | | |
| ID Fan Motor (High Static) | | | |
| Indoor Motor Part No. | 575-3 | HD56FE575 | HD56FE575 |
| Indoor Motor Max Continuous BHP | 575-3 | 2.4 | 2.4 |
| ID Fan Wheel, Shaft, Bearings, Drive (High Static) | | | |
| Motor Pulley Part No. | Same all voltages | KR11HY161 | KR11HY161 |
| Motor Pulley Type | | Variable | Variable |
| Motor Pulley Pitch Diameter A min (in.) | | 2.4 | 2.4 |
| Motor Pulley Pitch Diameter A max (in.) | | 3.4 | 3.4 |
| Blower Pulley Part No. | | KR11AZ406 | KR11AZ406 |
| Blower Pulley Type | | Fixed | Fixed |
| Blower Pulley Pitch Diameter A (in.) | | 4 | 4 |
| Belt Part No. | | KR29AF038 | KR29AF038 |

ECONOMIZER, BAROMETRIC RELIEF, AND PERFORMANCE

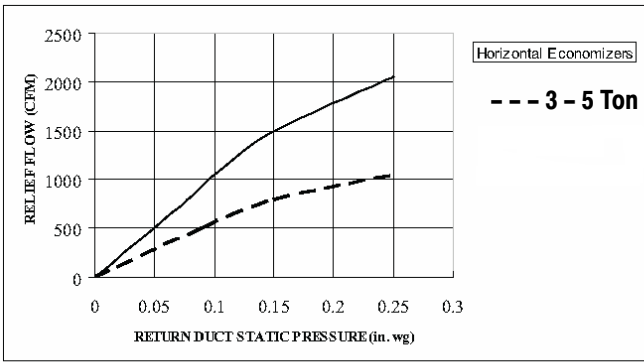


Fig 1 – Barometric Relief Flow Capacity

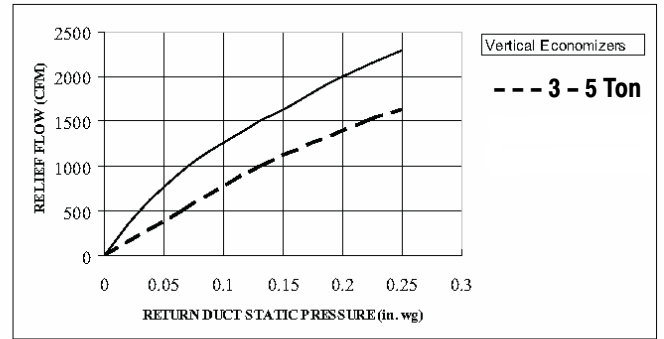


Fig 5 – Barometric Relief Flow Capacity

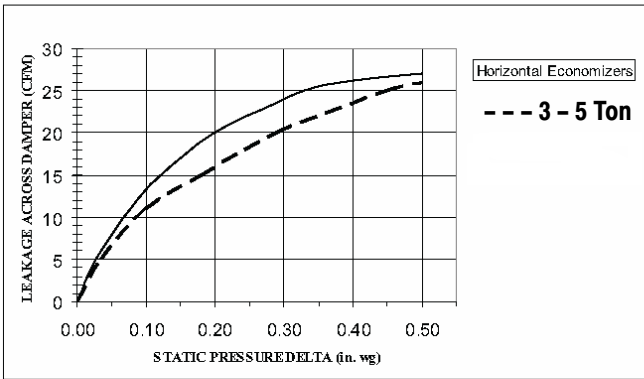


Fig 2 – Outdoor Air Damper Leakage

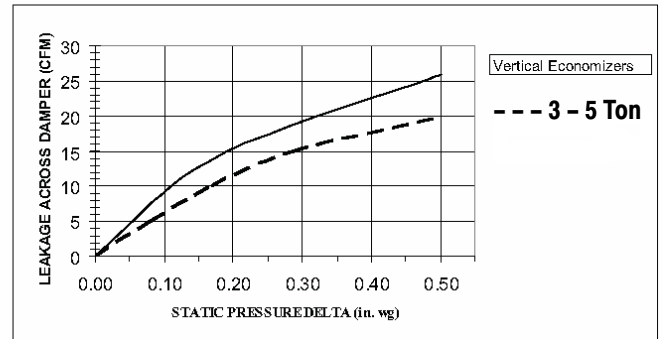


Fig 6 – Outdoor Air Damper Leakage

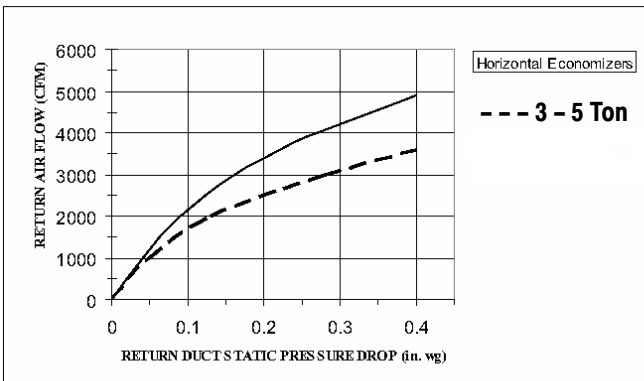


Fig 3 – Return Air Pressure Drop

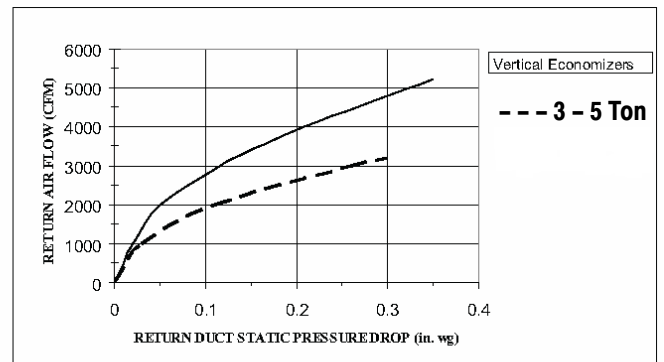


Fig 7 – Return Air Pressure Drop

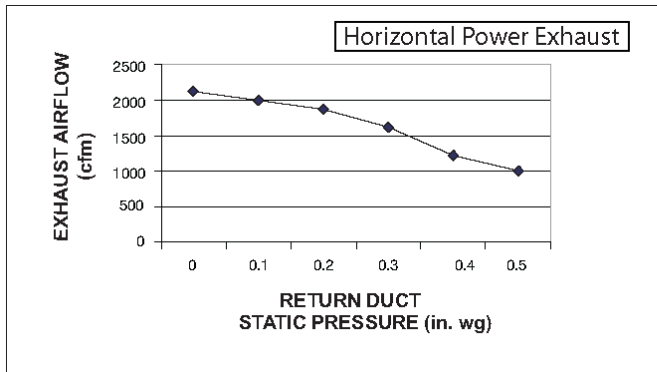


Fig 4 – Horizontal Power Exhaust Performance

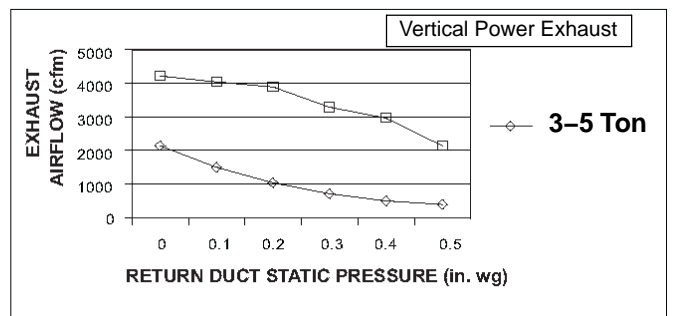


Fig 8 – Vertical Power Exhaust Performance

ELECTRICAL INFORMATION

Table 20 – RGS036, 3 TONS

| V-Ph-Hz | VOLTAGE RANGE | | COMP (ea) | | OFM (ea) | | IFM | | | | |
|----------|---------------|-----|-----------|-----|----------|-----|---------------------------|--------------|--------------|------------------|------------|
| | MIN | MAX | RLA | LRA | WATTS | FLA | TYPE | Max WATTS | Max AMP Draw | EFF at Full Load | FLA |
| 575-3-60 | 518 | 633 | 3.8 | 37 | 325 | 0.6 | Std Static High Static | 1000 2120 | 2.0 2.1 | 71% 80% | 1.9 2.0 |

Table 21 – RGS048, 4 TONS

| V-Ph-Hz | VOLTAGE RANGE | | COMP (ea) | | OFM (ea) | | IFM | | | | |
|----------|---------------|-----|-----------|-----|----------|-----|---------------------------|--------------|--------------|------------------|------------|
| | MIN | MAX | RLA | LRA | WATTS | FLA | TYPE | Max WATTS | Max AMP Draw | EFF at Full Load | FLA |
| 575-3-60 | 518 | 633 | 4.8 | 37 | 325 | 0.6 | Std Static High Static | 1000 2120 | 2.0 2.1 | 71% 80% | 1.9 2.0 |

Table 22 – RGS060, 5 TONS

| V-Ph-Hz | VOLTAGE RANGE | | COMP (ea) | | OFM (ea) | | IFM | | | | |
|----------|---------------|-----|-----------|-----|----------|-----|---------------------------|--------------|--------------|------------------|------------|
| | MIN | MAX | RLA | LRA | WATTS | FLA | TYPE | Max WATTS | Max AMP Draw | EFF at Full Load | FLA |
| 575-3-60 | 518 | 633 | 5.8 | 39 | 325 | 0.6 | Std Static High Static | 1000 3775 | 2.0 2.9 | 71% 81% | 1.9 2.8 |

Table 23 – MCA/MOCP DETERMINATION NO C.O. OR UNPWRD C.O.

| Unit | NOM. V-Ph-Hz | IFM TYPE | Combustion Fan Motor FLA | Power Exhaust FLA | NO C.O. or UNPWRD C.O. | | | | | | | |
|--------|--------------|----------|--------------------------|-------------------|------------------------|------|------------|-----|-------------------------|------|------------|-----|
| | | | | | NO P.E. | | | | w/ P.E. (pwrd fr/ unit) | | | |
| | | | | | MCA | MOCP | DISC. SIZE | | MCA | MOCP | DISC. SIZE | |
| | | | | | | | FLA | LRA | | | FLA | LRA |
| RGS036 | 575-3-60 | STD | 0.24 | 1.9 | 7.3 | 15.0 | 7 | 44 | 9.2 | 15.0 | 9 | 46 |
| | | MED* | | | 7.3 | 15.0 | 7 | 44 | 9.2 | 15.0 | 9 | 46 |
| | | HIGH | | | 7.4 | 15.0 | 7 | 50 | 9.3 | 15.0 | 10 | 52 |
| RGS048 | 575-3-60 | STD | 0.24 | 1.9 | 8.5 | 15.0 | 8 | 44 | 10.4 | 15.0 | 11 | 46 |
| | | MED* | | | 8.5 | 15.0 | 8 | 44 | 10.4 | 15.0 | 11 | 46 |
| | | HIGH | | | 8.6 | 15.0 | 9 | 50 | 10.5 | 15.0 | 11 | 52 |
| RGS060 | 575-3-60 | STD | 0.24 | 1.9 | 9.8 | 15.0 | 10 | 46 | 11.7 | 15.0 | 12 | 48 |
| | | MED* | | | 9.9 | 15.0 | 10 | 52 | 11.8 | 15.0 | 13 | 54 |
| | | HIGH | | | 10.7 | 15.0 | 11 | 63 | 12.6 | 15.0 | 13 | 65 |

*Available from Fast Parts

LEGEND:

- CO – Convenient outlet
- DISC – Disconnect
- FLA – Full load amps
- IFM – Indoor fan motor
- LRA – Locked rotor amps
- MCA – Minimum circuit amps
- MOCP – Maximum over current protection
- PE – Power exhaust
- UNPWRD CO – Unpowered convenient outlet



Example: Supply voltage is 230-3-60



AB = 224 v
BC = 231 v
AC = 226 v

$$\text{Average Voltage} = \frac{(224 + 231 + 226)}{3} = \frac{681}{3} = 227$$

Determine maximum deviation from average voltage.

(AB) 227 – 224 = 3 v

(BC) 231 – 227 = 4 v

(AC) 227 – 226 = 1 v

Maximum deviation is 4 v.

Determine percent of voltage imbalance.

$$\% \text{ Voltage Imbalance} = 100 \times \frac{4}{227} = 1.76\%$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

NOTES:

1. In compliance with NEC requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker. Canadian units may be fuse or circuit breaker.

2. Unbalanced 3-Phase Supply Voltage

Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance.

$$\% \text{ Voltage Imbalance} = 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

SEQUENCE OF OPERATION

General

The sequence below describes the sequence of operation for an electro-mechanical unit with and without a factory installed economizer. For information regarding a direct digital controller, see the start-up, operations, and troubleshooting manual for the applicable controller.

Units with no Economizer

Cooling —

When the thermostat calls for cooling, terminals G and Y1 are energized. As a result, the indoor-fan contactor (IFC) and the compressor contactor (C1) are energized, causing the indoor-an motor (IFM), compressor #1, and outdoor fan to start. If the unit has 2 stages of cooling, the thermostat will additionally energize Y2. The Y2 signal will energize compressor contactor #2 (C2), causing compressor #2 to start. Regardless of the number of stages, the outdoor-fan motor runs continuously while unit is cooling.

Heating

NOTE: RGS units have either one or two stages of gas heat.

When the thermostat calls for heating, power is sent to W on the Integrated Gas Controller (IGC) board. An LED (light-emitting diode) on the IGC board turns on and remains on during normal operation. A check is made to ensure that the rollout switch and limit switch are closed and the induced-draft motor is running. If the check was successful, the induced-draft motor is energized, and when its speed is satisfactory, as proven by the "hall effect" sensor, the ignition activation period begins. The burners will ignite within 5 seconds. If the burners do not light, there is a 22-second delay before another 5-second attempt. This sequence is repeated for 15 minutes or until the burners light. If, after the 15 minutes, the burners still have not lit, heating is locked out. To reset the control, break 24-v power to the thermostat.

When ignition occurs, the IGC board will continue to monitor the condition of the rollout switch, the limit switches, the "hall effect" sensor, as well as the flame sensor. 45 seconds after ignition occurs, assuming the unit is controlled through a room thermostat set for fan auto, the indoor-fan motor will energize (and the outdoor-air dampers will open to their minimum position). If, for some reason, the over-temperature limit opens prior to the start of the indoor fan blower, the unit will shorten the 45-second delay to 5 seconds less than the time from initiation of heat to when the limit tripped. Gas will not be interrupted to the burners and heating will continue. Once the fan-on delay has been modified, it will not change back to 45 seconds until power is reset to the control.

On units with 2 stages of heat, when additional heat is required, W2 closes and initiates power to the second stage of the main gas valve. When the thermostat is satisfied, W1 and W2 open and the gas valve closes, interrupting the flow of gas to the main burners.

If the call for W1 lasted less than 1 minute, the heating cycle will not terminate until 1 minute after W1 became active. If the unit is controlled through a room thermostat set for fan auto, the indoor-fan motor will continue to operate for an additional 45 seconds then stop. If the over-temperature limit opens after the indoor motor is stopped, but within 10 minutes of W1 becoming inactive, on the next cycle the time will be extended by 15 seconds. The maximum delay is 3 minutes. Once modified, the fan off delay will not change back to 45 seconds unless power is reset to the control. A LED indicator is provided on the IGC to monitor operation.

Units with an Economizer

Cooling —

When free cooling is not available, the compressors will be controlled by the zone thermostat. When free cooling is available, the outdoor-air damper is modulated by the economizer control to provide a 50°F (10°C) to 55°F (13°C) mixed-air temperature into the zone. As the mixed air temperature fluctuates above 55°F (13°C) or below 50°F (10°C) dampers will be modulated (open or close) to bring the mixed-air temperature back within control. If mechanical cooling is utilized with free cooling, the outdoor-air damper will maintain its current position at the time the compressor is started. If the increase in cooling capacity causes the mixed-air temperature to drop below 45°F (7°C), then the outdoor-air damper position will be decreased to the minimum position. If the mixed-air temperature continues to fall, the outdoor-air damper will close. Control returns to normal once the mixed-air temperature rises above 48°F (9°C). The power exhaust fans will be energized and de-energized, if installed, as the outdoor-air damper opens and closes.

If field-installed accessory CO2 sensors are connected to the economizer control, a demand controlled ventilation strategy will begin to operate. As the CO2 level in the zone increases above the CO2 set point, the minimum position of the damper will be increased proportionally. As the CO2 level decreases because of the increase in fresh air, the outdoor-air damper will be proportionally closed. For economizer operation, there must be a thermostat call for the fan (G). If the unit is occupied and the fan is on, the damper will operate at minimum position. Otherwise, the damper will be closed.

When the economizer control is in the occupied mode and a call for cooling exists (Y1 on the thermostat), the control will first check for indoor fan operation. If the fan is not on, then cooling will not be activated. If the fan is on, then the control will open the economizer damper to the minimum position.

On the initial power to the economizer control, it will take the damper up to 2 1/2 minutes before it begins to position itself. After the initial power-up, further changes in damper position can take up to 30 seconds to initiate. Damper movement from full closed to full open (or vice versa) will take between 1 1/2 and 2 1/2 minutes. If free cooling can be used as determined from the appropriate changeover command (switch, dry bulb, enthalpy curve, differential dry bulb, or differential enthalpy), then the control will modulate the dampers open to maintain the mixed-air temperature set point at 50°F (10°C) to 55°F (13°C). If there is a further demand for cooling (cooling second stage – Y2 is energized), then the control will bring on compressor stage 1 to maintain the mixed-air temperature set point. The economizer damper will be open at maximum position. economizer operation is limited to a single compressor.

Heating

The sequence of operation for the heating is the same as an unit with no economizer. The only difference is how the economizer acts. The economizer will stay at the Economizer Minimum Position while the evaporator fan is operating. The outdoor-air damper is closed when the indoor fan is not operating.

GUIDE SPECIFICATIONS – RGS036–060

HVAC GUIDE SPECIFICATIONS

Size Range: 3 to 5 Nominal Tons



As an Energy Star® Partner, International Comfort Products has determined that this product meets the ENERGY STAR® guidelines for energy efficiency.

Section Description

23 06 80 Schedules for Decentralized HVAC Equipment

23 06 80.13 Decentralized Unitary HVAC Equipment Schedule

23 06 80.13.A. Rooftop unit schedule

1. Schedule is per the project specification requirements.

23 07 16 HVAC Equipment Insulation

23 07 16.13 Decentralized, Rooftop Units:

23 07 16.13.A. Evaporator fan compartment:

1. Interior cabinet surfaces shall be insulated with a minimum 1/2-in. thick, minimum 1 1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 07 16.13.B. Gas heat compartment:

1. Aluminum foil-faced fiberglass insulation shall be used.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 09 13 Instrumentation and Control Devices for HVAC

23 09 13.23 Sensors and Transmitters

23 09 13.23.A, Thermostats

1. Thermostat must
 - a. energize both "W" and "G" when calling for heat.
 - b. have capability to energize 2 different stages of cooling, and two different stages of heating.
 - c. must include capability for occupancy scheduling.

23 09 33 Electric and Electronic Control System for HVAC

23 09 33.13 Decentralized, Rooftop Units:

23 09 33.13.A. General:

1. Shall be complete with self-contained low-voltage control circuit protected by a fuse on the 24-v transformer side (036–060 units have a resettable circuit breaker).
2. Shall utilize color-coded wiring.
3. Unit shall include self-contained low-voltage control circuit protected by a fuse on the 24-v transformer side with a resettable circuit breaker.
4. The heat exchanger shall be controlled by an integrated gas controller (IGC) microprocessor. See heat exchanger section of this specification.
5. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.

23 09 33.23.B, Safeties:

1. Compressor over-temperature, over current.
2. Low-pressure switch.
 - a. Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service person to correctly wire and or troubleshoot the rooftop unit.
3. High-pressure switch.
 - a. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service person to correctly wire and or troubleshoot the rooftop unit.

4. Automatic reset, motor thermal overload protector.
5. Heating section shall be provided with the following minimum protections:
 - a. High-temperature limit switches.
 - b. Induced draft motor speed sensor.
 - c. Flame rollout switch.
 - d. Flame proving controls.

23 09 93 Sequence of Operations for HVAC Controls

23 09 93.13 Decentralized, Rooftop Units:

23 09 93.13 INSERT SEQUENCE OF OPERATION

23 40 13 Panel Air Filters

23 40 13.13 Decentralized, Rooftop Units:

23 40 13.13.A. Standard filter section shall

1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
2. Unit shall use only one filter size. Multiple sizes are not acceptable.
3. Filter face velocity shall not exceed 365 fpm at nominal airflows.
4. Filters shall be accessible through an access panel with "no-tool" removal as described in the unit cabinet section of this specification (23 81 19.13.H).

23 81 19 Self-Contained Air Conditioners

23 81 19.13 Small-Capacity Self-Contained Air Conditioners (RGS036-060)

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a(n) hermetic scroll compressor(s) for cooling duty and gas combustion for heating duty.
2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
3. Unit shall use environmentally safe, R-410A refrigerant.
4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1-2004 minimum efficiency requirements.
2. 3 phase units are Energy Star qualified.
3. Unit shall be rated in accordance with ARI Standards 210 and 360.
4. Unit shall be designed to conform to ASHRAE 15, 2001.
5. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
6. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
7. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).
8. Unit casing shall be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 5000-hour salt spray.
9. Unit shall be designed in accordance with ISO 9001:2000, and shall be manufactured in a facility registered by ISO 9001:2000.
10. Roof curb shall be designed to conform to NRCA Standards.
11. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
12. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
13. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
14. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.

23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer's recommendations.
2. Lifted by crane requires either shipping top panel or spreader bars.
3. Unit shall only be stored or positioned in the upright position.

23 81 19.13.E. Project Conditions

1. As specified in the contract.

23 81 19.13.F. Operating Characteristics

1. Unit shall be capable of starting and running at 115°F (46°C) ambient outdoor temperature, meeting maximum load criteria of ARI Standard 210/240 or 360 at ± 10% voltage.
2. Compressor with standard controls shall be capable of operation down to 40°F (4°C), ambient outdoor temperatures. Accessory winter start kit is necessary if mechanically cooling at ambient temperatures below 40°F (4°C) to 20°F (-7°C) below 20°F (-7°C) an accessory Motormaster low ambient control is required and the outdoor fan motor needs to be changed to a ball-bearing speed control motor design..
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured for vertical supply & return configurations.
5. Unit shall be field convertible from vertical to horizontal configuration
6. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.

23 81 19.13.G. Electrical Requirements

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

23 81 19.13.H. Unit Cabinet

1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a pre-painted baked enamel finish on all externally exposed surfaces.
2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches (.076mm) minimum, gloss (per ASTM D523, 60°F (16°C): 60, Hardness: H-2H Pencil hardness.
3. Evaporator fan compartment interior cabinet insulation shall conform to ARI Standards 210 or 360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2-in. thick, 1 lb density, flexible fiberglass insulation, neoprene coated on the air side. Aluminum foil-faced fiberglass insulation shall be used in the gas heat compartment.
4. Base of unit shall have a minimum of four locations for thru-the-base gas and electrical connections (factory installed or field installed), standard.
5. Base Rail
 - a. Unit shall have base rails on a minimum of 2 sides.
 - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
 - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
 - d. Base rail shall be a minimum of 16 gauge thickness.
6. Condensate pan and connections:
 - a. Shall be a sloped condensate drain pan made of a non-corrosive material.
 - b. Shall comply with ASHRAE Standard 62.
 - c. Shall use a 3/4" -14 NPT drain connection, possible either through the bottom or end of the drain pan. Connection shall be made per manufacturer's recommendations.
7. Top panel:
 - a. Shall be a single piece top panel on 036 to 060 models.
8. Gas Connections:
 - a. All gas piping connecting to unit gas valve shall enter the unit cabinet at a single location on side of unit (horizontal plane).
 - b. Thru-the-base capability
 - i. Standard unit shall have a thru-the-base gas-line location using a raised, embossed portion of the unit basepan.
 - ii. Optional, factory-approved, water-tight connection method must be used for thru-the-base gas connections.
 - iii. No basepan penetration, other than those authorized by the manufacturer, is permitted.
9. Electrical Connections
 - a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, knockout location.
 - b. Thru-the-base capability
 - i. Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
 - ii. Optional, factory-approved, water-tight connection method must be used for thru-the-base electrical connections.
 - iii. No basepan penetration, other than those authorized by the manufacturer, is permitted.

10. Component access panels (standard)

- a. Cabinet panels shall be easily removable for servicing.
- b. Unit shall have one factory installed, tool-less, removable, filter access panel.
- c. Panels covering control box, indoor fan, indoor fan motor, gas components (where applicable), and compressors shall have a molded composite handles.
- d. Handles shall be UV modified, composite. They shall be permanently attached, and recessed into the panel.
- e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
- f. Collars shall be removable and easily replaceable using manufacturer recommended parts.

23 81 19.13.I. Gas Heat

1. General

- a. Heat exchanger shall be an induced draft design. Positive pressure heat exchanger designs shall not be allowed.
- b. Shall incorporate a direct-spark ignition system and redundant main gas valve.
- c. Heat exchanger design shall allow combustion process condensate to gravity drain; maintenance to drain the gas heat exchanger shall not be required.
- d. Gas supply pressure at the inlet to the rooftop unit gas valve must match that required by the manufacturer.

2. The heat exchanger shall be controlled by an integrated gas controller (IGC) microprocessor.

- a. IGC board shall notify users of fault using an LED (light-emitting diode).
- b. The Light Emitting Diode (LED) shall be visible without removing the control box access panel.
- c. IGC board shall contain algorithms that modify evaporator-fan operation to prevent future cycling on high temperature limit switch.
- d. Unit shall be equipped with anti-cycle protection with one short cycle on unit flame rollout switch or 4 continuous short cycles on the high temperature limit switch. Fault indication shall be made using an LED.

3. Standard Heat Exchanger construction

- a. Heat exchanger shall be of the tubular-section type constructed of a minimum of 20-gauge steel coated with a nominal 1.2 mil aluminum-silicone alloy for corrosion resistance.
- b. Burners shall be of the in-shot type constructed of aluminum-coated steel.
- c. Burners shall incorporate orifices for rated heat output up to 2000 ft (610m) elevation. Additional accessory kits may be required for applications above 2000 ft (610m) elevation, depending on local gas supply conditions.
- d. Each heat exchanger tube shall contain multiple dimples for increased heating effectiveness.

23 81 19.13.J. Coils

1. Standard Aluminum/Copper Coils: (036 -060 single compressor/single stage cooling models only)

- a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
- b. Evaporator and condenser coils shall be leak tested to 150 psig, pressure tested to 400 psig, and qualified to UL 1995 burst test at 2,200 psi.

23 81 19.13.K. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:

- a. Fixed orifice metering system shall prevent mal-distribution of two-phase refrigerant by including multiple fixed orifice devices in each refrigeration circuit. Each orifice is to be optimized to the coil circuit it serves.
- b. Refrigerant filter drier.
- c. Service gauge connections on suction and discharge lines.
- d. Pressure gauge access through a specially designed access port in the top panel of the unit.

2. There shall be gauge line access port in the skin of the rooftop, covered by a black, removable plug (036 to 060 models only).

- a. The plug shall be easy to remove and replace.
- b. When the plug is removed, the gauge access port shall enable maintenance personnel to route their pressure gauge lines.
- c. This gauge access port shall facilitate correct and accurate condenser pressure readings by enabling the reading with the compressor access panel on.
- d. The plug shall be made of a leak proof, UV-resistant, composite material.

3. Compressors

- a. Unit shall use one fully hermetic, scroll compressor for each independent refrigeration circuit.
- b. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
- c. Compressors shall be internally protected from high discharge temperature conditions.
- d. Compressors shall be protected from an over-temperature and over-ampere conditions by an internal, motor overload device.
- e. Compressor shall be factory mounted on rubber grommets.
- f. Compressor motors shall have internal line break thermal and current overload protection.
- g. Crankcase heaters shall not be required for normal operating range.

23 81 19.13.L. Filter Section

- 1. Filters access is specified in the unit cabinet section of this specification.
- 2. Filters shall be held in place by a pivoting filter tray, facilitating easy removal and installation.
- 3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
- 4. Filter face velocity shall not exceed 320 fpm at nominal airflows.
- 5. Filters shall be standard, commercially available sizes.
- 6. Only one size filter per unit is allowed.

23 81 19.13.M. Evaporator Fan and Motor

- 1. Evaporator fan motor:
 - a. Shall have permanently lubricated bearings
 - b. Shall have inherent automatic-reset thermal overload protection.
 - c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
- 2. Belt-driven Evaporator Fan:
 - a. Belt drive shall include an adjustable-pitch motor pulley.
 - b. Shall use sealed, permanently lubricated ball-bearing type.
 - c. Blower fan shall be double-inlet type with forward-curved blades.
 - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

23 81 19.13.N. Condenser Fans and Motors

- 1. Condenser fan motors:
 - a. Shall be a totally enclosed motor.
 - b. Shall use permanently lubricated bearings.
 - c. Shall have inherent thermal overload protection with an automatic reset feature.
 - d. Shall use a shaft-down design on 036-060 models.
- 2. Condenser Fans shall:
 - a. Shall be a direct-driven propeller type fan
 - b. Shall have aluminum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

1. Integrated Economizers:

- a. Integrated, gear-driven parallel modulating blade design type capable of simultaneous economizer and compressor operation.
- b. Independent modules for vertical or horizontal return configurations shall be available. Vertical return modules shall be available as a factory installed option.
- c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
- d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
- e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
- f. Shall be equipped with low-leakage dampers, not to exceed 2% leakage at 1 in. wg pressure differential.
- g. Shall be capable of introducing up to 100% outdoor air.
- h. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air.
- i. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
- j. Dry bulb outdoor-air temperature sensor shall be provided as standard. Outdoor air sensor set point shall be adjustable and shall range from 40 to 100°F / 4 to 38°C. Additional sensor options shall be available as accessories.
- k. The economizer controller shall also provide control of an accessory power exhaust unit. function. Factory set at 100%, with a range of 0% to 100%.
- l. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy. A remote potentiometer may be used to override the damper set point.
- m. Dampers shall be completely closed when the unit is in the unoccupied mode.
- n. Economizer controller shall accept a 2–10Vdc CO2 sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor-air damper to provide ventilation based on the sensor input.
- o. Compressor lockout sensor shall open at 35°F (2°C) and close closes at 50°F (10°C).
- p. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
- q. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
- r. Economizer uses a mixed air thermister (MAT) located on indoor fan housing to modulate outdoor air dampers and return air dampers to control to a 55°F (13°C) discharge air temperature

2. Two-Position Damper

- a. Damper shall be a Two-Position Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
- b. Damper shall include adjustable damper travel from 25% to 100% (full open).
- c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
- d. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
- e. Damper will admit up to 100% outdoor air for applicable rooftop units.
- f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
- g. Design shall incorporate inherent barometric relief capabilities for barometric relief of rooftop unit return air.
- h. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
- i. Outside air hood shall include aluminum water entrainment filter

3. Manual damper

- a. Manual damper field installed accessory package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 50% outdoor air for year round ventilation.

4. Head Pressure Control Package

- a. Controller shall control coil head pressure by condenser-fan speed modulation or condenser-fan cycling and wind baffles.
- b. Shall consist of solid-state control and condenser-coil temperature sensor to maintain condensing temperature between 90°F (32°C) and 110°F (43°C) at outdoor ambient temperatures down to -20°F (-29°C).

5. Liquid Propane (LP) Conversion Kit

- a. Package shall contain all the necessary hardware and instructions to convert a standard natural gas unit for use with liquefied propane, up to 2000 ft (610m) elevation.
- b. Additional accessory kits may be required for applications above 2000 ft (610m) elevation.

6. Flue Shield
 - a. Flue shield shall provide protection from the hot sides of the gas flue hood.
7. Condenser Coil Hail Guard Assembly
 - a. Shall protect against damage from hail.
 - b. Shall be either hood style or louvered.
8. Flue Discharge Deflector:
 - a. Flue discharge deflector shall direct unit exhaust vertically instead of horizontally.
 - b. Deflector shall be defined as a “natural draft” device by the National Fuel and Gas (NFG) code.
9. Thru-the-Base Connectors:
 - a. Kits shall provide connectors to permit gas and electrical connections to be brought to the unit through the unit basepan.
 - b. Minimum of four connection locations per unit.
10. Fan/Filter Status Switch:
 - a. Switch shall provide status of indoor evaporator fan (ON/OFF) or filter (CLEAN/DIRTY).
 - b. Status shall be displayed with an indicator light at the thermostat.
11. Propeller Power Exhaust:
 - a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Independent modules for vertical or horizontal return configurations shall be available.
 - c. Horizontal power exhaust is shall be mounted in return ductwork.
 - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0–100% adjustable setpoint on the economizer control.
12. Roof Curbs (Vertical):
 - a. Full perimeter roof curb with exhaust capability providing separate airstreams for energy recovery from the exhaust air without supply air contamination.
 - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
 - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
13. High-Altitude Gas Conversion Kit:
 - a. Package shall contain all the necessary hardware and instructions to convert a standard natural gas unit to operate from 2000–7000 ft (610 to 2134m) elevation with natural gas or from 0–7000 ft 90–2134m) elevation with liquefied propane.
14. High-Static Indoor Fan Motor(s) and Drive(s):
 - a. High-static motor(s) and drive(s) shall be factory-installed to provide additional performance range.
15. Condenser Coil Grille:
 - a. The grille protects the condenser coil from damage by large objects without increasing unit clearances.
16. Outdoor Air Enthalpy Sensor:
 - a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
17. Return Air Enthalpy Sensor:
 - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
18. Indoor Air Quality (CO2) Sensor:
 - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
 - b. The IAQ sensor shall be available in duct mount. The set point shall have adjustment capability.
19. Winter start kit
 - a. Shall contain a bypass device around the low pressure switch.
 - b. Shall be required when mechanical cooling below an outdoor ambient of 40°F (4°C) to 25°F (–4°C).
 - c. Shall not be required to operate an equipped economizer when below an outdoor ambient of 40°F (4°C).
20. Time Guard
 - a. Shall prevent compressor short cycling by providing a 5-minute delay (±2 minutes) before restarting a compressor after shutdown for any reason.
 - b. One device shall be required per compressor.
21. Phase Monitor Control
 - a. Field installed accessory that provides phase loss / phase reversal protection.
 - b. Mounts in unit control box and connects to unit main terminal board.