



SUBMITTAL COVER SHEET

PROJECT NAME _____

LOCATION _____

ARCHITECT _____

ENGINEER _____

CONTRACTOR _____

SUBMITTED BY _____ DATE _____

UNIT SUMMARY

Quantity						
Unit Designation						
Model No.						
Total Cooling						
Sensible Cooling						
Air Ent. Evaporator						
Air Lvg. Evaporator						
Heating Input						
Heating Output						
CFM/ESP						
EER/SEER						
Electrical						
Minimum Ampacity						
Min.-Max. Breaker						
Net Unit Weight						
Accessory						
Catalog Form Number						

ACCESSORIES:

NOTES:

SUBMITTAL SHEET FOR 13PJL SERIES 1½ TO 5 NOMINAL TON [5.28 TO 17.58 kW], 13 SEER HEAT PUMP UNITS



Featuring
New Industry Standard
R-410A Refrigerant **R-410A**

JOB NAME _____ LOCATION _____
CONTRACTOR _____ ORDER NO. _____
ENGINEER _____ UNIT MODEL NO. _____
SUBMITTED FOR ☐ APPROVAL ☐ RECORD COIL MODEL NO. _____
DATE _____ AIR HANDLER MODEL NO. _____

UNIT DATA

COOLING PERFORMANCE

EFFICIENCY SEER
TOTAL CAPACITY* MBH [kW]
SENSIBLE CAPACITY* MBH [kW]
OUTDOOR DESIGN TEMP. °F [°C] DB
TEMP. OF AIR ENTERING
EVAPORATOR COIL °F [°C] DB
..... °F [°C] WB
POWER INPUT REQUIREMENT kW
(*uses blower motor heat)

HEATING PERFORMANCE

EFFICIENCY HSPF
TOTAL CAPACITY* MBH [kW]
OUTDOOR DESIGN TEMP. °F [°C] DB
TEMP. OF AIR ENTERING
EVAPORATOR COIL °F [°C] DB

SUPPLY AIR BLOWER PERFORMANCE

TOTAL AIR SUPPLY CFM [L/s]
TOTAL RESISTANCE EXTERNAL
TO UNIT IWG
BLOWER SPEED RPM
POWER OUTPUT REQUIREMENT .. BHP
MOTOR RATING HP [W]
POWER INPUT REQUIREMENT kW

ELECTRICAL DATA

POWER SUPPLY Hz
TOTAL UNIT AMPACITY AMPS
MINIMUM WIRE SIZE AWG
MAXIMUM OVERCURRENT DEVICE
FUSES/HACR BREAKER AMPS

CLEARANCES

ACCESS SIDE 24" [609.6 mm]
AIR INLETS 12" [304.8 mm]
ABOVE UNIT 60" [1524 mm]

FEATURES FOR 13PJL SERIES HEAT PUMP UNITS 1½ TO 5 NOMINAL TON [5.28 TO 17.58 kW]

- Strong, attractive cabinet-louvered design protects the coil from damage
 - Factory installed low pressure controls.
 - Easily accessible control box
 - Grille/motor mount for quiet fan operation
 - Expansion Valves with Internal Check Valve—Provides for quieter refrigerant metering
 - Coils constructed with copper tubing and enhanced aluminum fins
 - Demand Defrost Control
 - Hot Gas Muffler
 - Service Valves
 - Non-Cycling Reversing Valve
 - Bi-Directional Filter Drier (shipped – not installed)
 - Certified and rated under ARI Standard 240
 - U.L. listed
 - Factory limited warranty on parts as follows:
Conditional Parts Warranty* Ten (10) Years
(Registration Required)
Conditional Compressor* Ten (10) Years
(Registration Required)
Limited Parts Five (5) Years
- *See Product Warranty Card for Details.



ACCESSORIES/OPTIONS

- Outdoor Thermostats (Model No. RXPT-A01, A02, A03, A04) .. ☐
High Pressure Control (Model No. RXAB-A07) ☐
Low Ambient Control (Model No. RXAD-A07) ☐
Compressor Time Delay Control (Model No. RXMD-B01) ☐
Blower Time Delay Control (Model No. RXMD-C04) ☐
Sound Enclosure* ☐
Heat Pump Monitor (Model No. RXPM-B01) ☐
Thermostats and Subbases*
Start Components*

*Available through the Replacement Parts Division



13PJL 18, 24, 30,
36, 42, 48, 60

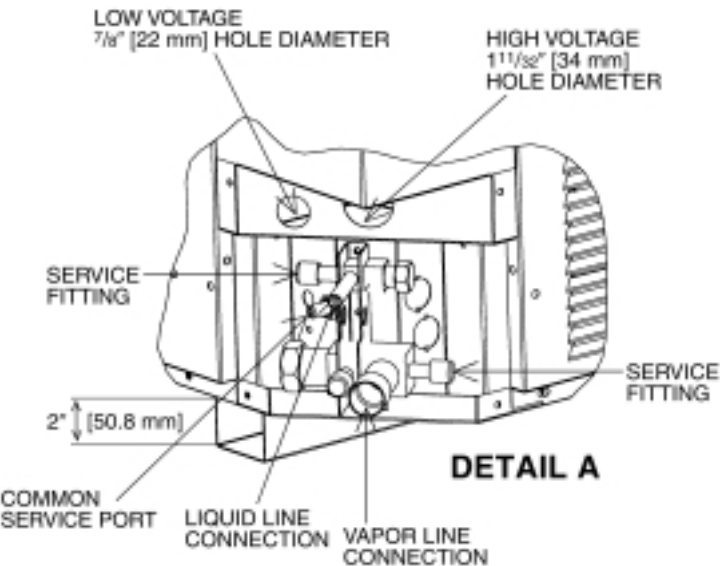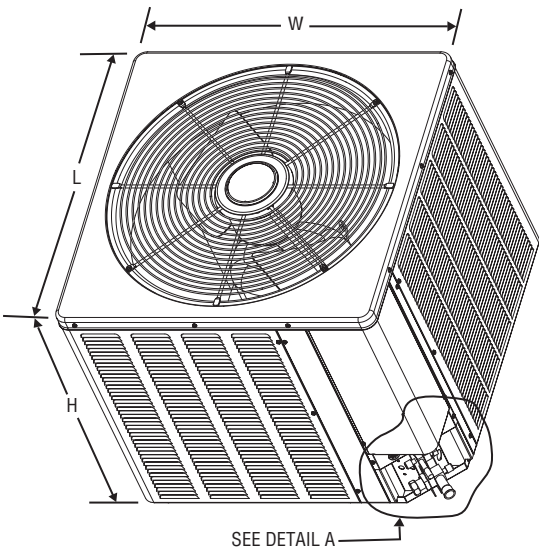

Model No. 13PJL	Unit Dimensions		
	Height "H" Inches [mm]	Length "L" Inches [mm]	Width "W" Inches [mm]
18, 24	26 ¹ / ₈ [664]	23 ⁵ / ₈ [600]	23 ⁵ / ₈ [600]
30	26 ⁵ / ₈ [676]	27 ⁵ / ₈ [702]	27 ⁵ / ₈ [702]
36	27 ¹⁵ / ₁₆ [710]	31 ⁵ / ₈ [803]	31 ⁵ / ₈ [803]
42, 48, 60	35 ¹⁵ / ₁₆ [913]	31 ⁵ / ₈ [803]	31 ⁵ / ₈ [803]

[] Designates Metric Conversions

NOTES:

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.

"In keeping with its policy of continuous progress and product improvement, Manufacturer reserves the right to make changes without notice."