


# INSTALLATION INSTRUCTIONS

## Package Air Conditioners Featuring Industry Standard R-410A Refrigerant

### RLNL 13 SEER (3-5 TONS) SERIES RLPL 14 SEER (3-5 TONS) SERIES

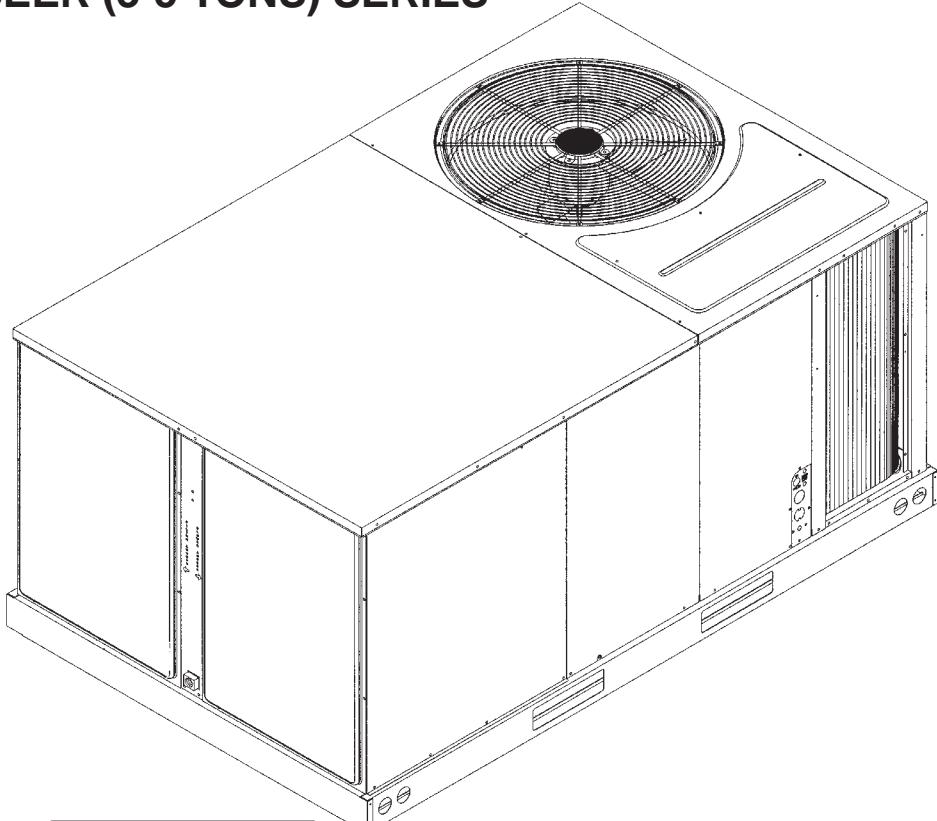

ENERGY STAR  
(14 SEER ONLY)



RECOGNIZE THIS SYMBOL AS AN INDICATION OF IMPORTANT SAFETY INFORMATION!

#### WARNING

THESE INSTRUCTIONS ARE INTENDED AS AN AID TO QUALIFIED, LICENSED SERVICE PERSONNEL FOR PROPER INSTALLATION, ADJUSTMENT AND OPERATION OF THIS UNIT. READ THESE INSTRUCTIONS THOROUGHLY BEFORE ATTEMPTING INSTALLATION OR OPERATION. FAILURE TO FOLLOW THESE INSTRUCTIONS MAY RESULT IN IMPROPER INSTALLATION, ADJUSTMENT, SERVICE OR MAINTENANCE POSSIBLY RESULTING IN FIRE, ELECTRICAL SHOCK, PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.



AS Quality Evaluations Inc.  
Management System Certification



ISO 9001:2008

Certificate Number: 30164

#### DO NOT DESTROY THIS MANUAL

PLEASE READ CAREFULLY AND KEEP IN A SAFE PLACE FOR FUTURE REFERENCE BY A SERVICEMAN



[ ] INDICATES METRIC CONVERSION

92-23577-76-05

SUPERSEDES 92-23577-76-04

# I. TABLE OF CONTENTS

I. Table of Contents .....	2
II. Introduction.....	3
III. Checking Product Received.....	3
IV. Specifications .....	3
V. Equipment Protection.....	4
Vi. Installation .....	7
A. General .....	7
1. Pre-Installation Check Points.....	7
2. Location .....	7
B. Outside Slab Installation .....	7
C. Clearances.....	8
D. Rooftop Installation .....	8
VII. Ductwork .....	9
VIII. Filters.....	10
IX. Conversion Procedure.....	10
X. Condensate Drain .....	10
XI. Electrical Wiring.....	11
A. Power Wiring.....	11
B. Special Instructions for Power Wiring with Aluminum Conductors .....	11
C. Control Wiring .....	12
D. Internal Wiring.....	13
E. Grounding .....	13
F. Thermostat.....	13
XII. Indoor Air Flow Data.....	14
XIII. Crankcase Heat.....	14
XIV. Pre-Start Check.....	14
XV. Startup.....	14
XVI. Operation.....	15
XVII. Auxiliary Heat .....	15
XVIII. General Data.....	16-41
XIX. Miscellaneous.....	42
Electrical & Physical Data .....	42-47
Airflow Performance.....	48-53
Heater Kit Characteristics .....	54-67
Wiring Diagrams.....	68-73
Charge Charts.....	74-78
Troubleshooting.....	79



Recognize this symbol as an indication of Important Safety Information!



## WARNING

**PROPOSITION 65: THIS APPLIANCE CONTAINS FIBERGLASS INSULATION. RESPIRABLE PARTICLES OF FIBERGLASS ARE KNOWN TO THE STATE OF CALIFORNIA TO CAUSE CANCER..**



## WARNING

**THE MANUFACTURER'S WARRANTY DOES NOT COVER ANY DAMAGE OR DEFECT TO THE AIR CONDITIONER CAUSED BY THE ATTACHMENT OR USE OF ANY COMPONENTS, ACCESSORIES OR DEVICES (OTHER THAN THOSE AUTHORIZED BY THE MANUFACTURER) INTO, ONTO OR IN CONJUNCTION WITH THE AIR CONDITIONER. YOU SHOULD BE AWARE THAT THE USE OF UNAUTHORIZED COMPONENTS, ACCESSORIES OR DEVICES MAY ADVERSELY AFFECT THE OPERATION OF THE AIR CONDITIONER AND MAY ALSO ENDANGER LIFE AND PROPERTY. THE MANUFACTURER DISCLAIMS ANY RESPONSIBILITY FOR SUCH LOSS OR INJURY RESULTING FROM THE USE OF SUCH UNAUTHORIZED COMPONENTS, ACCESSORIES OR DEVICES.**

## II. INTRODUCTION

This booklet contains the installation and operating instructions for your package air conditioner. There are a few precautions that should be taken to derive maximum satisfaction from it. Improper installation can result in unsatisfactory operation or dangerous conditions.

Read this booklet and any instructions packaged with separate equipment required to make up the system prior to installation. Give this booklet to the owner and explain its provisions. The owner should retain this booklet for future reference.

## III. CHECKING PRODUCT RECEIVED

Upon receiving the unit, inspect it for any damage from shipment. Claims for damage, either shipping or concealed, should be filed immediately with the shipping company. Check the unit model number, electrical characteristics, and accessories to determine if they are correct.

## IV. SPECIFICATIONS

### A. GENERAL

The Packaged Air Conditioner is available without heat or with 6, 10, 12, 15, 20 or 24 kW electric heat. Cooling capacities of 3, 3½, 4 and 5 nominal tons of cooling are available. Units are convertible from end supply and return to bottom supply and return by relocation of supply and return air access panels. See cover installation detail.

The units are weatherized for mounting outside of the building.

The information on the rating plate is in compliance with the FTC and DOE rating for single phase units. The following information is for three phase units which **are not** covered under the DOE certification program.

1. The efficiency rating of this unit is a product thermal efficiency rating determined under continuous operating conditions independent of any installed system.

### B. MAJOR COMPONENTS

The unit includes a hermetically-sealed refrigerating system (consisting of a compressor, condenser coil, evaporator coil with thermal expansion valve), a circulation air blower, a condenser fan, and all necessary internal electrical wiring. The cooling system of these units is factory-evacuated, charged and performance tested. Refrigerant amount and type are indicated on rating plate.

### C. R-410A REFRIGERANT

All units are factory charged with R-410A refrigerant.

#### 1. Specification of R-410A:

**Application:** R-410A is not a drop-in replacement for R-22; equipment designs must accommodate its higher pressures. It cannot be retrofitted into R-22 units.

**Pressure:** The pressure of R-410A is approximately 60% (1.6 times) greater than R-22. Recovery and recycle equipment, pumps, hoses and the like need to have design pressure ratings appropriate for R-410A. Manifold sets need to range up to 800 psig high-side and 250 psig low-side with a 550 psig low-side retard. Hoses need to have a service pressure rating of 800 psig. Recovery cylinders need to have a 400 psig service pressure rating. DOT 4BA400 or DOT BW400.

**Combustibility:** At pressures above 1 atmosphere, mixture of R-410A and air can become combustible. R-410A and air should never be mixed in tanks or supply lines, or be allowed to accumulate in storage tanks. Leak checking should never be done with a mixture of R-410A and air. Leak checking can be performed safely with nitrogen or a mixture of R-410A and nitrogen.

#### 2. Quick Reference Guide For R-410A

- R-410A refrigerant operates at approximately 60% higher pressure (1.6 times) than R-22. Ensure that servicing equipment is designed to operate with R-410A.
- R-410A refrigerant cylinders are pink.
- R-410A, as with other HFC's is only compatible with POE oils.
- Vacuum pumps will not remove moisture from POE oil.

- R-410A systems are to be charged with liquid refrigerants. Prior to March 1999, R-410A refrigerant cylinders had a dip tube. These cylinders should be kept upright for equipment charging. Post March 1999 cylinders do not have a dip tube and should be inverted to ensure liquid charging of the equipment.
- Do not install a suction line filter drier in the liquid line.
- A liquid line filter drier is standard on every unit.
- Desiccant (drying agent) must be compatible for POE oils and R-410A.

### 3. Evaporator Coil / TXV

The thermostatic expansion valve is specifically designed to operate with R-410A. **DO NOT use an R-22 TXV. The existing evaporator must be replaced with the factory specified TXV evaporator specifically designed for R-410A.**

### 4. Tools Required For Installing & Servicing R-410A Models

Manifold Sets:

- Up to 800 PSIG High side
- Up to 250 PSIG Low Side
- 550 PSIG Low Side Retard

Manifold Hoses:

- Service Pressure Rating of 800 PSIG

Recovery Cylinders:

- 400 PSIG Pressure Rating
- Dept. of Transportation 4BA400 or BW400

#### **⚠ CAUTION**

R-410A systems operate at higher pressures than R-22 systems. Do not use R-22 service equipment or components on R-410A equipment.

## V. EQUIPMENT PROTECTION FROM THE ENVIRONMENT

The metal parts of this unit may be subject to rust or deterioration in adverse environmental conditions. This oxidation could shorten the equipment's useful life. Salt spray, fog or mist in seacoast areas, sulphur or chlorine from lawn watering systems, and various chemical contaminants from industries such as paper mills and petroleum refineries are especially corrosive.

**If the unit is to be installed in an area where contaminants are likely to be a problem, special attention should be given to the equipment location and exposure.**

1. Avoid having lawn sprinkler heads spray direction on the unit cabinet.
2. In coastal areas, locate the unit on the side of the building away from the waterfront.
3. Shielding provided by a fence or shrubs may give some protection.

**Regular maintenance will reduce the buildup of contaminants and help to protect the unit's finish.**

#### **⚠ WARNING**


**DISCONNECT ALL POWER TO THE UNIT BEFORE STARTING MAINTENANCE. FAILURE TO DO SO CAN RESULT IN SEVERE ELECTRICAL SHOCK OR DEATH.**

1. Frequent washing of the cabinet, fan blade and coil with fresh water will remove most of the salt or other contaminants that build up on the unit.
2. Regular cleaning and waxing of the cabinet with a good automobile polish will provide some protection.
3. A good liquid cleaner may be used several times a year to remove matter that will not wash off with water.


Several different types of protective coatings are offered in some areas. These coatings may provide some benefit, but the effectiveness of such coating materials cannot be verified by the equipment manufacturer.

**The best protection is frequent cleaning, maintenance and minimal exposure to contaminants.**


**FIGURE 1**  
UNIT DIMENSIONS

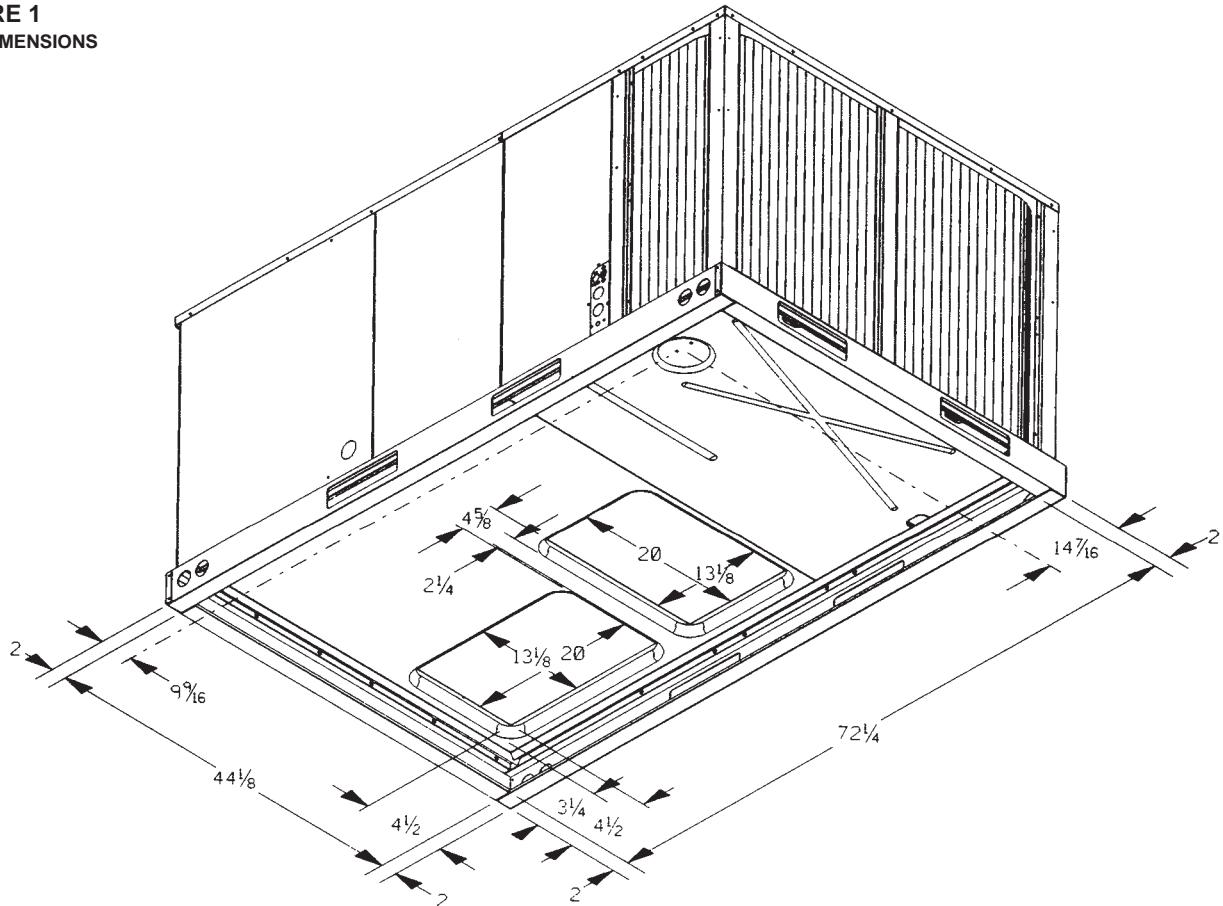

**FIGURE 2**  
UNIT DIMENSIONS

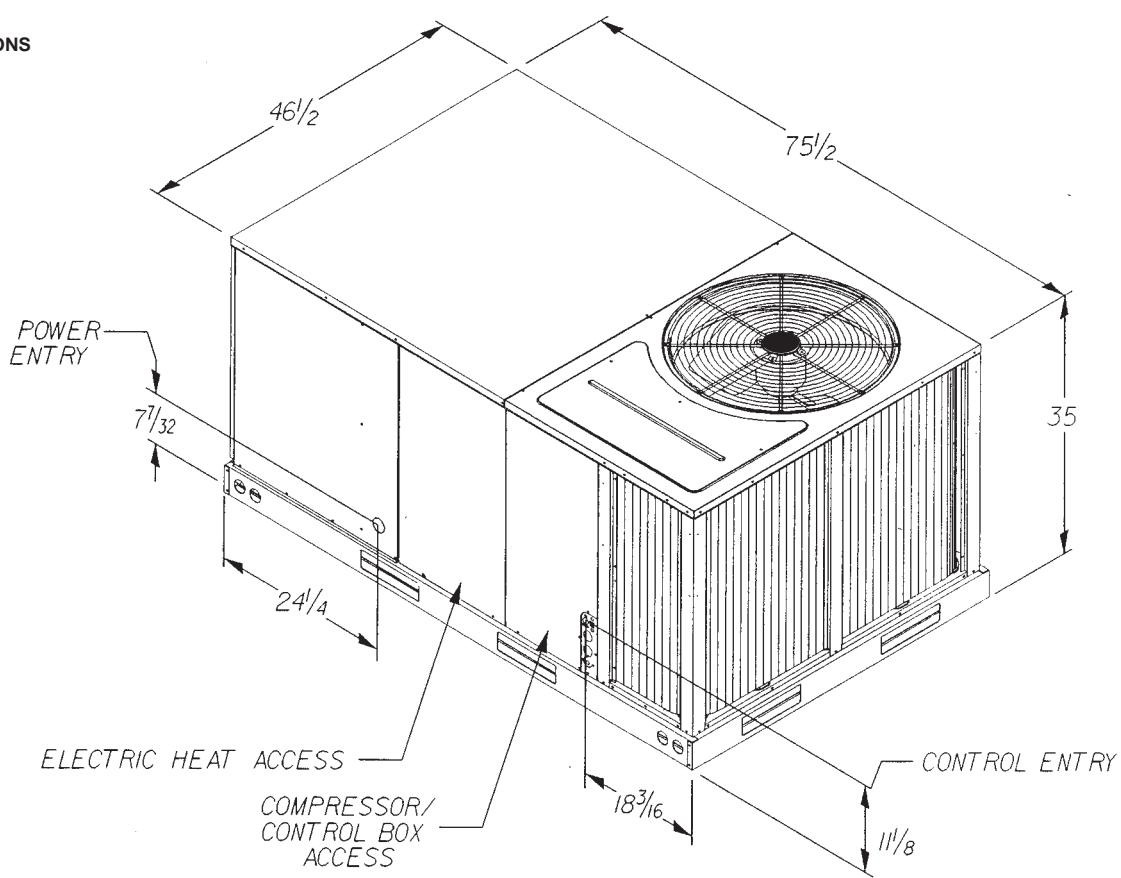


**FIGURE 3**  
UNIT DIMENSIONS

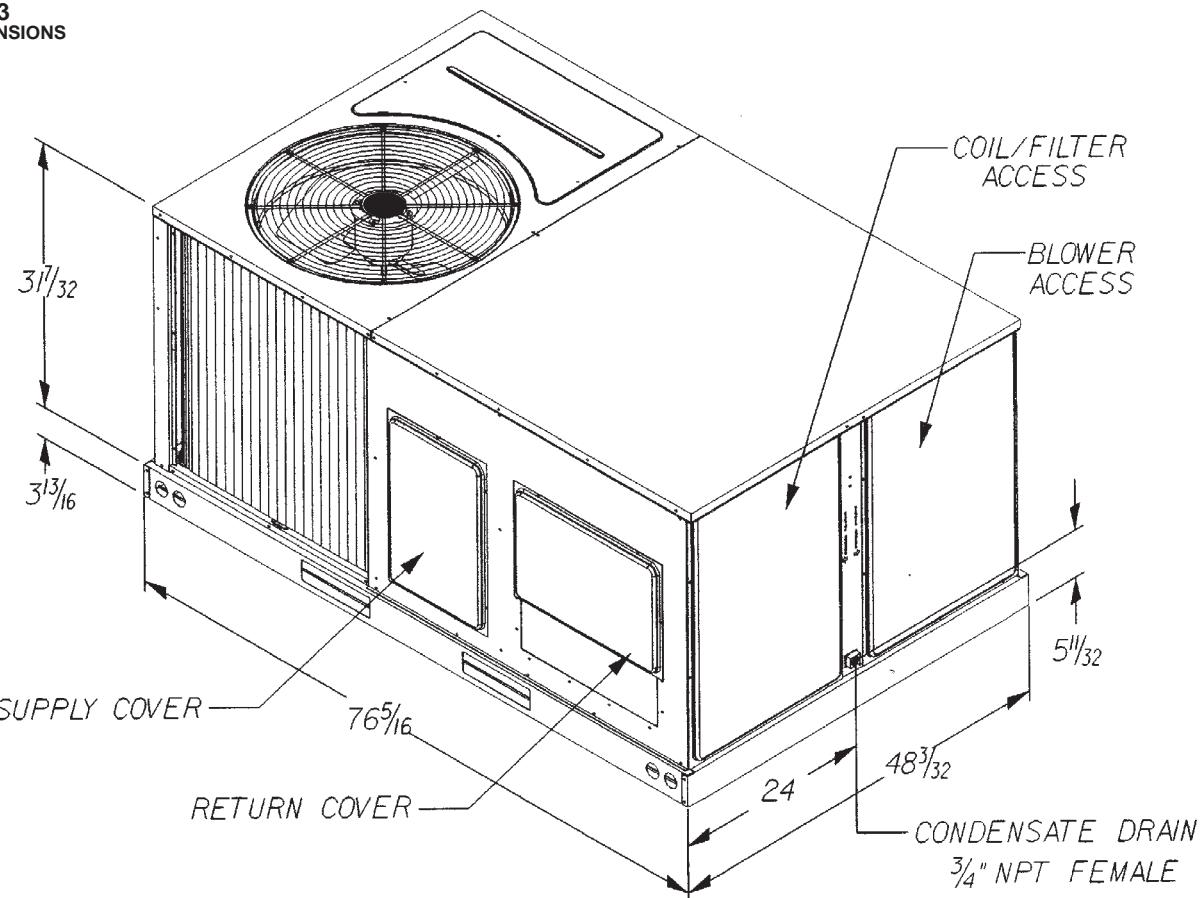

ILL 1304


**FIGURE 4**  
UNIT DIMENSIONS

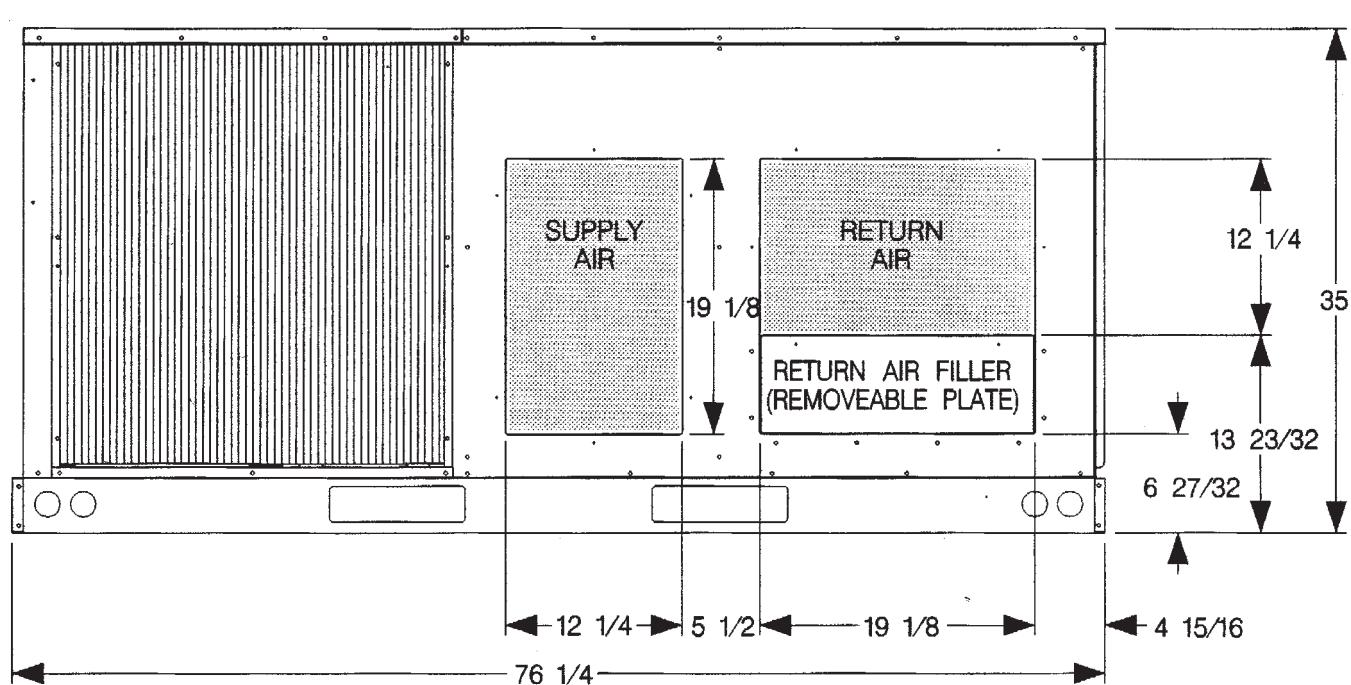


ILL 1288

**FIGURE 5**

PACKAGE AIR CONDITIONER – OUTSIDE SLAB INSTALLATION,  
BASEMENT OR CRAWL SPACE DISTRIBUTION SYSTEM

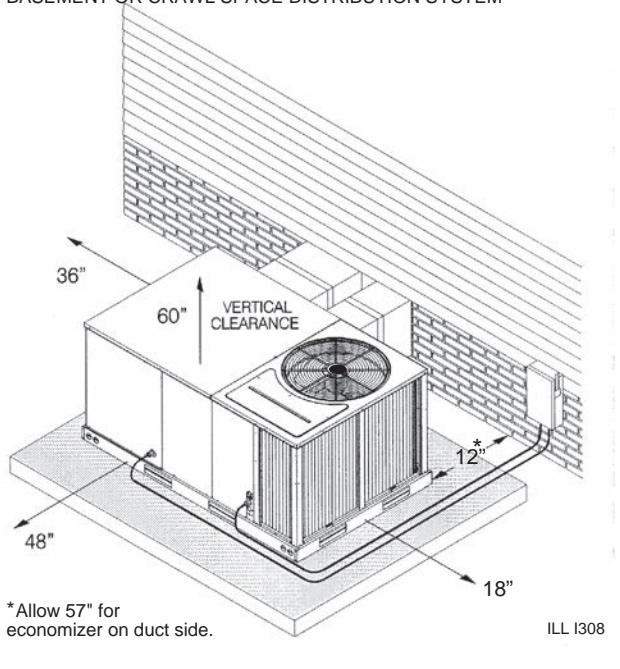**FIGURE 6**

PACKAGE AIR CONDITIONER – OUTSIDE SLAB INSTALLATION, CLOSET  
DISTRIBUTION SYSTEM. SLAB FLOOR CONSTRUCTION

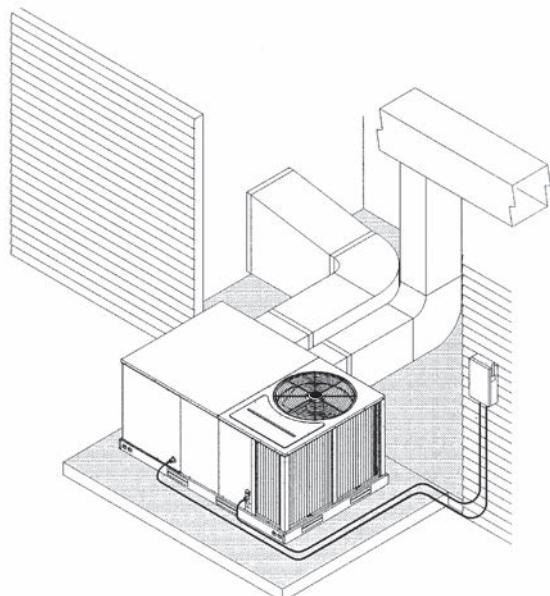

## VI. INSTALLATION

### A. GENERAL

#### 1. PRE-INSTALLATION CHECK-POINTS

Before attempting any installation, the following points should be carefully considered:

- Structural strength of supporting members.  
(rooftop installation)
- Clearances and provision for servicing.
- Power supply and wiring.
- Air duct connections.
- Drain facilities and connections.
- Location for minimum noise.

#### 2. LOCATION


These units are designed for outdoor installations. They can be mounted on a slab or rooftop. They are not to be installed within any part of a structure such as an attic, crawl space, closet, or any other place where condenser air flow is restricted or other than outdoor ambient conditions prevail. Since the application of the units is of the outdoor type, it is important to consult your local code authorities at the time the first installation is made.

### B. OUTSIDE SLAB INSTALLATION

**(Typical outdoor slab installations are shown in Figures 5 and 6.)**

- Select a location where external water drainage cannot collect around the unit.
- Provide a level concrete slab extending 3" beyond all four sides of the unit. The slab should be sufficient above grade to prevent ground water from entering the unit. **IMPORTANT: To prevent transmission of noise or vibration, slab should not be connected to building structure.**
- The location of the unit should be such as to provide proper access for inspection and servicing.
- Locate unit where operating sounds will not disturb owner or neighbors.
- Locate unit so roof runoff water does not pour directly on the unit. Provide gutter or other shielding at roof level. Do not locate unit in an area where excessive snow drifting may occur or accumulate.
- Remove compressor shipping supports (if so equipped) after installation.

**FIGURE 7**  
PACKAGE AIR CONDITIONER – RIGGING FOR LIFTING

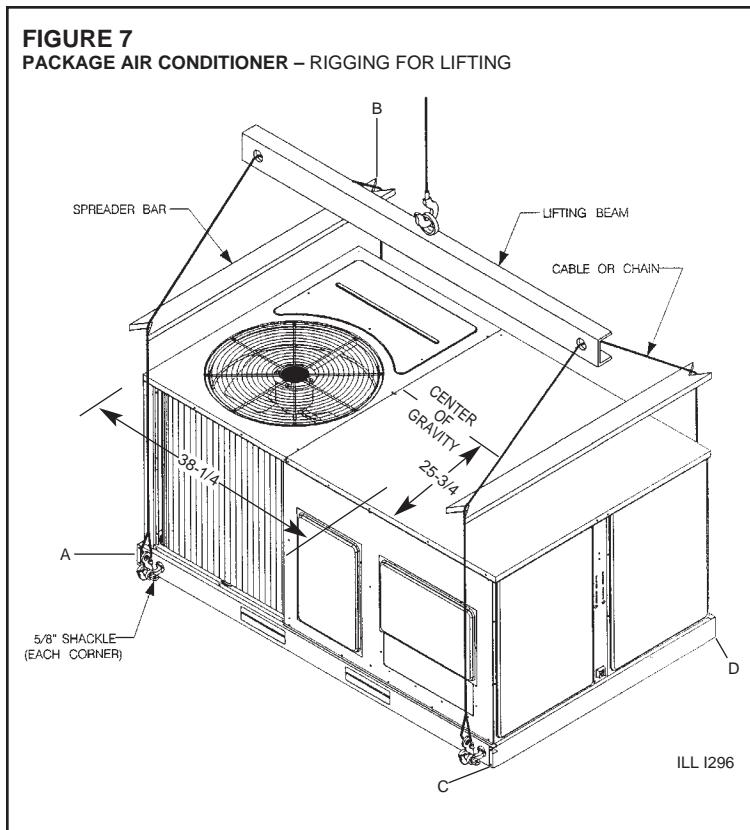

CORNER WEIGHTS BY PERCENTAGE			
A	B	C	D
23%	27%	23%	27%

### C. CLEARANCES

The following minimum clearances must be observed for proper unit performance and serviceability.


1. Provide 48" minimum clearance at the front of the unit. Provide 36" minimum clearance at the left and right side of the unit for service access.
2. Provide 60" minimum clearance between top of unit and maximum 3 foot overhang.
3. Unit is design certified for application on combustible flooring with 0" minimum clearance.
4. See Figure 5 for illustration of minimum installation-service clearances.

### D. ROOFTOP INSTALLATION

1. Before locating the unit on the roof, make sure that the strength of the roof and beams is adequate at that point to support the weight involved. (See specification sheet for weight of unit.) This is very important and user's responsibility.
2. For rigging and roofcurb details, see Figures 7 and 8. Use field-furnished spreaders.
3. For roofcurb assembly, see Roofcurb Installation Instructions.
4. If the roofcurb is not used, provisions for disposing of condensate water runoff must be provided.
5. The unit should be placed on a solid and level roofcurb or platform of adequate strength. See Figure 9.
6. The location of the unit on the roof should be such as to provide proper access for inspection and servicing.
7. Remove compressor shipping supports (if so equipped) after installation.

**IMPORTANT:** If unit will not be put into service immediately, cover supply and return openings to prevent excessive condensation.

**FIGURE 8**  
PACKAGE AIR CONDITIONER – ROOFCURB INSTALLATION

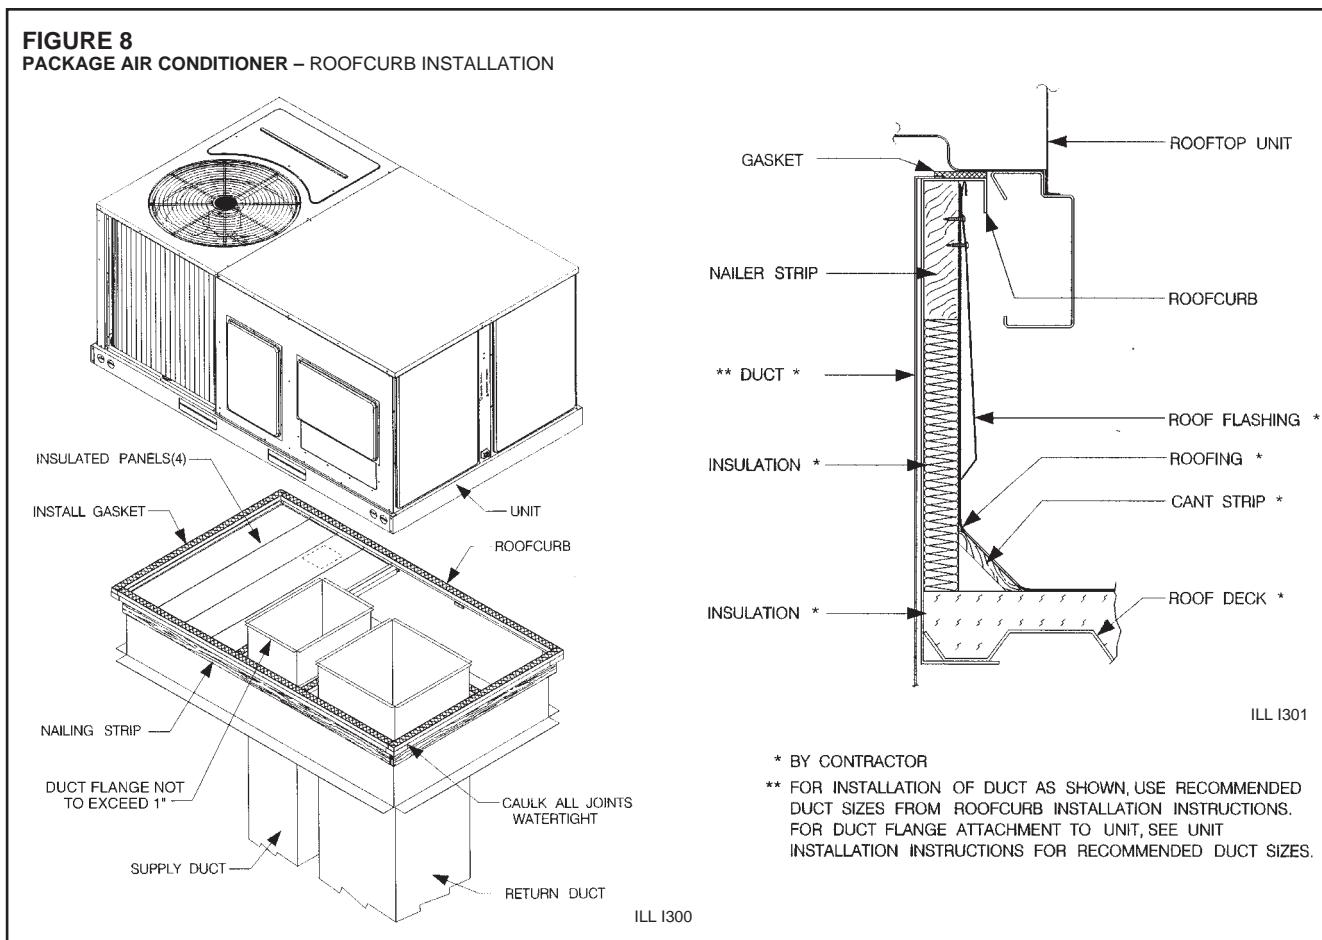

## ⚠ WARNING

DO NOT, UNDER ANY CIRCUMSTANCES, CONNECT RETURN DUCTWORK TO ANY OTHER HEAT PRODUCING DEVICE SUCH AS A FIREPLACE INSERT, STOVE, ETC. UNAUTHORIZED USE OF SUCH DEVICES MAY RESULT IN FIRE, CARBON MONOXIDE POISONING, EXPLOSION, PROPERTY DAMAGE, SEVERE PERSONAL INJURY OR DEATH.

## VII. DUCTWORK

Ductwork should be fabricated by the installing contractor in accordance with local codes and NFPA90A. Industry manuals may be used as a guide when sizing and designing the duct system - contact Air Conditioning Contractors of America, 2800 Shirlington Road, Suite 300, Arlington, VA 22206, <http://www.acca.org>.

The unit should be placed as close to the space to be air conditioned as possible allowing clearance dimensions as indicated. Ducts should be run as directly as possible to supply and return outlets. Use of non-flammable waterproof flexible connectors on both supply and return connections at the unit to reduce noise transmission is recommended.

It is preferable to install the unit on the roof of the structure if the registers or diffusers are located on the wall or in the ceiling. A slab installation could be considered when the registers are low on a wall or in the floor.

On ductwork exposed to outside air conditions of temperature and humidity, use a minimum of 2" of insulation and a vapor barrier. Distribution system in attic, furred space or crawl space should be insulated with at least 2" of insulation with vapor barrier. One-half to 1" thickness of insulation is usually sufficient for ductwork inside the air conditioned space.


Balancing dampers should be provided for each branch duct in the supply system. Ductwork should be properly supported from the structure.

When installing ductwork, consider the following items:


1. Noncombustible flexible connectors should be used between ductwork and unit to reduce noise and vibration transmission into the ductwork.
2. When auxiliary heaters are installed, use noncombustible flexible connectors and clearance to combustible material of 0" for the first 3 feet of discharge duct. Clearance to unit top and side is 0".

**FIGURE 9**

**PACKAGE AIR CONDITIONER – FLAT ROOFTOP INSTALLATION, ATTIC OR DROP CEILING DISTRIBUTION SYSTEM. MOUNTED ON ROOFCURB. CURB MUST BE LEVEL**

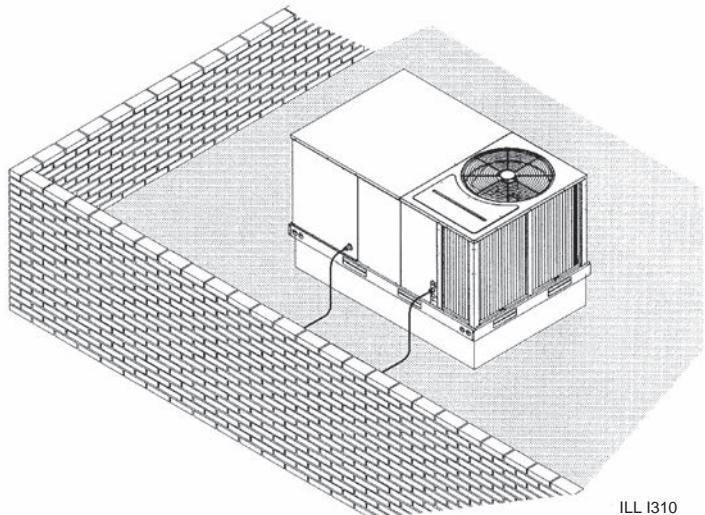

ILL I310

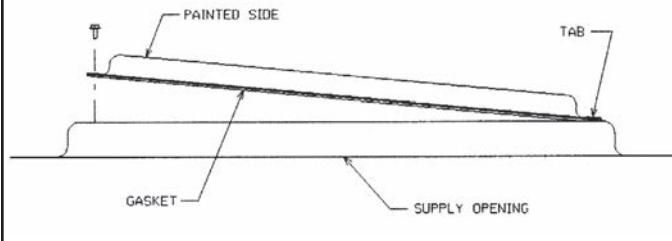**FIGURE 10  
COVER GASKET DETAIL**

ILL I631

## VIII. FILTERS

This unit is provided with 2 - 25" x 16" x 1" disposable filters. When replacing filters, ensure they are inserted fully to the back to prevent bypass.

## IX. CONVERSION PROCEDURE DOWNGLOW TO HORIZONTAL

1. Remove the screws and covers from the outside of the supply and return sections.
2. Install the covers in the bottom supply and return openings with the painted side up. See Figure 10. Use the existing gasket to seal the covers.
3. Secure the supply cover to the base of the unit with 1 screw, engaging prepunched tab in unit base.
4. Secure the return cover to the base of the unit with screws, engaging prepunched holes in the unit base.


## X. CONDENSATE DRAIN

The condensate drain connection of the evaporator is 3/4" nominal female pipe thread.

**IMPORTANT:** Install a condensate trap to ensure proper condensate drainage. See Figure 11.

**FIGURE 11  
CONDENSATE DRAIN**

DO NOT OPERATE UNIT WITHOUT  
CONDENSATE DRAIN TRAP

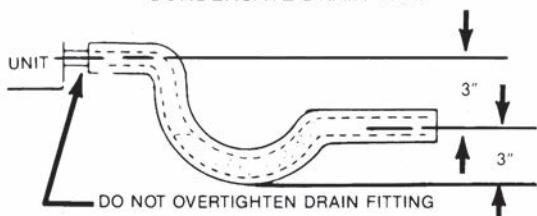

## **XI. ELECTRICAL WIRING**

Field wiring must comply with the National Electrical Code\* and local ordinances that may apply.

\*C.E.C. in Canada

## A. POWER WIRING

1. It is important that proper electrical power is available at the unit. Voltage should not vary more than 10% from that stamped on the unit rating plate. On three phase units, phases must be balanced within 3%.
  2. Install a branch circuit disconnect within sight of the unit and of adequate size to handle the starting current. Reference Figure 12 for proper location.
  3. For branch circuit wiring (main power supply to unit disconnect), the minimum wire size can be determined from Table A using the circuit ampacity found on the unit nameplate.

**TABLE A**

## COPPER WIRE SIZE — AWG (1% VOLTAGE DROP)

	300	4	3	2	2	1	1/0	1/0	2/0	2/0	3/0	3/0	4/0	4/0	4/0	250	250	250	250	300	300	300	300	350	350	350	350		
Supply	250	4	4	3	3	2	1	1	1/0	1/0	2/0	2/0	3/0	3/0	4/0	4/0	4/0	4/0	250	250	250	250	250	250	250	250			
Wire	200	6	4	4	4	3	2	2	1	1	1/0	1/0	1/0	2/0	2/0	2/0	3/0	3/0	3/0	3/0	4/0	4/0	4/0	4/0	300	300	300	300	
Length	150	8	6	6	4	4	4	3	3	2	2	1	1	1/0	1/0	1/0	2/0	2/0	2/0	2/0	3/0	3/0	3/0	3/0	4/0	4/0	4/0	4/0	
Feet	100	10	8	8	6	6	6	4	4	4	3	3	2	2	2	1	1	1	1	1/0	1/0	1/0	1/0	1/0	1/0	2/0	2/0	2/0	
		50	14	12	10	10	8	8	6	6	6	4	4	4	3	3	3	2	2	2	2	1	1	1	1	1/0	1/0	2/0	
Circuit Ampacity																													
	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130	135	140	145	150	155

**NOTE:**

1. Wire size based on 60°C type copper conductors below 100 ampacity.  
2. Wire size based on 75°C type copper conductors for 100 ampacity and above.

2. Wire size based on 75°C type copper conductors for 100 ampacity and above.

4. This unit incorporates single point electrical connection for unit and electric heat accessory.
  5. Power wiring must be run in grounded rain-tight conduit. Connect the power field wiring as follows:
    - a. NO ELECTRIC HEAT - Connect the field wires directly to the contactor pigtail in the electric heat access area. Connect ground wire to ground lug.
    - b. WITH ELECTRIC HEAT - Connect the field wires to the terminal block on the electric heater kit in the electric heat access area. Connect the ground wire to the ground lug on the heater kit.

**NOTE:** For field installation of a heater kit, follow the instructions provided with the heater kit.

6. The pigtail wires in the electric heat access area are factory wired to the contactor in the control box.
  7. DO NOT connect aluminum field wires to electric heat kit power input terminals.


## **B. SPECIAL INSTRUCTIONS FOR POWER WIRING WITH ALUMINUM CONDUCTORS**

1. Select the equivalent aluminum wire size from the tabulation below:

TABLE B. WIRE SIZES			
AWG Copper Wire Size	AWG Aluminum Wire Size	Connector Type and Size (or equivalent)	
#12	#10	T&B Wire Nut	PT2
#10	#8	T&B Wire Nut	PT3
#8	#6	Ilasco Split Bolt	AK-6
#6	#4	Ilasco Split Bolt	AK-4
#4	#2	Ilasco Split Bolt	AK-2
#3	#1	Ilasco Split Bolt	AK-1/0
#2	#0	Ilasco Split Bolt	AK-1/0
#1	#00	Ilasco Split Bolt	AK-2/0
#0	#000	Ilasco Split Bolt	AK-4/0

2. Attach a length (6" or more) of recommended size copper wire to the unit terminals L1 and L3 for single phase, L1, L2, L3 for three phase.

**FIGURE 12**  
RECOMMENDED LOCATION OF BRANCH CIRCUIT DISCONNECT

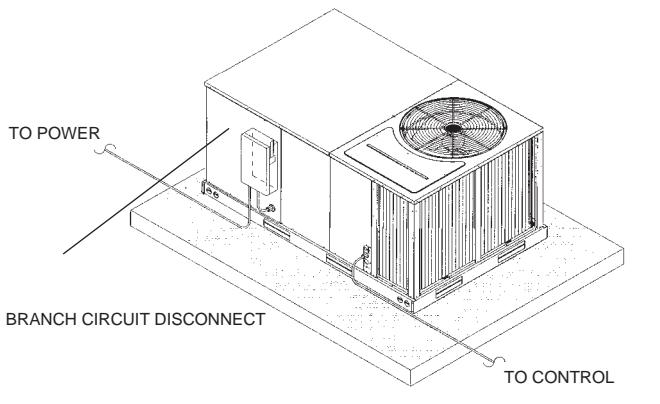


3. Splice copper wire pigtails to aluminum wire with U.L. recognized connectors for copper-aluminum splices. Follow these instructions very carefully to make a positive and lasting connection;
  - a. Strip insulation from aluminum conductor.
  - b. Coat the stripped end of the aluminum wire with the recommended inhibitor and wire brush aluminum surface through inhibitor. Inhibitors: Brundt, Pentex "A"; Alcoa, No. 2EJC; T&B KPOR Shield.
  - c. Clean and recoat aluminum conductor with inhibitor.
  - d. Make the splice using the above listed wire nuts or split bolt connectors.
  - e. Coat the entire connection with inhibitor and wrap with electrical insulating tape.

WARRANTY MAY NOT APPLY IF CONNECTIONS ARE NOT MADE PER INSTRUCTIONS

### C. CONTROL WIRING (Class II)


1. Low voltage wiring should not be run in conduit with power wiring.
2. Control wiring is routed through the 7/8" hole adjacent to the compressor access panel. See Figure 2. Use a minimum #18 AWG thermostat wire. For wire lengths exceeding 50', use #16 AWG thermostat wire. The low voltage wires are connected to the unit pigtails which are supplied with the unit in the low voltage connection box located below the unit control box.

**FIGURE 13**  
HEATER KIT INSTALLATION

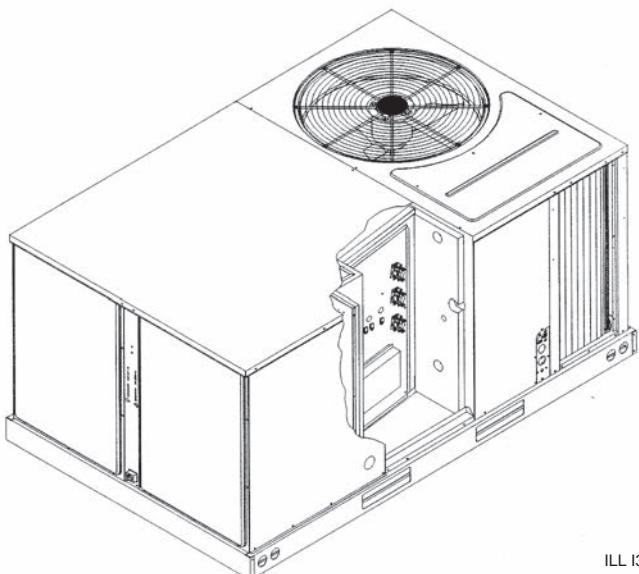

**FIGURE 14**  
LOW VOLTAGE CONNECTIONS DIAGRAMS

### STANDARD CONTROL WIRING

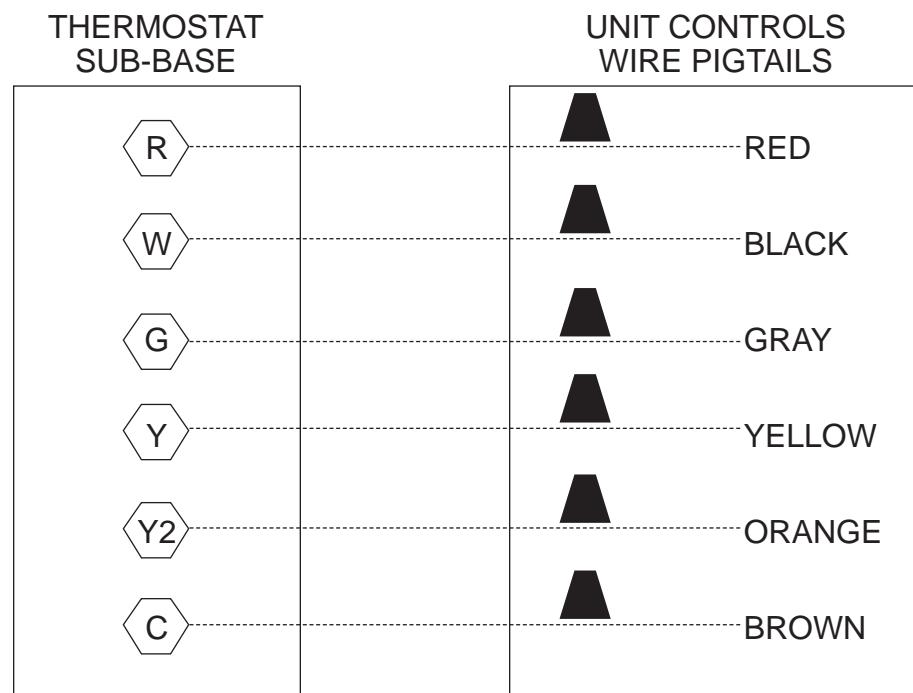

NOTE: Y2 IS ONLY USED WITH OPTIONAL ECONOMIZER.

3. Figure 14 shows representative low voltage connection diagrams. Read your thermostat installation instructions for any special requirements for your specific thermostat.  
 NOTE — Units installed in Canada require that an outdoor thermostat (30,000 min. cycles of endurance) be installed and be wired with C.E.C. Class I wiring.

### D. INTERNAL WIRING

**IMPORTANT:** Some single phase models are equipped with a single pole contactor. Caution must be exercised when servicing as only one leg of the power supply is broken with the contactor.

Some models are equipped with electronically commutated blower motors which are constantly energized unless the main unit disconnect is in the off position.

1. A diagram of the internal wiring of this unit is located on the inside of the compressor access panel. If any of the original wire as supplied with the appliance must be replaced, the wire gauge and insulation must be the same as original wiring.

### E. GROUNDING

#### WARNING

**THE UNIT MUST BE PERMANENTLY GROUNDED. A GROUNDING LUG IS PROVIDED IN THE ELECTRIC HEAT KIT ACCESS AREA FOR A GROUND WIRE. FAILURE TO GROUND THIS UNIT CAN RESULT IN FIRE OR ELECTRICAL SHOCK CAUSING PROPERTY DAMAGE, SEVERE PERSONAL INJURY OR DEATH.**

### F. THERMOSTAT

The thermostat should be mounted on an inside wall about five feet above the floor in a location where it will not be affected by unconditioned air, sun, or drafts from open doors or other sources. READ installation instructions in thermostat package CAREFULLY because each has some different wiring requirements.

## XII. INDOOR AIR FLOW DATA

Direct-drive blower models are shipped factory wired for the proper speed at a typical external static. See Blower Performance Data. Belt-drive blower models have motor sheaves set for proper CFM at a typical external static.

## XIII. CRANKCASE HEAT (OPTIONAL)

Crankcase heat is not required on scroll type compressors, but may be necessary for difficult starting situations.

## XIV. PRE-START CHECK

1. Is unit properly located and slightly slanted toward indoor condensate drain?
2. Is ductwork insulated, weatherproofed, with proper spacing to combustible materials?
3. Is air free to travel to and from outdoor coil? (See Figure 5.)
4. Is the wiring correct, tight, and according to unit wiring diagram?
5. Is unit grounded?
6. Are field supplied air filters in place and clean?
7. Do the outdoor fan and indoor blower turn freely without rubbing, and are they tight on the motor shafts?
8. Are the compressor shipping supports removed (if so equipped)?

## XV. STARTUP

1. Turn thermostat to "OFF," turn "on" power supply at disconnect switch.
2. Turn temperature setting as high as it will go.
3. Turn fan switch to "ON."
4. Indoor blower should run. Be sure it is running in the right direction.
5. Turn fan switch to "AUTO." Turn system switch to "COOL" and turn temperature setting below room temperature. Unit should run in cooling mode.
6. Is outdoor fan operating correctly in the right direction?
7. Is compressor running correctly?
8. Check the refrigerant charge using the instructions located on compressor access panel. Replace service port caps. Service port cores are for system access only and will leak if not tightly capped.
9. Turn thermostat system switch to proper mode "HEAT" or "COOL" and set thermostat to proper temperature setting. Record the following after the unit has run some time.  
A. Operating Mode \_\_\_\_\_  
B. Discharge Pressure (High)\_PSIG  
C. Vapor Pressure at Compressor (Low) \_\_\_\_\_ PSIG  
D. VaporLine Temperature at Compressor \_\_\_\_\_ °F.  
E. Indoor Dry Bulb \_\_\_\_\_ °F.  
F. Indoor Wet Bulb \_\_\_\_\_ °F.  
G. Outdoor Dry Bulb \_\_\_\_\_ °F.  
H. Outdoor Wet Bulb \_\_\_\_\_ °F.  
I. Voltage at Contactor \_\_\_\_\_ Volts  
J. Current at Contactor \_\_\_\_\_ Amps  
K. Model Number \_\_\_\_\_  
L. Serial Number \_\_\_\_\_  
M. Location \_\_\_\_\_  
N. Owner \_\_\_\_\_  
O. Date \_\_\_\_\_
10. Adjust discharge air grilles and balance system.
11. Check ducts for condensation and air leaks.
12. Check unit for tubing and sheet metal rattles.
13. Instruct the owner on operation and maintenance.
14. Leave "INSTALLATION" and "USE AND CARE" instructions with owner.

## XVI. OPERATION

Most single phase units are operated PSC (no start relay or start capacitor). It is important that such systems be off for a minimum of 5 minutes before restarting to allow equalization of pressures. The thermostat should not be moved to cycle unit without waiting five minutes. To do so may cause the compressor to stop on an automatic open overload device or blow a fuse. Poor electrical service can cause nuisance tripping in overloads or blow fuses.

**IMPORTANT:** *The compressor has an internal overload protector. Under some conditions, it can take up to 2 hours for this overload to reset. Make sure overload has had time to reset before condemning the compressor.*

Some units are equipped with a time delay control (TDC1). The control allows the blower to operate for up to 60 seconds after the thermostat is satisfied.

## XVII. AUXILIARY HEAT

### WARNING

ONLY ELECTRIC HEATER KITS SUPPLIED BY THIS MANUFACTURER AS DESCRIBED IN THIS PUBLICATION HAVE BEEN DESIGNED, TESTED, AND EVALUATED BY A NATIONALLY RECOGNIZED SAFETY TESTING AGENCY FOR USE WITH THIS UNIT. USE OF ANY OTHER MANUFACTURED ELECTRIC HEATERS INSTALLED WITHIN THIS UNIT MAY CAUSE HAZARDOUS CONDITIONS RESULTING IN PROPERTY DAMAGE, FIRE, BODILY INJURY OR DEATH.

### CONTROL SYSTEM OPERATION

1. In the cooling mode, the thermostat will, on a call for cooling, energize the compressor contactor and the indoor blower relay. The indoor blower can be operated continuously by setting the thermostat fan switch at the "ON" position.
2. In the heating mode, the thermostat will energize one or more supplementary resistance heaters.

## XVIII. GENERAL DATA - RLNL MODELS

### NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLNL- Series	A036CK	A036CL	A036CM	A036DK
<b>Cooling Performance<sup>1</sup></b>	<b>[Continued -&gt;]</b>			
Gross Cooling Capacity Btu [kW]	36,800 [10.78]	36,800 [10.78]	36,800 [10.78]	36,800 [10.78]
EER/SEER <sup>2</sup>	11.4/13	11.4/13	11.4/13	11.4/13
Nominal CFM/AHRI Rated CFM [L/s]	1200/1200 [566/566]	1200/1200 [566/566]	1200/1200 [566/566]	1200/1200 [566/566]
AHRI Net Cooling Capacity Btu [kW]	35,400 [10.37]	35,400 [10.37]	35,400 [10.37]	35,400 [10.37]
Net Sensible Capacity Btu [kW]	26,200 [7.68]	26,200 [7.68]	26,200 [7.68]	26,200 [7.68]
Net Latent Capacity Btu [kW]	9,200 [2.7]	9,200 [2.7]	9,200 [2.7]	9,200 [2.7]
Net System Power kW	3.1	3.1	3.1	3.1
<b>Compressor</b>				
No./Type	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	78	78	78	78
<b>Outdoor Coil - Fin Type</b>				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Size in. [mm] OD	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]
1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]
<b>Indoor Coil - Fin Type</b>				
Tube Type	Corrugated	Corrugated	Corrugated	Corrugated
Tube Size in. [mm]	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Refrigerant Control	2 / 17 [7]	2 / 17 [7]	2 / 17 [7]	2 / 17 [7]
TX Valves	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>				
No. Used/Diameter in. [mm]	Propeller	Propeller	Propeller	Propeller
1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3680 [1737]	3680 [1737]	3680 [1737]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>				
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Direct/3	Belt/Variable	Belt/Variable	Direct/3
No. Motors	1	1	1	1
Motor HP	1/2	1/2	3/4	1/2
Motor RPM	1075	1725	1725	1075
Motor Frame Size	48	48	56	48
<b>Filter - Type</b>				
Furnished	Disposable	Disposable	Disposable	Disposable
Yes	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	96 [2722]	96 [2722]	96 [2722]	96 [2722]
<b>Weights</b>				
Net Weight lbs. [kg]	543 [246]	543 [246]	543 [246]	543 [246]
Ship Weight lbs. [kg]	550 [249]	550 [249]	550 [249]	550 [249]

**NOTES:**

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLNL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLNL- Series	A036DL	A036DM	A036JK	A036YL
<b>Cooling Performance<sup>1</sup></b>	<b>Continued -&gt;</b>			
Gross Cooling Capacity Btu [kW]	36,800 [10.78]	36,800 [10.78]	36,800 [10.78]	36,800 [10.78]
EER/SEER <sup>2</sup>	11.4/13	11.4/13	11.4/13	11.4/13
Nominal CFM/AHRI Rated CFM [L/s]	1200/1200 [566/566]	1200/1200 [566/566]	1200/1200 [566/566]	1200/1200 [566/566]
AHRI Net Cooling Capacity Btu [kW]	35,400 [10.37]	35,400 [10.37]	35,400 [10.37]	35,400 [10.37]
Net Sensible Capacity Btu [kW]	26,200 [7.68]	26,200 [7.68]	26,200 [7.68]	26,200 [7.68]
Net Latent Capacity Btu [kW]	9,200 [2.7]	9,200 [2.7]	9,200 [2.7]	9,200 [2.7]
Net System Power kW	3.1	3.1	3.1	3.1
<b>Compressor</b>				
No./Type	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	78	78	78	78
<b>Outdoor Coil - Fin Type</b>				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Size in. [mm] OD	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]
1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]
<b>Indoor Coil - Fin Type</b>				
Tube Type	Corrugated	Corrugated	Corrugated	Corrugated
Tube Size in. [mm]	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
1 / 17 [7]	2 / 17 [7]	2 / 17 [7]	2 / 17 [7]	2 / 17 [7]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>				
No. Used/Diameter in. [mm]	Propeller	Propeller	Propeller	Propeller
1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3680 [1737]	3680 [1737]	3680 [1737]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>				
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Direct/3	Belt/Variable
No. Motors	1	1	1	1
Motor HP	1/2	3/4	1/2	3/4
Motor RPM	1725	1725	1075	1725
Motor Frame Size	48	56	48	56
<b>Filter - Type</b>				
Furnished	Disposable	Disposable	Disposable	Disposable
Yes	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]
	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	96 [2722]	96 [2722]	96 [2722]	96 [2722]
<b>Weights</b>				
Net Weight lbs. [kg]	543 [246]	543 [246]	543 [246]	543 [246]
Ship Weight lbs. [kg]	550 [249]	550 [249]	550 [249]	550 [249]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLNL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLNL- Series	A036YM	A042CK	A042CL	A042CM
<b>Cooling Performance<sup>1</sup></b>	<b>[Continued -&gt;]</b>			
Gross Cooling Capacity Btu [kW]	36,800 [10.78]	42,500 [12.45]	42,500 [12.45]	42,500 [12.45]
EER/SEER <sup>2</sup>	11.4/13	11.2/13	11.2/13	11.2/13
Nominal CFM/AHRI Rated CFM [L/s]	1200/1200 [566/566]	1400/1450 [661/684]	1400/1450 [661/684]	1400/1450 [661/684]
AHRI Net Cooling Capacity Btu [kW]	35,400 [10.37]	40,500 [11.87]	40,500 [11.87]	40,500 [11.87]
Net Sensible Capacity Btu [kW]	26,200 [7.68]	30,600 [8.97]	30,600 [8.97]	30,600 [8.97]
Net Latent Capacity Btu [kW]	9,200 [2.7]	9,900 [2.9]	9,900 [2.9]	9,900 [2.9]
Net System Power kW	3.1	3.62	3.62	3.62
<b>Compressor</b>				
No./Type	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	78	78	78	78
<b>Outdoor Coil - Fin Type</b>				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Size in. [mm] OD	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]
Refrigerant Control	1 / 22 [9]	1.53 / 22 [9]	1.53 / 22 [9]	1.53 / 22 [9]
Drain Connection No./Size in. [mm]	Corrugated	Corrugated	Corrugated	Corrugated
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Rows / FPI [FPcm]	2 / 17 [7]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Indoor Coil - Fin Type</b>				
Tube Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3680 [1737]	3680 [1737]	3680 [1737]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>				
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
Drive Type/No. Speeds	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
No. Motors	Belt/Variable	Direct/3	Belt/Variable	Belt/Variable
Motor HP	1	1	1	1
Motor RPM	3/4	1/2	1/2	3/4
Motor Frame Size	1725	1075	1725	1725
Filter - Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	96 [2722]	125 [3544]	125 [3544]	125 [3544]
<b>Weights</b>				
Net Weight lbs. [kg]	543 [246]	570 [259]	570 [259]	570 [259]
Ship Weight lbs. [kg]	550 [249]	577 [262]	577 [262]	577 [262]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLNL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLNL- Series	A042DK	A042DL	A042DM	A042JK
<b>Cooling Performance<sup>1</sup></b>	<b>Continued -&gt;</b>			
Gross Cooling Capacity Btu [kW]	42,500 [12.45]	42,500 [12.45]	42,500 [12.45]	42,500 [12.45]
EER/SEER <sup>2</sup>	11.2/13	11.2/13	11.2/13	11.2/13
Nominal CFM/AHRI Rated CFM [L/s]	1400/1450 [661/684]	1400/1450 [661/684]	1400/1450 [661/684]	1400/1450 [661/684]
AHRI Net Cooling Capacity Btu [kW]	40,500 [11.87]	40,500 [11.87]	40,500 [11.87]	40,500 [11.87]
Net Sensible Capacity Btu [kW]	30,600 [8.97]	30,600 [8.97]	30,600 [8.97]	30,600 [8.97]
Net Latent Capacity Btu [kW]	9,900 [2.9]	9,900 [2.9]	9,900 [2.9]	9,900 [2.9]
Net System Power kW	3.62	3.62	3.62	3.62
<b>Compressor</b>				
No./Type	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	78	78	78	78
<b>Outdoor Coil - Fin Type</b>				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Size in. [mm] OD	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]
	1.53 / 22 [9]	1.53 / 22 [9]	1.53 / 22 [9]	1.53 / 22 [9]
<b>Indoor Coil - Fin Type</b>				
Tube Type	Corrugated	Corrugated	Corrugated	Corrugated
Tube Size in. [mm]	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>				
No. Used/Diameter in. [mm]	Propeller	Propeller	Propeller	Propeller
1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3680 [1737]	3680 [1737]	3680 [1737]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>				
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Direct/3	Belt/Variable	Belt/Variable	Direct/3
No. Motors	1	1	1	1
Motor HP	1/2	1/2	3/4	1/2
Motor RPM	1075	1725	1725	1075
Motor Frame Size	48	48	56	48
<b>Filter - Type</b>				
Furnished	Disposable	Disposable	Disposable	Disposable
Yes	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]
	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	125 [3544]	125 [3544]	125 [3544]	125 [3544]
<b>Weights</b>				
Net Weight lbs. [kg]	570 [259]	570 [259]	570 [259]	570 [259]
Ship Weight lbs. [kg]	577 [262]	577 [262]	577 [262]	577 [262]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLNL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLNL- Series	A048CK	A048CL	A048CM	A048DK
<b>Cooling Performance<sup>1</sup></b>	<b>Continued -&gt;</b>			
Gross Cooling Capacity Btu [kW]	50,000 [14.65]	50,000 [14.65]	50,000 [14.65]	50,000 [14.65]
EER/SEER <sup>2</sup>	11.45/13	11.45/13	11.45/13	11.45/13
Nominal CFM/AHRI Rated CFM [L/s]	1600/1600 [755/755]	1600/1600 [755/755]	1600/1600 [755/755]	1600/1600 [755/755]
AHRI Net Cooling Capacity Btu [kW]	48,000 [14.06]	48,000 [14.06]	48,000 [14.06]	48,000 [14.06]
Net Sensible Capacity Btu [kW]	35,600 [10.43]	35,600 [10.43]	35,600 [10.43]	35,600 [10.43]
Net Latent Capacity Btu [kW]	12,400 [3.63]	12,400 [3.63]	12,400 [3.63]	12,400 [3.63]
Net System Power kW	4.19	4.19	4.19	4.19
<b>Compressor</b>				
No./Type	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	78	78	78	78
<b>Outdoor Coil - Fin Type</b>				
Louvered	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
<b>Indoor Coil - Fin Type</b>				
Corrugated	Corrugated	Corrugated	Corrugated	Corrugated
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Rows / FPI [FPcm]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>				
Propeller	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3680 [1737]	3680 [1737]	3680 [1737]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>				
FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Direct/3	Belt/Variable	Belt/Variable	Direct/3
No. Motors	1	1	1	1
Motor HP	1/2	1/2	3/4	1/2
Motor RPM	1075	1725	1725	1075
<b>Motor Frame Size</b>	48	48	56	48
<b>Filter - Type</b>				
Disposable	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	165 [4678]	165 [4678]	165 [4678]	165 [4678]
<b>Weights</b>				
Net Weight lbs. [kg]	580 [263]	580 [263]	580 [263]	580 [263]
Ship Weight lbs. [kg]	587 [266]	587 [266]	587 [266]	587 [266]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLNL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLNL- Series	A048DL	A048DM	A048JK	A048YL
<b>Cooling Performance<sup>1</sup></b>	<b>Continued -&gt;</b>			
Gross Cooling Capacity Btu [kW]	50,000 [14.65]	50,000 [14.65]	50,000 [14.65]	50,000 [14.65]
EER/SEER <sup>2</sup>	11.45/13	11.45/13	11.45/13	11.45/13
Nominal CFM/AHRI Rated CFM [L/s]	1600/1600 [755/755]	1600/1600 [755/755]	1600/1600 [755/755]	1600/1600 [755/755]
AHRI Net Cooling Capacity Btu [kW]	48,000 [14.06]	48,000 [14.06]	48,000 [14.06]	48,000 [14.06]
Net Sensible Capacity Btu [kW]	35,600 [10.43]	35,600 [10.43]	35,600 [10.43]	35,600 [10.43]
Net Latent Capacity Btu [kW]	12,400 [3.63]	12,400 [3.63]	12,400 [3.63]	12,400 [3.63]
Net System Power kW	4.19	4.19	4.19	4.19
<b>Compressor</b>				
No./Type	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	78	78	78	78
<b>Outdoor Coil - Fin Type</b>				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Size in. [mm] OD	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
<b>Indoor Coil - Fin Type</b>				
Tube Type	Corrugated	Corrugated	Corrugated	Corrugated
Tube Size in. [mm]	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Refrigerant Control	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]
Drain Connection No./Size in. [mm]	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>				
No. Used/Diameter in. [mm]	Propeller	Propeller	Propeller	Propeller
Drive Type/No. Speeds	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
CFM [L/s]	Direct/1	Direct/1	Direct/1	Direct/1
No. Motors/HP	3680 [1737]	3680 [1737]	3680 [1737]	3680 [1737]
Motor RPM	1 at 1/3 HP			
	1075	1075	1075	1075
<b>Indoor Fan - Type</b>				
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
Drive Type/No. Speeds	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
No. Motors	Belt/Variable	Belt/Variable	Direct/3	Belt/Variable
Motor HP	1	1	1	1
Motor RPM	1/2	3/4	1/2	3/4
Motor Frame Size	1725	1725	1075	1725
	48	56	48	56
<b>Filter - Type</b>				
Furnished	Disposable	Disposable	Disposable	Disposable
(NO.) Size Recommended in. [mm x mm x mm]	Yes	Yes	Yes	Yes
(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]
(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	165 [4678]	165 [4678]	165 [4678]	165 [4678]
<b>Weights</b>				
Net Weight lbs. [kg]	580 [263]	580 [263]	580 [263]	580 [263]
Ship Weight lbs. [kg]	587 [266]	587 [266]	587 [266]	587 [266]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLNL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLNL- Series	A048YM	A060CK	A060CL	A060CM
<b>Cooling Performance<sup>1</sup></b>	<b>[Continued -&gt;]</b>			
Gross Cooling Capacity Btu [kW]	50,000 [14.65]	61,000 [17.87]	61,000 [17.87]	61,000 [17.87]
EER/SEER <sup>2</sup>	11.45/13	11.1/13	11.1/13	11.1/13
Nominal CFM/AHRI Rated CFM [L/s]	1600/1600 [755/755]	2000/1900 [944/897]	2000/1900 [944/897]	2000/1900 [944/897]
AHRI Net Cooling Capacity Btu [kW]	48,000 [14.06]	59,000 [17.29]	59,000 [17.29]	59,000 [17.29]
Net Sensible Capacity Btu [kW]	35,600 [10.43]	42,000 [12.31]	42,000 [12.31]	42,000 [12.31]
Net Latent Capacity Btu [kW]	12,400 [3.63]	17,000 [4.98]	17,000 [4.98]	17,000 [4.98]
Net System Power kW	4.19	5.32	5.32	5.32
<b>Compressor</b>				
No./Type	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	78	83	83	83
<b>Outdoor Coil - Fin Type</b>				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Size in. [mm] OD	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]
2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
<b>Indoor Coil - Fin Type</b>				
Tube Type	Corrugated	Corrugated	Corrugated	Corrugated
Tube Size in. [mm]	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Refrigerant Control	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]
TX Valves	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>				
No. Used/Diameter in. [mm]	Propeller	Propeller	Propeller	Propeller
1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3930 [1855]	3930 [1855]	3930 [1855]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>				
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Direct/3	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	3/4	1	3/4	1
Motor RPM	1725	1075	1725	1725
Motor Frame Size	56	48	56	56
<b>Filter - Type</b>				
Furnished	Disposable	Disposable	Disposable	Disposable
Yes	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	165 [4678]	160 [4536]	160 [4536]	160 [4536]
<b>Weights</b>				
Net Weight lbs. [kg]	580 [263]	590 [268]	590 [268]	590 [268]
Ship Weight lbs. [kg]	587 [266]	597 [271]	597 [271]	597 [271]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLNL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLNL- Series	A060DK	A060DL	A060DM	A060JK
<b>Cooling performance<sup>1</sup></b>	<b>Continued -&gt;</b>			
Gross Cooling Capacity Btu [kW]	61,000 [17.87]	61,000 [17.87]	61,000 [17.87]	61,000 [17.87]
EER, SEER <sup>2</sup>	11.1/13	11.1/13	11.1/13	11.1/13
Nominal CFM/AHRI Rated CFM [L/s]	2000/1900 [944/897]	2000/1900 [944/897]	2000/1900 [944/897]	2000/1900 [944/897]
AHRI Net Cooling Capacity Btu [kW]	59,000 [1729]	59,000 [1729]	59,000 [1729]	59,000 [1729]
Net Sensible Capacity Btu [kW]	42,000 [1231]	42,000 [1231]	42,000 [1231]	42,000 [1231]
Net Latent Capacity Btu [kW]	17,000 [4.98]	17,000 [4.98]	17,000 [4.98]	17,000 [4.98]
Net System Power kW	5.32	5.32	5.32	5.32
<b>Compressor</b>				
No/Type	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll	1/Copeland Scroll
<b>Outdoor Sound Rating (dB)<sup>3</sup></b>	83	83	83	83
<b>Outdoor Coil - Fin Type</b>				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Size in. [mm] OD	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]
	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
<b>Indoor Coil - Fin Type</b>				
Tube Type	Corrugated	Corrugated	Corrugated	Corrugated
Tube Size in. [mm]	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Refrigerant Control	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]
Drain Connection No./Size in. [mm]	TX Valves	TX Valves	TX Valves	TX Valves
	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>				
No. Used/Diameter in. [mm]	Propeller	Propeller	Propeller	Propeller
Drive Type/No. Speeds	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
CFM [L/s]	Direct/1	Direct/1	Direct/1	Direct/1
No. Motors/HP	3930 [1855]	3930 [1855]	3930 [1855]	3930 [1855]
Motor RPM	1 at 1/3 HP			
	1075	1075	1075	1075
<b>Indoor Fan - Type</b>				
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
Drive Type/No. Speeds	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
No. Motors	Direct/3	Belt/Variable	Belt/Variable	Direct/3
Motor HP	1	1	1	1
Motor RPM	1075	1725	1725	1075
Motor Frame Size	48	56	56	48
<b>Filter - Type</b>				
Furnished	Disposable	Disposable	Disposable	Disposable
(NO.) Size Recommended in. [mm x mm x mm]	Yes	Yes	Yes	Yes
	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]
	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	160 [4536]	160 [4536]	160 [4536]	160 [4536]
<b>Weights</b>				
Net Weight lbs. [kg]	590 [268]	590 [268]	590 [268]	590 [268]
Ship Weight lbs. [kg]	597 [271]	597 [271]	597 [271]	597 [271]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLNL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLNL- Series	A060YL	A060YM
<b>Cooling performance<sup>1</sup></b>		
Gross Cooling Capacity Btu [kW]	61,000 [17.87]	61,000 [17.87]
EER, SEER <sup>2</sup>	11.1/13	11.1/13
Nominal CFM/AHRI Rated CFM [L/s]	2000/1900 [944/897]	2000/1900 [944/897]
AHRI Net Cooling Capacity Btu [kW]	59,000 [1729]	59,000 [1729]
Net Sensible Capacity Btu [kW]	42,000 [1231]	42,000 [1231]
Net Latent Capacity Btu [kW]	17,000 [4.98]	17,000 [4.98]
Net System Power kW	5.32	5.32
<b>Compressor</b>		
No/Type	1/Copeland Scroll	1/Copeland Scroll
<b>Outdoor Sound Rating (dB)<sup>3</sup></b>		
Outdoor Coil - Fin Type	Louvered	Louvered
Tube Type	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.56 [1.54]	16.56 [1.54]
Rows / FPI [FPCm]	2 / 22 [9]	2 / 22 [9]
<b>Indoor Coil - Fin Type</b>		
Tube Type	Corrugated	Corrugated
Tube Size in. [mm]	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPCm]	5.17 [0.48]	5.17 [0.48]
Refrigerant Control	3 / 15 [6]	3 / 15 [6]
Drain Connection No./Size in. [mm]	TX Valves	TX Valves
	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>		
No. Used/Diameter in. [mm]	Propeller	Propeller
Drive Type/No. Speeds	1/24 [609.6]	1/24 [609.6]
CFM [L/s]	Direct/1	Direct/1
No. Motors/HP	3930 [1855]	3930 [1855]
Motor RPM	1 at 1/3 HP	1 at 1/3 HP
	1075	1075
<b>Indoor Fan - Type</b>		
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal
Drive Type/No. Speeds	1/10x10 [254x254]	1/10x10 [254x254]
No. Motors	Belt/Variable	Belt/Variable
Motor HP	1	1
Motor RPM	3/4	1
Motor Frame Size	1725	1725
	56	56
<b>Filter - Type</b>		
Furnished	Disposable	Disposable
(NO.) Size Recommended in. [mm x mm x mm]	Yes	Yes
	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]
	(1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>		
	160 [4536]	160 [4536]
<b>Weights</b>		
Net Weight lbs. [kg]	590 [268]	590 [268]
Ship Weight lbs. [kg]	597 [271]	597 [271]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLPL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLPL- Series	A036CK	A036CL	A036CM	A036DK
<b>Cooling Performance<sup>1</sup></b>	<b>Continued -&gt;</b>			
Gross Cooling Capacity Btu [kW]	36,600 [10.72]	36,600 [10.72]	36,600 [10.72]	36,600 [10.72]
EER/SEER <sup>2</sup>	12.05/14	12.05/14	12.05/14	12.05/14
Nominal CFM/AHRI Rated CFM [L/s]	1200/1200 [566/566]	1200/1200 [566/566]	1200/1200 [566/566]	1200/1200 [566/566]
AHRI Net Cooling Capacity Btu [kW]	35,800 [10.49]	35,800 [10.49]	35,800 [10.49]	35,800 [10.49]
Net Sensible Capacity Btu [kW]	27,000 [7.91]	27,000 [7.91]	27,000 [7.91]	27,000 [7.91]
Net Latent Capacity Btu [kW]	8,800 [2.58]	8,800 [2.58]	8,800 [2.58]	8,800 [2.58]
Net System Power kW	2.97	2.97	2.97	2.97
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	78	78	78	78
<b>Outdoor Coil - Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]
Rows / FPI [FPcm]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]
<b>Indoor Coil - Fin Type</b>	Corrugated	Corrugated	Corrugated	Corrugated
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Rows / FPI [FPcm]	2 / 17 [7]	2 / 17 [7]	2 / 17 [7]	2 / 17 [7]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3680 [1737]	3680 [1737]	3680 [1737]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Direct/4	Belt/Variable	Belt/Variable	Direct/4
No. Motors	1	1	1	1
Motor HP	1/2	1/2	3/4	1/2
Motor RPM	1075	1725	1725	1075
Motor Frame Size	48	48	56	48
<b>Filter - Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	96 [2722]	96 [2722]	96 [2722]	96 [2722]
<b>Weights</b>				
Net Weight lbs. [kg]	543 [246]	543 [246]	543 [246]	543 [246]
Ship Weight lbs. [kg]	550 [249]	550 [249]	550 [249]	550 [249]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLPL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLPL- Series	A036DL	A036DM	A036JK	A042CK
<b>Cooling Performance<sup>1</sup></b>	<b>Continued -&gt;</b>			
Gross Cooling Capacity Btu [kW]	36,600 [10.72]	36,600 [10.72]	36,600 [10.72]	43,000 [12.6]
EER/SEER <sup>2</sup>	12.05/14	12.05/14	12.05/14	12/14
Nominal CFM/AHRI Rated CFM [L/s]	1200/1200 [566/566]	1200/1200 [566/566]	1200/1200 [566/566]	1400/1450 [661/684]
AHRI Net Cooling Capacity Btu [kW]	35,800 [10.49]	35,800 [10.49]	35,800 [10.49]	41,500 [12.16]
Net Sensible Capacity Btu [kW]	27,000 [7.91]	27,000 [7.91]	27,000 [7.91]	31,200 [9.14]
Net Latent Capacity Btu [kW]	8,800 [2.58]	8,800 [2.58]	8,800 [2.58]	10,300 [3.02]
Net System Power kW	2.97	2.97	2.97	3.5
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>3</sup></b>	78	78	78	78
<b>Outdoor Coil - Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]
Rows / FPI [FPIcm]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1.53 / 22 [9]
<b>Indoor Coil - Fin Type</b>	Corrugated	Corrugated	Corrugated	Corrugated
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Rows / FPI [FPIcm]	2 / 17 [7]	2 / 17 [7]	2 / 17 [7]	3 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3680 [1737]	3680 [1737]	3680 [1737]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Direct/4	Direct/4
No. Motors	1	1	1	1
Motor HP	1/2	3/4	1/2	3/4
Motor RPM	1725	1725	1075	1075
Motor Frame Size	48	56	48	48
<b>Filter - Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	96 [2722]	96 [2722]	96 [2722]	125 [3544]
<b>Weights</b>				
Net Weight lbs. [kg]	543 [246]	543 [246]	543 [246]	570 [259]
Ship Weight lbs. [kg]	550 [249]	550 [249]	550 [249]	577 [262]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLPL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLPL- Series	A042CL	A042CM	A042DK	A042DL
<b>Cooling Performance<sup>1</sup></b>				Continued ->
Gross Cooling Capacity Btu [kW]	43,000 [12.6]	43,000 [12.6]	43,000 [12.6]	43,000 [12.6]
EER/SEER <sup>2</sup>	12/14	12/14	12/14	12/14
Nominal CFM/AHRI Rated CFM [L/s]	1400/1450 [661/684]	1400/1450 [661/684]	1400/1450 [661/684]	1400/1450 [661/684]
AHRI Net Cooling Capacity Btu [kW]	41,500 [12.16]	41,500 [12.16]	41,500 [12.16]	41,500 [12.16]
Net Sensible Capacity Btu [kW]	31,200 [9.14]	31,200 [9.14]	31,200 [9.14]	31,200 [9.14]
Net Latent Capacity Btu [kW]	10,300 [3.02]	10,300 [3.02]	10,300 [3.02]	10,300 [3.02]
Net System Power kW	3.5	3.5	3.5	3.5
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	78	78	78	78
<b>Outdoor Coil - Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]	16.91 [1.57]
Rows / FPI [FPcm]	1.53 / 22 [9]	1.53 / 22 [9]	1.53 / 22 [9]	1.53 / 22 [9]
<b>Indoor Coil - Fin Type</b>	Corrugated	Corrugated	Corrugated	Corrugated
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Rows / FPI [FPcm]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3680 [1737]	3680 [1737]	3680 [1737]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Direct/4	Belt/Variable
No. Motors	1	1	1	1
Motor HP	1/2	3/4	3/4	1/2
Motor RPM	1725	1725	1075	1725
Motor Frame Size	48	56	48	48
<b>Filter - Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	125 [3544]	125 [3544]	125 [3544]	125 [3544]
<b>Weights</b>				
Net Weight lbs. [kg]	570 [259]	570 [259]	570 [259]	570 [259]
Ship Weight lbs. [kg]	577 [262]	577 [262]	577 [262]	577 [262]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLPL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLPL- Series	A042DM	A042JK	A048CK	A048CL
<b>Cooling Performance<sup>1</sup></b>	<b>Continued -&gt;</b>			
Gross Cooling Capacity Btu [kW]	43,000 [12.6]	43,000 [12.6]	50,500 [14.8]	50,500 [14.8]
EER/SEER <sup>2</sup>	12/14	12/14	12.15/14	12.15/14
Nominal CFM/AHRI Rated CFM [L/s]	1400/1450 [661/684]	1400/1450 [661/684]	1600/1600 [755/755]	1600/1600 [755/755]
AHRI Net Cooling Capacity Btu [kW]	41,500 [12.16]	41,500 [12.16]	49,000 [14.36]	49,000 [14.36]
Net Sensible Capacity Btu [kW]	31,200 [9.14]	31,200 [9.14]	36,400 [10.67]	36,400 [10.67]
Net Latent Capacity Btu [kW]	10,300 [3.02]	10,300 [3.02]	12,600 [3.69]	12,600 [3.69]
Net System Power kW	3.5	3.5	4.03	4.03
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	78	78	78	78
<b>Outdoor Coil - Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.91 [1.57]	16.91 [1.57]	16.56 [1.54]	16.56 [1.54]
Rows / FPI [FPIcm]	1.53 / 22 [9]	1.53 / 22 [9]	2 / 22 [9]	2 / 22 [9]
<b>Indoor Coil - Fin Type</b>	Corrugated	Corrugated	Corrugated	Corrugated
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Rows / FPI [FPIcm]	3 / 13 [5]	3 / 13 [5]	3 / 15 [6]	3 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3680 [1737]	3680 [1737]	3680 [1737]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Direct/4	Direct/4	Belt/Variable
No. Motors	1	1	1	1
Motor HP	3/4	3/4	3/4	1/2
Motor RPM	1725	1075	1075	1725
Motor Frame Size	56	48	48	48
<b>Filter - Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	125 [3544]	125 [3544]	165 [4678]	165 [4678]
<b>Weights</b>				
Net Weight lbs. [kg]	570 [259]	570 [259]	580 [263]	580 [263]
Ship Weight lbs. [kg]	577 [262]	577 [262]	587 [266]	587 [266]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLPL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLPL- Series	A048CM	A048DK	A048DL	A048DM
<b>Cooling Performance<sup>1</sup></b>	<b>Continued -&gt;</b>			
Gross Cooling Capacity Btu [kW]	50,500 [14.8]	50,500 [14.8]	50,500 [14.8]	50,500 [14.8]
EER/SEER <sup>2</sup>	12.15/14	12.15/14	12.15/14	12.15/14
Nominal CFM/AHRI Rated CFM [L/s]	1600/1600 [755/755]	1600/1600 [755/755]	1600/1600 [755/755]	1600/1600 [755/755]
AHRI Net Cooling Capacity Btu [kW]	49,000 [14.36]	49,000 [14.36]	49,000 [14.36]	49,000 [14.36]
Net Sensible Capacity Btu [kW]	36,400 [10.67]	36,400 [10.67]	36,400 [10.67]	36,400 [10.67]
Net Latent Capacity Btu [kW]	12,600 [3.69]	12,600 [3.69]	12,600 [3.69]	12,600 [3.69]
Net System Power kW	4.03	4.03	4.03	4.03
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	78	78	78	78
<b>Outdoor Coil - Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
<b>Indoor Coil - Fin Type</b>	Corrugated	Corrugated	Corrugated	Corrugated
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Rows / FPI [FPcm]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3680 [1737]	3680 [1737]	3680 [1737]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Direct/4	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	3/4	3/4	1/2	3/4
Motor RPM	1725	1075	1725	1725
Motor Frame Size	56	48	48	56
<b>Filter - Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	165 [4678]	165 [4678]	165 [4678]	165 [4678]
<b>Weights</b>				
Net Weight lbs. [kg]	580 [263]	580 [263]	580 [263]	580 [263]
Ship Weight lbs. [kg]	587 [266]	587 [266]	587 [266]	587 [266]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLPL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLPL- Series	A048JK	A060CK	A060CL	A060CM
<b>Cooling Performance<sup>1</sup></b>				Continued ->
Gross Cooling Capacity Btu [kW]	50,500 [14.8]	61,500 [18.02]	61,500 [18.02]	61,500 [18.02]
EER/SEER <sup>2</sup>	12.15/14	12.25/14	12.25/14	12.25/14
Nominal CFM/AHRI Rated CFM [L/s]	1600/1600 [755/755]	2000/1850 [944/873]	2000/1850 [944/873]	2000/1850 [944/873]
AHRI Net Cooling Capacity Btu [kW]	49,000 [14.36]	60,000 [17.58]	60,000 [17.58]	60,000 [17.58]
Net Sensible Capacity Btu [kW]	36,400 [10.67]	42,500 [12.45]	42,500 [12.45]	42,500 [12.45]
Net Latent Capacity Btu [kW]	12,600 [3.69]	17,500 [5.13]	17,500 [5.13]	17,500 [5.13]
Net System Power kW	4.03	4.9	4.9	4.9
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>3</sup></b>	78	83	83	83
<b>Outdoor Coil - Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]
Rows / FPI [FPIcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
<b>Indoor Coil - Fin Type</b>	Corrugated	Corrugated	Corrugated	Corrugated
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Rows / FPI [FPIcm]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3680 [1737]	3930 [1855]	3930 [1855]	3930 [1855]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/11x10 [279x254]	1/11x10 [279x254]
Drive Type/No. Speeds	Direct/4	Direct/3	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	3/4	1	3/4	1
Motor RPM	1075	1075	1725	1725
Motor Frame Size	48	48	56	56
<b>Filter - Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	165 [4678]	147 [4167]	147 [4167]	147 [4167]
<b>Weights</b>				
Net Weight lbs. [kg]	580 [263]	590 [268]	590 [268]	590 [268]
Ship Weight lbs. [kg]	587 [266]	597 [271]	597 [271]	597 [271]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

# GENERAL DATA - RLPL MODELS

## NOMINAL SIZES 3-5 TONS [10.6-17.6 kW]

Model RLPL- Series	A060DK	A060DL	A060DM	A060JK
<b>Cooling Performance<sup>1</sup></b>				Continued ->
Gross Cooling Capacity Btu [kW]	61,500 [18.02]	61,500 [18.02]	61,500 [18.02]	61,500 [18.02]
EER/SEER <sup>2</sup>	12.25/14	12.25/14	12.25/14	12.25/14
Nominal CFM/AHRI Rated CFM [L/s]	2000/1850 [944/873]	2000/1850 [944/873]	2000/1850 [944/873]	2000/1850 [944/873]
AHRI Net Cooling Capacity Btu [kW]	60,000 [17.58]	60,000 [17.58]	60,000 [17.58]	60,000 [17.58]
Net Sensible Capacity Btu [kW]	42,500 [12.45]	42,500 [12.45]	42,500 [12.45]	42,500 [12.45]
Net Latent Capacity Btu [kW]	17,500 [5.13]	17,500 [5.13]	17,500 [5.13]	17,500 [5.13]
Net System Power kW	4.9	4.9	4.9	4.9
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	83	83	83	83
<b>Outdoor Coil - Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
<b>Indoor Coil - Fin Type</b>	Corrugated	Corrugated	Corrugated	Corrugated
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]	5.17 [0.48]
Rows / FPI [FPcm]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
<b>Outdoor Fan - Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	3930 [1855]	3930 [1855]	3930 [1855]	3930 [1855]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan - Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/11x10 [279x254]	1/11x10 [279x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Direct/3	Belt/Variable	Belt/Variable	Direct/3
No. Motors	1	1	1	1
Motor HP	1	3/4	1	1
Motor RPM	1075	1725	1725	1075
Motor Frame Size	48	56	56	48
<b>Filter - Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]	(1)1x16x25 [25x406x635] (1)1x16x25 [25x406x635]
<b>Refrigerant Charge Oz. [g]</b>	147 [4167]	147 [4167]	147 [4167]	147 [4167]
<b>Weights</b>				
Net Weight lbs. [kg]	590 [268]	590 [268]	590 [268]	590 [268]
Ship Weight lbs. [kg]	597 [271]	597 [271]	597 [271]	597 [271]

### NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

## XIX. MISCELLANEOUS

ELECTRICAL DATA - RLNL SERIES										
		-A036CK	-A036CL	-A036CM	-A036DK	-A036DL	-A036DM	-A036JK	-A036YL	-A036YM
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	414-506	187-253	517-633	517-633
	Minimum Circuit Ammpacity	19/19	18/18	18/18	11	10	10	27/27	7	7
	Minimum Overcurrent Protection Device Size	25/25	20/20	25/25	15	15	15	35/35	15	15
	Maximum Overcurrent Protection Device Size	25/25	25/25	25/25	15	15	15	40/40	15	15
Compressor Motor	No.	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	575	575
	Phase	3	3	3	3	3	3	1	3	3
	HP	3	3	3	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450
	Amps (RLA)	10.4/10.4	10.4/10.4	10.4/10.4	5.8	5.8	5.8	16.7/16.7	3.8	3.8
	Amps (LRA)	88/88	88/88	88/88	38	38	38	79/79	36.5	36.5
Condenser Motor	No.	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	575	575
	Phase	1	1	1	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA)	1.5	1.5	1.5	1	1	1	1.5	0.8	0.8
	Amps (LRA)	3	3	3	1.9	1.9	1.9	3	1.9	1.9
Evaporator Fan	No.	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	575	575
	Phase	1	3	3	1	3	3	1	3	3
	HP	1/2	1/2	3/4	1/2	1/2	3/4	1/2	3/4	3/4
	Amps (FLA)	4	2.8	3.4	2	1.4	1.6	4	1.3	1.3
	Amps (LRA)	6.7	11.3	16.8	3.6	6.2	8.4	6.7	6	6

ELECTRICAL DATA - RLNL SERIES								
		-A042CK	-A042CL	-A042CM	-A042DK	-A042DL	-A042DM	-A042JK
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	414-506	187-253
	Minimum Circuit Ammpacity	23/23	22/22	22/22	11	10	11	28/28
	Minimum Overcurrent Protection Device Size	30/30	25/25	30/30	15	15	15	35/35
	Maximum Overcurrent Protection Device Size	35/35	30/30	35/35	15	15	15	45/45
Compressor Motor	No.	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230
	Phase	3	3	3	3	3	3	1
	HP	3 1/2	3 1/2	3 1/2	3 1/2	3 1/2	3 1/2	3 1/2
	RPM	3450	3450	3450	3450	3450	3450	3450
	Amps (RLA)	13.5/13.5	13.5/13.5	13.5/13.5	6	6	6	17.9/17.9
	Amps (LRA)	88/88	88/88	88/88	44	44	44	112/112
Condenser Motor	No.	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230
	Phase	1	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA)	1.5	1.5	1.5	1	1	1	1.5
	Amps (LRA)	3	3	3	1.9	1.9	1.9	3
Evaporator Fan	No.	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230
	Phase	1	3	3	1	3	3	1
	HP	1/2	1/2	3/4	1/2	1/2	3/4	1/2
	Amps (FLA)	4	2.8	3.4	2	1.4	1.6	4
	Amps (LRA)	6.7	11.3	16.8	3.6	6.2	8.4	6.7

ELECTRICAL DATA - RLNL SERIES										
		-A048CK	-A048CL	-A048CM	-A048DK	-A048DL	-A048DM	-A048JK	-A048YL	-A048YM
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	414-506	187-253	517-633	517-633
	Minimum Circuit Ammpacity	23/23	22/22	23/23	11	11	11	33/33	9	9
	Minimum Overcurrent Protection Device Size	30/30	25/25	30/30	15	15	15	40/40	15	15
	Maximum Overcurrent Protection Device Size	35/35	35/35	35/35	15	15	15	50/50	15	15
Compressor Motor	No.	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	575	575
	Phase	3	3	3	3	3	3	1	3	3
	HP	4	4	4	4	4	4	4	4	4
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450
	Amps (RLA)	13.7/13.7	13.7/13.7	13.7/13.7	6.2	6.2	6.2	21.8/21.8	4.8	4.8
	Amps (LRA)	83.1/83.1	83.1/83.1	83.1/83.1	41	41	41	117/117	33	33
Condenser Motor	No.	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	575	575
	Phase	1	1	1	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA)	1.5	1.5	1.5	1	1	1	1.5	0.8	0.8
	Amps (LRA)	3	3	3	1.9	1.9	1.9	3	1.9	1.9
Evaporator Fan	No.	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	575	575
	Phase	1	3	3	1	3	3	1	3	3
	HP	1/2	1/2	3/4	1/2	1/2	3/4	1/2	3/4	3/4
	Amps (FLA)	4	2.8	3.4	2	1.4	1.6	4	1.3	1.3
	Amps (LRA)	6.7	11.3	16.8	3.6	6.2	8.4	6.7	6	6

ELECTRICAL DATA – RLNL SERIES										
	-A060CK	-A060CL	-A060CM	-A060DK	-A060DL	-A060DM	A060JK	-A060YL	-A060YM	
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	414-506	187-253	517-633	517-633
	Minimum Circuit Ampacity	30/30	26/26	26/26	15	13	13	43/43	10	10
	Minimum Overcurrent Protection Device Size	35/35	30/30	30/30	20	15	15	50/50	15	15
	Maximum Overcurrent Protection Device Size	40/40	40/40	40/40	20	20	20	60/60	15	15
Compressor Motor	No.	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	575	575
	Phase	3	3	3	3	3	3	1	3	3
	HP	5	5	5	5	5	5	5	5	5
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450
	Amps (RLA)	15.6/15.6	15.6/15.6	15.6/15.6	7.8	7.8	7.8	26.3/26.3	5.8	5.8
	Amps (LRA)	110/110	110/110	110/110	52	52	52	134/134	38.9	38.9
Condenser Motor	No.	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	575	575
	Phase	1	1	1	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA)	2.2	2.2	2.2	1	1	1	2.2	0.8	0.8
	Amps (LRA)	4.9	4.9	4.9	1.9	1.9	1.9	4.9	1.9	1.9
Evaporator Fan	No.	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	575	575
	Phase	1	3	3	1	3	3	1	3	3
	HP	1	3/4	1	1	3/4	1	1	3/4	1
	Amps (FLA)	7.6	3.4	3.8	4	1.6	1.9	7.6	1.3	1.4
	Amps (LRA)	0	16.8	24	0	8.4	12	0	6	7.2

**ELECTRICAL DATA – RLPL SERIES**

	-A036CK	-A036CL	-A036CM	-A036DK	-A036DL	-A036DM	-A036JK	-A042CK	-A042CL	-A042CM	-A042DK	-A042DL	-A042DM	-A042JK
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	414-506	187-253	187-253	187-253	414-506	414-506	414-506	187-253
	Minimum Circuit Ampacity	19/19	18/18	18/18	11	10	10	27/27	25/25	22/22	22/22	12	10	11
	Minimum Overcurrent Protection Device Size	25/25	20/209	25/25	15	15	15	35/35	30/30	25/25	30/30	15	15	15/35
	Maximum Overcurrent Protection Device Size	25/25	25/25	25/25	15	15	15	40/40	35/35	30.30	35/35	15	15	45/45
Compressor Motor	No.	1	1	1	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	208/230	208/230	208/230	460	460	208/230
	Phase	3	3	3	3	3	3	1	3	3	3	3	3	1
	HP	3	3	3	3	3	3	3	3 1/2	3 1/2	3 1/2	3 1/2	3 1/2	3 1/2
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450
	Amps (RLA)	10.4/10.4	10.4/10.4	10.4/10.4	5.8	5.8	5.8	16.7/16.7	13.5/13.5	13.5/13.5	13.5/13.5	6	6	6
Condenser Motor	Amps (LRA)	88/88	88/88	88/88	38	38	38	79/79	88/88	88/88	88/88	44	44	44
	No.	1	1	1	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	208/230	208/230	208/230	460	460	208/230
	Phase	1	1	1	1	1	1	1	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA)	1.5	1.5	1.5	1	1	1	1.5	1.5	1.5	1.5	1	1	1.5
Evaporator Fan	Amps (LRA)	3	3	3	1.9	1.9	1.9	3	3	3	3	1.9	1.9	3
	No.	1	1	1	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	208/230	208/230	208/230	460	460	208/230
	Phase	1	3	3	1	3	3	1	1	3	3	1	3	1
	HP	1/2	1/2	3/4	1/2	1/2	3/4	1/2	3/4	1/2	3/4	3/4	1/2	3/4
	Amps (FLA)	4.1	2.8	3.4	2.1	1.4	1.6	4.1	6	2.8	3.4	3.2	1.4	1.6
	Amps (LRA)	0	11.3	16.8	0	6.2	8.4	0	0	11.3	16.8	0	6.2	8.4
														0

ELECTRICAL DATA – RLPL SERIES														
	-A048CK	-A048CL	-A048CM	-A048DK	-A408DL	-A048DM	-A048JK	-A060CK	-A060CL	-A060CM	-A060DK	-A060DL	-A060DM	-A060JK
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	187-253	187-253	187-253	187-253	414-506	414-506	414-506	187-253
	Minimum Circuit Ampacity	25/25	22/22	23/23	12	11	11	35/35	30/30	26/26	26/26	15	13	13
	Minimum Overcurrent Protection Device Size	30/30	25/25	30/30	15	15	15	45/45	35/35	30/30	35/35	20	15	15
	Maximum Overcurrent Protection Device Size	35/35	35/35	35/35	15	15	15	50/50	45/45	40/40	40/40	20	20	20
Compressor Motor	No.	1	1	1	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	208/230	208/230	208/230	460	460	208/230
	Phase	3	3	3	3	3	3	1	3	3	3	3	3	1
	HP	4	4	4	4	4	4	4	5	5	5	5	5	5
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450
	Amps (RLA)	13.7/13.7	13.7/13.7	13.7/13.7	6.2	6.2	6.2	21.8/21.8	16.16	16/16	16/16	7.8	7.8	7.8
Condenser Motor	Amps (LRA)	83.1/83.1	83.1/83.1	83.1/83.1	41	41	41	117/117	110/110	110/110	110/110	52	52	134/134
	No.	1	1	1	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	208/230	208/230	208/230	460	460	408/230
	Phase	1	1	1	1	1	1	1	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA)	1.5	1.5	1.5	1	1	1	1.5	2.2	2.2	2.2	1	1	2.2
Evaporator Fan	Amps (LRA)	3	3	3	1.9	1.9	1.9	3	4.9	4.9	4.9	1.9	1.9	4.9
	No.	1	1	1	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	208/230	208/230	208/230	208/230	460	460	208/230
	Phase	1	3	3	1	3	3	1	1	3	3	1	3	1
	HP	3/4	1/2	3/4	3/4	1/2	3/4	3/4	1	3/4	1	3/4	1	1
	Amps (FLA)	6	2.8	3.4	3.2	1.4	1.6	6	7.6	3.4	3.8	4	1.6	1.9
	Amps (LRA)	0	11.3	16.8	0	6.2	8.4	0	0	16.8	24	0	8.4	12

# INDOOR AIRFLOW PERFORMANCE FOR 3-5 TON SELF-CONTAINED AIR CONDITIONERS-RLNL DIRECT DRIVE

## DIRECT-DRIVE BLOWER 208 AIRFLOW PERFORMANCE

Unit Model	Motor Speed From Factory	Heating Input BTU/hr [kW]	Manufacturer Recommended Air-Flow Range (Min / Max) CFM	Blower Size/ Motor HP # of Speeds	Motor Speed	CFM Air Delivery/RPM/Watts-208 VOLTS								
						Cool	Heat	Low	CFM	Watts	0.10	0.20	0.30	
RLNL-A036	Low	1050 / 1350	10x10 1/2 3 Speed	CFM Watts	1210 1193 1155 1125 1075 1015	CFM	1210	1193	1155	1125	1075	1015	925	
						Watts	450	400	395	385	380	375	370	360
						CFM	1515	1500	1475	1450	1405	1350	1275	1180
						Watts	525	515	510	505	490	475	460	445
						CFM	1680	1650	1625	1580	1530	1460	1390	1280
						Watts	650	640	630	610	580	560	545	515
RLNL-A042	Med	1225 / 1575	10x10 1/2 3 Speed	CFM Watts	1210 1193 1155 1125 1075 1015	CFM	1210	1193	1175	1155	1125	1075	1015	
						Watts	450	400	395	385	380	375	370	360
						CFM	1515	1500	1475	1450	1405	1350	1275	1180
						Watts	525	515	510	505	490	475	460	445
						CFM	1680	1650	1625	1580	1530	1460	1390	1280
						Watts	650	640	630	610	580	560	545	515
RLNL-A048	Med	1400 / 1800	10x10 1/2 3 Speed	CFM Watts	1210 1193 1155 1125 1075 1015	CFM	1210	1193	1175	1155	1125	1075	1015	
						Watts	450	400	395	385	380	375	370	360
						CFM	1515	1500	1475	1450	1405	1350	1275	1180
						Watts	525	515	510	505	490	475	460	445
						CFM	1680	1650	1625	1580	1530	1460	1390	1280
						Watts	650	640	630	610	580	560	545	515
RLNL-A060	Med	1750 / 2250	10x10 1/2 3 Speed (X-13)	CFM Watts	1210 1193 1155 1125 1075 1015	CFM	1210	1193	1175	1155	1125	1075	1015	
						Watts	450	400	395	385	380	375	370	360
						CFM	1515	1500	1475	1450	1405	1350	1275	1180
						Watts	525	515	510	505	490	475	460	445
						CFM	1680	1650	1625	1580	1530	1460	1390	1280
						Watts	650	640	630	610	580	560	545	515

# INDOOR AIRFLOW PERFORMANCE FOR 3-5 TON SELF-CONTAINED AIR CONDITIONERS–RLNL DIRECT DRIVE

## DIRECT-T-DRIVE 230/460 AIRFLOW PERFORMANCE

Unit Model	Motor Speed From Factory		Manufacturer Recommended Air-Flow Range (Min / Max) CFM	Blower Size/ Motor HP # of Speeds	Motor Speed	CFM Air Delivery/RPM/Watts-230/460 VOLTS						External Static Pressure-Inches W.C.		
	Cool	Heat				CFM	Watts	CFM	Watts	CFM	Watts			
RLNL-A036	Low	Low	1050 / 1350	10x10 1/2 3 Speed	Low	CFM	1400	1375	1360	1335	1305	0.50		
					Med	Watts	470	460	455	450	440	0.60		
					High	CFM	1685	1620	1580	1550	1500	0.70		
	[6] [10] [12] [20]	[6] [10] [12] [20]			Watts	635	600	580	570	550	535	0.80		
					Low	CFM	1870	1830	1790	1730	1660	1210		
					Med	Watts	780	760	740	700	660	1100		
RLNL-A042	Med	Med	1225 / 1575	10x10 1/2 3 Speed	Low	CFM	1400	1375	1360	1335	1305	410		
					Med	Watts	470	460	455	450	440	425		
					High	CFM	1685	1620	1580	1550	1500	400		
	[6] [10] [12] [15] [20]	[6] [10] [12] [15] [20]			Watts	635	600	580	570	550	535	410		
					Low	CFM	1870	1830	1790	1730	1660	1230		
					Med	Watts	780	760	740	700	660	1100		
RLNL-A048	Med	Med	1400 / 1800	10x10 1/2 3 Speed	Low	CFM	1400	1375	1360	1335	1305	425		
					Med	Watts	470	460	455	450	440	410		
					High	CFM	1685	1620	1580	1550	1500	430		
	[6] [10] [12] [15] [20]	[6] [10] [12] [15] [20]			Watts	635	600	580	570	550	535	425		
					Low	CFM	1870	1830	1790	1730	1660	1230		
					Med	Watts	780	760	740	700	660	1100		
RLNL-A060	Med	Med	1750 / 2250	10x10 1 3 Speed (X-13)	Low	CFM	1985	1954	1919	1876	1824	555		
					Med	Watts	535	553	574	593	606	599		
					High	CFM	2431	2372	2306	2228	2138	572		
					Watts	970	981	964	926	872	806	665		

# INDOOR AIRFLOW PERFORMANCE FOR 3-5 TON SELF-CONTAINED AIR CONDITIONERS-RLPL DIRECT DRIVE

Unit Model Cooling Capacity Tons [kW]	Motor Speed From Factory Cool Heat	Heating Input BTU/hr [kW]	Manufacturer Recommended Air-Flow Range (Min / Max) CFM	Blower Size/ Motor HP # of Speeds	Motor Speed	CFM Air Delivery/RPM/Watts-230/460 Volts								
						External Static Pressure-Inches W.C.								
						0.10	0.20	0.30	0.40	0.50	0.60			
RLPL-A036 3.0 [10.55]	Low (Tap 2)	[10] [12] [15] [20]	1050 / 1350	10x10 1/2 HP [249 W] 3 Speed (X-13 Motor)	Low (Tap 2)	CFM RPM Watts	1381 675 200	1339 717 214	1291 766 225	1236 808 233	1193 855 248	1144 903 262	1079 961 1016	1004
					Med (Tap 3)	CFM RPM Watts	1479 706 242	1432 751 254	1385 795 266	1346 835 282	1304 874 291	1256 919 306	1201 970 319	1137 1024 336
					High (Tap 4)	CFM RPM Watts	1669 788 356	1626 827 370	1585 868 385	1544 908 401	1500 941 411	1460 978 426	1418 1015 438	1376 1052 442
					Low (Tap 1)	CFM RPM Watts	1444 681 208	1396 731 223	1347 780 237	1306 827 253	1265 873 268	1225 920 281	1185 966 293	1108 1038 317
					Med (Tap 2)	CFM RPM Watts	1643 768 304	1605 805 319	1567 842 333	1523 887 350	1479 932 366	1441 971 381	1403 1009 395	1365 1048 410
	Med (Tap 2)	[10] [12] [15] [20]	1225 / 1575	10x10 3/4 HP [559 W] 4 Speed (X-13 Motor)	Med (Tap 3)	CFM RPM Watts	1643 768 304	1605 805 319	1567 842 333	1523 887 350	1479 932 366	1441 971 381	1403 1009 395	1365 1048 410
					High (Tap 4)	CFM RPM Watts	1875 842 435	1837 880 452	1799 918 468	1755 955 487	1711 991 505	1673 1025 519	1635 1025 532	1597 1058 546
					Low (Tap 1)	CFM RPM Watts	1457 710 229	1410 763 241	1363 816 252	1322 858 267	1280 900 282	1235 951 299	1190 1002 315	1106 1061 330
					Med (Tap 2)	CFM RPM Watts	1717 817 360	1676 854 374	1635 890 387	1596 931 402	1556 971 417	1514 1012 433	1471 1052 449	1425 1092 461
					High (Tap 3)	CFM RPM Watts	1875 877 360	1837 911 374	1799 944 387	1757 979 402	1714 1014 417	1674 1053 433	1633 1091 449	1548 1113 461
RLPL-A048 4.0 [14.07]	Med (Tap 2)	[10] [12] [15] [20]	1400 / 1800	10x10 3/4 HP [559 W] 4 Speed (X-13 Motor)	Low (Tap 1)	CFM RPM Watts	1717 817 360	1676 854 374	1635 890 387	1596 931 402	1556 971 417	1514 1012 433	1471 1052 449	1425 1092 461
					Med (Tap 2)	CFM RPM Watts	1875 877 360	1837 911 374	1799 944 387	1757 979 402	1714 1014 417	1674 1053 433	1633 1091 449	1548 1113 461
					High (Tap 4)	CFM RPM Watts	1875 877 458	1837 911 473	1799 944 488	1757 979 503	1714 1014 517	1674 1053 534	1633 1091 550	1548 1113 535
					Low (Tap 1)	CFM RPM Watts	1575 741 297	1536 783 314	1496 824 330	1457 866 347	1417 907 364	1377 949 381	1338 990 397	1298 1032 414
					Med (Tap 2)	CFM RPM Watts	1985 902 535	1954 942 574	1919 979 593	1876 1013 606	1824 1040 609	1759 1071 599	1679 1096 572	1581 1119 557
RLPL-A060 5.0 [17.59]	Med (Tap 2)	[10] [12] [15] [20]	1750 / 2250	10x10 1 HP [746 W] 3 Speed (X-13 Motor)	High (Tap 3)	CFM RPM Watts	2431 1076 970	2372 1089 981	2306 1102 964	2228 1114 926	2138 1125 872	2032 1133 806	1907 1142 736	1762 1151 665
					High (Tap 4)	CFM RPM Watts	2431 1076 970	2372 1089 981	2306 1102 964	2228 1114 926	2138 1125 872	2032 1133 806	1907 1142 736	1762 1151 665

# INDOOR AIRFLOW PERFORMANCE FOR 3-5 TON SELF-CONTAINED AIR CONDITIONERS

## DIRECT DRIVE / BELT DRIVE

### BELT-DRIVE AIRFLOW PERFORMANCE - RLNL/RLPL

CAPACITY 3 & 3.5 TON PACKAGED AIR CONDITIONER (13 & 14 SEER)												
AIR VOLTAGE 208-230, 460 - 3 PHASE												
AIR FLOW CFM	0.1						0.2					
	RPM	WATTS	RPM	WATTS								
900	—	—	—	—	665	290	730	300	780	315	830	330
1000	—	—	625	275	680	295	750	310	805	325	850	345
1100	—	—	640	300	710	315	780	325	830	340	875	365
1200	—	—	670	315	735	330	800	345	850	365	890	385
1300	625	315	700	330	770	350	830	370	875	400	915	415
1400	655	340	730	365	795	365	850	400	890	430	935	445
1500	685	380	755	390	825	415	870	435	915	450	955	480
1600	730	420	790	435	850	455	890	490	935	505	970	525
1700	755	465	825	475	875	505	915	535	985	550	1005	550
1800	790	500	850	530	880	550	935	570	975	600	1020	650

NOTE: Bold lines separate L, M and N drives respectively.

DRIVE PACKAGE	L	M	N (FIELD-SUPPLIED)
MOTOR 1/2	1/2 (3/4 - 575V)	3/4	3/4
BLOWER SHEAVE	6.9 PITCH DIAMETER	6.4 PITCH DIAMETER	6.4 PITCH DIAMETER
MOTOR SHEAVE	ADJUSTABLE 2.4 - 3.4 PITCH DIAMETER	ADJUSTABLE 3.4 - 4.4 PITCH DIAMETER	ADJUSTABLE 4.0 - 5.0 PITCH DIAMETER
TURNS OPEN	0	1 2 3 4 5 6	0 1 2 3 4 5 6
RPM	935	<b>875</b> 830 780 730 680 625	1295 1230 1185 1135 <b>1085</b> 1000 955

NOTE: Factory sheave settings are shown in bold print.

## BELT-DRIVE AIRFLOW PERFORMANCE—RLNL/RLPL

# INDOOR AIRFLOW PERFORMANCE FOR 3-5 TON SELF-CONTAINED AIR CONDITIONERS

## BELT DRIVE

AIR FLOW CFM		CAPACITY 4 TON PACKAGED AIR CONDITIONER (13 & 14 SEER)												AIR FLOW CFM																																
AIR VOLTAGE	208-230, 60 - 3 PHASE	0.1			0.2			0.3			0.4			0.5			0.6			0.7			0.8			0.9			1.0			1.1			1.2			1.3			1.4					
		RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM	WATTS	RPM										
1200	—	—	—	—	—	745	810	375	865	390	400	945	420	1000	440	1040	460	1075	490	1115	540	1170	560	1215	620	1260	650	1300	685	1200	—	—	—	—	—	—	—	—	—	—	—					
1300	—	—	—	695	330	365	835	395	880	415	920	435	975	455	1010	470	1060	490	1100	530	1140	570	1235	640	1270	685	1315	740	1300	—	—	—	—	—	—	—	—	—	—	—						
1400	—	—	—	725	350	385	855	420	895	435	946	455	985	470	1030	500	1070	520	1115	560	1160	600	1205	640	1250	685	1290	745	1335	810	1400	—	—	—	—	—	—	—	—	—	—	—				
1500	690	360	390	750	390	820	425	875	450	920	465	970	480	1010	500	1055	560	1100	580	1140	630	1180	660	1220	700	1270	760	1315	815	1350	865	1500	—	—	—	—	—	—	—	—	—	—	—			
1600	720	390	780	430	850	460	895	480	945	500	990	530	1035	565	1075	590	1115	635	1160	680	1205	725	1250	770	1290	830	1335	890	1365	935	1600	—	—	—	—	—	—	—	—	—	—	—				
1700	750	430	810	465	870	485	920	500	970	530	1015	570	1055	600	1090	645	1140	695	1180	735	1225	790	1270	845	1315	910	1350	960	—	—	—	—	—	—	—	—	—	—	—							
1800	780	475	840	515	885	540	945	555	1035	625	1080	660	1115	710	1155	740	1205	800	1250	860	1295	930	1340	985	1365	1030	—	—	—	—	—	—	—	—	—	—	—									
1900	820	520	870	560	925	580	970	600	1015	640	1060	690	1115	750	1145	790	1185	835	1225	880	1275	900	1315	1010	1355	1060	—	—	—	—	—	—	—	—	—	—	—									
2000	850	585	900	610	950	630	1000	665	1045	715	1090	760	1130	810	1170	865	1205	900	1255	965	1300	1050	1340	1100	1365	1140	—	—	—	—	—	—	—	—	—	—	—									

NOTE: Bold lines separate L, M and N drives respectively.

DRIVE PACKAGE		L						M						N (FIELD-SUPPLIED)																																
MOTOR H.P.	1/2 (3/4 - 5/6V)	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4																											
BLOWER SHEAVE	6.9 PITCH DIAMETER	6.4 PITCH DIAMETER																																												
MOTOR SHEAVE	ADJUSTABLE 28 - 38 PITCH DIAMETER	ADJUSTABLE 34 - 44 PITCH DIAMETER																																												
TURN S/OPEN	0	1	2	3	4	5	6	0	1	2	3	4	5	6	0	1	2	3	4	5	6	0	1	2	3	4	5	6	0	1	2	3	4	5	6											
RPM	990	990	945	895	850	800	750	695	655	620	590	560	530	500	470	440	415	390	365	345	325	305	285	265	245	225	205	185	165	145	125	105	85	65	45	25	0	0								

NOTE: Factory sheave settings are shown in bold print.

DRIVE PACKAGE		L						M						N (FIELD-SUPPLIED)																																
MOTOR H.P.	1/2 (3/4 - 5/6V)	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4																											
BLOWER SHEAVE	6.4 PITCH DIAMETER																																													
MOTOR SHEAVE	2.8-3.8 PITCH DIAMETER - ADJ.																																													
TURN S/OPEN	0	1	2	3	4	5	6	0	1	2	3	4	5	6	0	1	2	3	4	5	6	0	1	2	3	4	5	6	0	1	2	3	4	5	6											
RPM	1095	1040	995	940	890	835	780	1405	1360	1305	1250	1195	1145	1095	1040	980	925	870	820	760	705	655	605	555	505	455	405	355	305	255	205	155	105	55	0	0	0	0	0	0	0	0	0	0		

NOTE: L-drive left of bold line, M-drive right of bold line.

DRIVE PACKAGE		L						M						N (FIELD-SUPPLIED)					
MOTOR H.P.	1/2 (3/4 - 5/6V)	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4
BLOWER SHEAVE	6.4 PITCH DIAMETER																		
MOTOR SHEAVE	2.8-3.8 PITCH DIAMETER - ADJ.																		
TURN S/OPEN	0	1	2	3	4	5	6	0	1	2	3	4	5	6	0	1</			

# INDOOR AIRFLOW PERFORMANCE FOR 3-5 TON SELF-CONTAINED AIR CONDITIONERS–RLPL BELT DRIVE

## AIRFLOW PERFORMANCE - 5 TON [17.6 kW] BELT DRIVE - RLPL

Air Flow CFM [L/s]	Capacity 5 Ton [17.6kW] – 14 SEER										External Static Pressure — Inches of Water [kPa]							
	Voltage 208/230-460 – 3 phase					External Static Pressure — Inches of Water [kPa]					RPM	W	RPM	W	RPM	W		
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]			
	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W		
1400 [661]	—	—	—	—	794	395	835	433	877	918	499	962	528	1085	610	1118	668	
1500 [708]	—	—	—	—	810	440	851	478	892	512	934	544	978	573	1026	601	1087	666
1600 [755]	—	—	—	—	789	446	830	489	871	527	913	562	954	593	998	623	1059	688
1700 [802]	—	—	—	—	813	501	854	544	896	582	937	616	979	648	1023	677	1065	736
1800 [849]	—	—	—	—	799	470	840	560	882	604	923	642	964	676	1006	708	1044	747
1900 [897]	788	507	828	574	869	625	910	688	952	706	993	741	1035	772	1057	828	1087	892
2000 [944]	817	578	857	644	898	695	939	739	981	777	1022	811	1044	848	1073	916	1103	980
2100 [991]	845	653	885	720	927	771	968	814	1009	852	1035	869	1064	943	1093	1011	1123	1075
2200 [1038]	873	734	913	801	955	852	996	896	1037	934	1057	971	1086	1044	1115	1113	1145	1177
2300 [1085]	902	821	942	888	983	939	1024	983	1049	1000	1081	1080	1111	1153	1140	1222	1169	1286
2400 [1133]	933	914	973	981	1014	1032	1036	1028	1075	1116	1107	1196	1137	1270	1165	1338	1195	1402
2500 [1180]	970	1013	1010	1080	1035	1052	1062	1152	1101	1240	1133	1320	1163	1393	1191	1462	—	—

NOTE: L-Drive left of bold line, M-Drive right of bold line.

Drive Package	L	M
Motor H.P. [W]	¾ [559]	1 [746]
Blower Sheave	6.9" Pitch Diameter	6.9" Pitch Diameter
Motor Sheave	2.8"-3.8" Pitch Diameter - Adj.	4.0"-5.0" Pitch Diameter - Adj.
Turns Open	0	1
RPM	1007	963

NOTE: Factory sheave settings are shown in bold print.

[ ] Designates Metric Conversions

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION–RLNL

208-240 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION										
Single Power Supply For Both Unit And Heater Kit					Separate Power Supply For Unit And Heater Kit					
RHEEM Model Number	RXU-Heater Kit Nominal kW	Heater Kit			Air Conditioner			Heater Kit		
		No. of Sequence Steps	Rated Heater kW @ 208/240 V	Heater KBTU/Hr @ 208/240 V	Unit Min. Ckt Ampacity @ 208/240V	Unit Max. Ckt Ampacity @ 208/240V	Over Current Protective Device Size Min/Max @ 208 V	Min. Ckt Ampacity @ 208/240 V	Max. Fuse Size 208/240 V	Min. Ckt. Ampacity 208/240 V
RLNL-A042CK	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	20/22	25/25	15/17	15/20	19/19
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	30/30	25/29	25/30	19/19
	A12C	1	8.4/11.2	23.66/38.21	23.4/27	35/39	35/35	40/40	30/34	19/19
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	43/49	45/45	50/50	38/44	40/50
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60
	No Heat	—	—	—	—	23/23	30/35	—	—	23/23
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	23/23	30/35	15/17	15/20	23/23
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	30/35	25/29	25/30	23/23
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	35/39	35/35	40/40	30/34	23/23
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	43/49	45/45	50/50	38/44	40/45
RLNL-A048CK	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60
	No Heat	—	—	—	—	23/23	30/35	15/17	15/20	23/23
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	23/23	30/35	15/17	15/20	23/23
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	30/35	25/29	25/30	23/23
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	35/39	35/35	40/40	30/34	23/23
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	43/49	45/45	50/50	38/44	40/45
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60
	No Heat	—	—	—	—	30/30	35/40	—	—	30/30
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	30/30	35/40	15/17	15/20	30/30
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	35/39	35/40	40/40	25/29	25/30
RLNL-A060CK	A12C	1	8.4/11.2	28.66/38.21	23.4/27	39/44	40/40	45/45	30/34	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	48/53	50/50	60/60	38/44	40/45
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	60/68	60/60	70/70	50/58	50/60
	No Heat	—	—	—	—	—	—	—	—	—

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION–RLNL

208-240 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION									
Single Power Supply For Both Unit And Heater Kit					Separate Power Supply For Unit And Heater Kit				
RHEEM Model Number	RXJJ-Heater Kit Nominal kW	Heater Kit		Air Conditioner	Heater Kit		Air Conditioner		
		No. of Sequence Steps	Rated Heater kW @ 208/240 V		Unit Min. Ckt Ampacity @ 208/240V	Over Current Protective Device Size	Min. Ckt. Ampacity 208/240 V	Max. Ckt. Ampacity 208/240 V	Over Current Protective Device Size
RLNL-A036CL	No Heat	—	—	18/18	20/25	—	—	—	18/18
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	19/21	20/25	15/17	18/18
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	29/33	30/30	25/29	18/18
	A12C	1	8.4/11.2	23.66/38.21	23.4/27	33/38	35/35	40/40	18/18
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/47	45/45	50/50	18/18
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	54/62	60/60	70/70	18/18
RLNL-A042CL	No Heat	—	—	22/22	25/30	—	—	—	22/22
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	22/22	25/30	15/17	15/20
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	29/33	30/30	25/29	25/30
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	33/38	35/35	40/40	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/47	45/45	50/50	38/44
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	54/62	60/60	70/70	50/58
RLNL-A048CL	No Heat	—	—	22/22	25/35	—	—	—	22/22
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	23/23	30/35	15/17	15/20
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	29/33	30/35	35/35	22/22
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	33/38	35/35	40/40	50/58
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/47	45/45	50/50	38/44
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	54/62	60/60	70/70	50/58
RLNL-A060CL	No Heat	—	—	26/26	30/40	—	—	—	26/26
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	26/26	30/40	15/17	15/20
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	30/40	35/40	25/30
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	34/39	35/40	40/40	30/34
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/48	45/45	50/50	38/44
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58
A24C	1	18/24	61.41/81.88	50/57.7	67/77	70/70	80/80	63/73	70/80

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION–RLNL

208-240 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION												
RHEEM Model Number	Single Power Supply For Both Unit And Heater Kit			Heater Kit			Air Conditioner			Separate Power Supply For Unit And Heater Kit		
	RXJJ-Heater Kit Nominal kW	No. of Sequence Steps	Rated Heater kW @ 208/240 V	KBTU/Hr 208/240 V	Heater Amp. @ 208/240 V	Heater Amp. @ 208/240 V	Unit Min. Ckt Ampacity @ 208/240V	Unit Min. Ckt Ampacity @ 208/240V	Over Current Protective Device Size Min/Max @ 240 V	Min. Ckt. Ampacity 208/240 V	Max. Ckt. Ampacity 208/240 V	Over Current Protective Device Size Min/Max @ 240 V
RLNL-A036CM	No Heat	—	—	—	—	—	18/18	25/25	25/25	—	—	18/18
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	19/22	25/25	25/25	15/17	15/20	18/18	25/25
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	30/30	35/35	25/29	25/30	18/18	25/25
	A12C	1	8.4/11.2	23.66/38.21	23.4/27	34/39	35/35	40/40	30/34	30/35	18/18	25/25
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/48	45/45	50/50	38/44	40/45	18/18	25/25
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60	18/18	25/25
RLNL-A042CM	No Heat	—	—	—	—	—	22/22	30/35	30/35	—	—	22/22
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	22/22	30/35	30/35	15/17	15/20	22/22	30/35
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	30/35	35/35	25/29	25/30	22/22	30/35
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	34/39	35/35	40/40	30/34	30/35	22/22	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/48	45/45	50/50	38/44	40/45	22/22	30/35
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60	22/22	30/35
RLNL-A048CM	No Heat	—	—	—	—	—	23/23	30/35	30/35	—	—	23/23
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	23/23	30/35	30/35	15/17	15/20	23/23	30/35
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	30/35	35/35	25/29	25/30	23/23	30/35
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	34/39	35/35	40/40	30/34	30/35	23/23	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/48	45/45	50/50	38/44	40/45	23/23	30/35
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60	22/22	30/35
RLNL-A060CM	No Heat	—	—	—	—	—	23/23	30/35	30/35	—	—	23/23
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	26/26	30/40	30/40	15/17	15/20	23/23	30/35
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	30/40	35/40	25/29	25/30	26/26	30/40
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	34/39	35/40	40/40	30/34	30/35	26/26	30/40
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	43/49	45/45	50/50	38/44	40/45	26/26	30/40
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60	26/26	30/40
RLNL-A24C	A24C	1	18/24	61.41/81.88	50/57.7	68/77	70/70	80/80	63/73	70/80	26/26	30/40
	A24C	1	18/24	61.41/81.88	50/57.7	68/77	70/70	80/80	63/73	70/80	26/26	30/40

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION—RLNL

## **AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION**

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION–RLNL

480 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION										
RHEEM Model Number	Single Power Supply For Both Unit And Heater Kit					Separate Power Supply For Unit And Heater Kit				
	Heater Kit		Air Conditioner			Heater Kit		Air Conditioner		
	Rated Heater kW @ 480V	Heater BTU/Hr @ 480V	Heater Amp. @ 480V	Unit Min. Ckt. Ampacity @ 480V	Over Current Protective Device Size Min/Max @ 480V	Min. Ckt. Ampacity 480V	Max. Fuse Size 480V	Min. Ckt. Ampacity 480V	Max. Fuse Size 480V	Over Current Protective Device Size Min/Max @ 480V
RLNL-A036DM	No Heat	—	—	—	10	15/15	—	—	10	15/15
	A06D	1	5.6	19.1	6.7	11	15/15	—	9	15
	A10D	1	9.6	32.75	11.6	17	20/20	—	15	15
	A12D	1	11.2	38.21	13.5	19	20/20	—	17	20
	A15D	1	14.4	49.13	17.4	24	25/25	—	22	25
	A20D	1	19.2	65.5	23.3	31	35/35	—	30	30
RLNL-A042DM	No Heat	—	—	—	11	15/15	—	—	—	—
	A06D	1	5.6	19.1	6.7	11	15/15	—	9	15
	A10D	1	9.6	32.75	11.6	17	20/20	—	15	15
	A12D	1	11.2	38.21	13.5	19	20/20	—	17	20
	A15D	1	14.4	49.13	17.4	24	25/25	—	22	25
	A20D	1	19.2	65.5	23.3	31	35/35	—	30	30
RLNL-A048DM	No Heat	—	—	—	11	15/15	—	—	11	15/15
	A06D	1	5.6	19.1	6.7	11	15/15	—	9	15
	A10D	1	9.6	32.75	11.6	17	20/20	—	15	15
	A12D	1	11.2	38.21	13.5	19	20/20	—	17	20
	A15D	1	14.4	49.13	17.4	24	25/25	—	22	25
	A20D	1	19.2	65.5	23.3	32	35/35	—	30	30
RLNL-A060DM	No Heat	—	—	—	13	15/20	—	—	13	15/20
	A06D	1	5.6	19.1	6.7	13	15/20	—	9	15
	A10D	1	9.6	32.75	11.6	17	20/20	—	15	15
	A12D	1	11.2	38.21	13.5	20	20/20	—	17	20
	A15D	1	14.4	49.13	17.4	25	25/25	—	22	25
	A20D	1	19.2	65.5	23.3	32	35/35	—	30	30
A24D	—	—	—	—	—	—	—	—	—	—
	—	—	—	—	—	—	—	—	—	—
A060DM		24	81.88	28.9	39	40/40	—	37	40	13/0
A24D		—	—	—	—	—	—	—	—	15/20

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION–RLNL

RHEEM Model Number	208-240 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION						Separate Power Supply For Both Unit And Heater Kit				Air Conditioner
	RXJJ-Heater Kit Nominal kW	No. of Sequence Steps	Rated Heater kW @ 208/240 V	KBTU/Hr @ 208/240 V	Heater Amp. @ 208/240 V	Unit Min. Ckt Ampacity @ 208/240V	Over Current Protective Device Size Min/Max @ 208 V	Min. Ckt. Ampacity 208/240 V	Max. Fuse Size 208/240 V	Min. Ckt. Ampacity 208/240 V	
No Heat	—	—	—	—	—	27/27	35/40	—	—	27/27	35/40
RLNL-A06J	1	4.2/5.6	14.33/19.1	20.2/23.3	31/35	35/40	26/30	30/30	27/30	27/27	35/40
RLNL-A10J	1	7.2/9.6	24.56/32.75	34.6/40	49/55	50/55	60/60	44/50	45/50	27/27	35/40
RLNL-A12J	1	8.4/11.2	23.66/38.21	40.4/46.7	56/64	60/60	70/70	51/59	60/60	27/27	35/40
RLNL-A15J	1	10.8/14.4	36.84/49.13	51.9/60	70/80	70/70	80/80	65/75	70/80	27/27	35/40
RLNL-A20J	1	14.4/19.2	49.13/65.5	69.3/80	92/105	100/100	110/110	87/100	90/100	27/27	35/40
No Heat	—	—	—	—	28/28	35/45	—	—	—	28/28	35/45
RLNL-A06J	1	4.2/5.6	14.33/19.1	20.2/23.3	31/35	35/45	26/30	30/30	28/28	30/30	35/45
RLNL-A10J	1	7.2/9.6	24.56/32.75	34.6/40	49/55	50/55	60/60	44/50	45/50	28/28	35/45
RLNL-A12J	1	8.4/11.2	28.66/38.21	40.4/46.7	56/64	60/60	70/70	51/59	60/60	28/28	35/45
RLNL-A15J	1	10.8/14.4	36.84/49.13	51.9/60	70/80	70/70	80/80	65/75	70/80	28/28	35/45
RLNL-A20J	1	14.4/19.2	49.13/65.5	69.3/80	92/105	100/100	110/110	87/100	90/100	28/28	35/45
No Heat	—	—	—	—	33/33	40/50	—	—	—	33/33	40/50
RLNL-A06J	1	4.2/5.6	14.33/19.1	20.2/23.2	33/35	40/50	26/30	30/30	33/33	40/50	40/50
RLNL-A10J	1	7.2/9.6	24.56/32.75	34.6/40	49/55	50/55	60/60	44/50	45/50	33/33	40/50
RLNL-A12J	1	8.4/11.2	28.66/38.21	40.4/46.7	56/64	60/60	70/70	51/59	60/60	33/33	40/50
RLNL-A15J	1	10.8/14.4	36.84/49.13	51.9/60	70/80	70/70	80/80	65/75	70/80	33/33	40/50
RLNL-A20J	1	14.4/19.2	49.13/65.5	69.3/80	92/105	100/100	110/110	87/100	90/100	33/33	40/50
No Heat	—	—	—	—	43/43	50/60	—	—	—	43/43	50/60
RLNL-A06J	1	4.2/5.6	14.33/19.1	20.2/23.3	43/43	50/60	26/30	30/30	43/43	50/60	50/60
RLNL-A10J	1	7.2/9.6	24.56/32.75	34.6/40	53/60	60/60	44/50	45/50	43/43	50/60	50/60
RLNL-A12J	1	8.4/11.2	28.66/38.21	40.4/46.7	61/68	60/60	70/70	51/59	60/60	43/43	50/60
RLNL-A15J	1	10.8/14.4	36.84/49.13	51.9/60	75/85	80/80	90/90	65/75	70/80	43/43	50/60
RLNL-A20J	1	14.4/19.2	49.13/65.5	69.3/80	97/110	100/100	110/110	87/100	90/100	43/43	50/60

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION–RLNL

600 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION												
RHEEM Model Number	Single Power Supply For Both Unit And Heater Kit						Separate Power Supply For Unit And Heater Kit					
	Heater Kit			Air Conditioner			Heater Kit			Air Conditioner		
	RXUJ-Heater Kit Nominal kW	No. of Sequence Steps	Rated Heater kW @ 600 V	Heater BTU/Hr @ 600 V	Heater Amp. @ 600 V	Unit Min. Ckt. Ampacity @ 600V	Over Current Protective Device Size 600 V	Min/Max @ 600V	Min. Ckt. Ampacity 600 V	Min. Fuse Size 600 V	Min/Max @ 600V	Over Current Protective Device Size 600 V
RLNL-A036YL	No Heat	—	—	—	—	7	15/15	—	—	—	7	15/15
	A15Y	1	14.4	49.13	13.9	19	20/20	—	18	20	7/0	15/15
RLNL-A048YL	A20Y	1	19.2	65.5	18.8	26	30/30	—	24	25	7/0	15/15
	No Heat	—	—	—	—	9	15/15	—	—	—	9	15/15
RLNL-A060YL	A15Y	1	14.4	49.13	13.9	19	20/20	—	18	20	9/0	15/15
	A20Y	1	19.2	65.5	18.8	26	30/30	—	24	25	9/0	15/15
RLNL-A036YM	No Heat	—	—	—	—	10	15/15	—	—	—	10	15/15
	A15Y	1	14.4	49.13	13.9	19	20/20	—	18	20	10/0	15/15
RLNL-A048YM	A20Y	1	19.2	65.5	18.8	26	30/30	—	24	25	10/0	15/15
	No Heat	—	—	—	—	7	15/15	—	—	—	7	15/15
RLNL-A060YM	A15Y	1	14.4	49.13	13.9	19	20/20	—	18	20	7/0	15/15
	A20Y	1	19.2	65.5	18.8	26	30/30	—	24	25	7/0	15/15
RLNL-A060Y	No Heat	—	—	—	—	9	15/15	—	—	—	9	15/15
	A15Y	1	14.4	49.13	13.9	19	20/20	—	18	20	9/0	15/15
RLNL-A060Y	A20Y	1	19.2	65.5	18.8	26	30/30	—	24	25	9/0	15/15
	No Heat	—	—	—	—	10	15/15	—	—	—	10	15/15

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION—RLPL

208-240 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION											
RHEEM Model No.	RXJJ Heater Kit Nominal kW	Single Power Supply For Both Unit And Heater Kit					Separate Power Supply For Unit And Heater Kit				
		No. of Sequence Steps	Rated Heater kW @ 208/240 V	Heater BTU/Hr @ 208/240 V	Heater Amp. @ 208/240 V	Unit Min. Ckt Ampacity @ 208/240 V	Over Current Protective Device Size Min/Max @ 240 V	Heater Kit Min. Ckt. Ampacity 208/240 V	Air Conditioner Min. Ckt. Ampacity 208/240 V	Heater Kit Max. Fuse 208/240 V	Air Conditioner Max. Fuse 208/240 V
RLPL-A036CK	No Heat	—	—	—	—	19/19	25/25	—	—	19/19	25/25
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	20/22	25/25	15/17	15/20	19/19	25/25
	A10C	1	7.2/9.6	24.56/32.75	20.0/23.1	31/35	35/35	25/29	25/30	19/19	25/25
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	35/39	35/35	40/40	30/34	19/19	25/25
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	43/49	45/45	50/50	38/44	40/45	19/19
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	56/63	60/60	70/70	50/58	50/60	19/19
RLPL-A042CK	No Heat	—	—	—	—	25/25	30/35	—	—	25/25	30/35
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	25/25	30/35	15/17	15/20	25/25	30/35
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	33/37	35/35	40/40	25/29	25/30	30/35
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	37/42	40/40	45/45	30/34	30/35	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	46/51	50/50	60/60	38/44	40/45	25/25
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	58/66	60/60	70/70	50/58	50/60	25/25
RLPL-A048CK	No Heat	—	—	—	—	25/25	30/35	—	—	25/25	30/35
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	25/25	30/35	15/17	15/20	25/25	30/35
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	33/37	35/35	40/40	25/29	25/30	30/35
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	37/42	40/40	45/45	30/34	30/35	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	46/51	50/50	60/60	38/44	40/45	25/25
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	58/66	60/60	70/70	50/58	50/60	25/25
RLPL-A060CK	No Heat	—	—	—	—	30/30	35/45	—	—	30/30	35/45
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	30/30	35/45	15/17	15/20	30/30	35/45
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	35/39	35/45	40/45	25/29	25/30	35/45
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	39/44	40/45	45/45	30/34	30/35	35/45
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	48/53	50/50	60/60	38/44	40/45	30/30
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	60/68	60/60	70/70	50/58	50/60	30/30

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION–RLPL

**208-240 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION**

RHEEM Model No.	RXJU Heater Kit Nominal kW	Single Power Supply For Both Unit And Heater Kit					Separate Power Supply For Unit And Heater Kit				
		No. of Sequence Steps	Rated Heater kW @ 208/240 V	Heater BTU/Hr @ 208/240 V	Heater Amp. @ 208/240 V	Unit Min. Ckt Ampacity @ 208/240V	Over Current Protective Device Size Min/Max @ 240 V	Heater Kit Min. Ckt. Ampacity @ 208/240 V	Heater Kit Max. Fuse Size 208/240 V	Air Conditioner Min. Ckt. Ampacity 208/240 V	Air Conditioner Over Current Protective Device Size Min/Max @ 240 V
RLPL-A036CL	No Heat	—	—	—	—	18/18	20/25	—	—	18/18	20/25
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	19/21	20/25	25/25	15/17	18/18	20/25
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	29/33	30/30	35/35	25/29	18/18	20/25
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	33/38	35/35	40/40	30/34	18/18	20/25
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/47	45/45	50/50	38/44	40/45	20/25
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	54/62	60/60	70/70	50/58	50/60	20/25
RLPL-A042CL	No Heat	—	—	—	—	22/22	25/30	—	—	22/22	25/30
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	22/22	25/30	25/30	15/17	15/20	25/30
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	29/33	30/30	35/35	25/29	25/30	25/30
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	33/38	35/35	40/40	30/34	30/35	25/30
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/47	45/45	50/50	38/44	40/45	25/30
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	54/62	60/60	70/70	50/58	50/60	25/30
RLPL-A048CL	No Heat	—	—	—	—	22/22	25/35	—	—	22/22	25/35
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	22/22	25/35	25/35	15/17	15/20	25/35
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	29/33	30/35	35/35	25/29	25/30	25/35
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	33/38	35/35	40/40	30/34	30/35	25/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/47	45/45	50/50	38/44	40/45	25/35
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	54/62	60/60	70/70	50/58	50/60	25/35
RLPL-A060CL	No Heat	—	—	—	—	26/26	30/40	—	—	26/26	30/40
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	26/26	30/40	15/17	15/20	26/26	30/40
	A10C	1	7.2/9.6	24.56/32.75	20.0/23.1	30/34	35/40	25/29	25/30	26/26	30/40
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	34/39	35/40	40/40	30/34	30/35	30/40
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/48	45/45	50/50	38/44	40/45	30/40
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60	30/40

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION—RLPL

208-240 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION											
RHEEM Model No.	RX-U Heater Kit Nominal kW	Single Power Supply For Both Unit And Heater Kit						Separate Power Supply For Unit And Heater Kit			
		No. Sequence Steps	Rated Heater kW @ 208/240 V	Heater KBTU/Hr @ 208/240 V	Heater Amp. @ 208/240 V	Unit Min. Ckt Ampacity @ 208/240V	Unit Max. Ckt Ampacity @ 208/240V	Over Current Protective Device Size Min/Max @ 208 V	Heater Kit Min. Ckt. Ampacity 208/240 V	Heater Kit Max. Fuse Size 208/240 V	Air Conditioner Min. Ckt. Ampacity 208/240 V
RLPL-A036CM	No Heat	—	—	—	—	18/18	25/25	—	—	18/18	25/25
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	19/22	25/25	15/17	15/20	18/18	25/25
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	30/30	25/29	25/30	18/18	25/25
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	34/39	35/35	40/40	30/34	18/18	25/25
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/48	45/45	50/50	38/44	40/45	25/25
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60	18/18
RLPL-A042CM	No Heat	—	—	—	—	22/22	30/35	—	—	22/22	30/35
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	22/22	30/35	15/17	15/20	22/22	30/35
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	30/35	25/29	25/30	22/22	30/35
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	34/39	35/35	40/40	30/34	22/22	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/48	45/45	50/50	38/44	40/45	22/22
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60	22/22
RLPL-A048CM	No Heat	—	—	—	—	23/23	30/35	—	—	23/23	30/35
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	23/23	30/35	15/17	15/20	23/23	30/35
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	30/35	25/29	25/30	23/23	30/35
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	34/39	35/35	40/40	30/34	23/23	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	42/48	45/45	50/50	38/44	40/45	23/23
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60	23/23
RLPL-A060CM	No Heat	—	—	—	—	26/26	35/40	—	—	26/26	35/40
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	26/26	35/40	15/17	15/20	26/26	35/40
	A10C	1	7.2/9.6	24.56/32.75	20/23.1	30/34	35/40	25/29	25/30	26/26	35/40
	A12C	1	8.4/11.2	28.66/38.21	23.4/27	34/39	35/40	40/40	30/34	26/26	35/40
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	43/49	45/45	50/50	38/44	40/45	26/26
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	55/63	60/60	70/70	50/58	50/60	26/26
RLPL-A024C	A24C	1	18/24	61.41/81.88	50/57.7	68/77	70/70	80/80	63/73	70/80	35/40

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION–RLPL

**460 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION**

RHEEM Model No.	RXJJ Heater Kit Nominal kW	Single Power Supply For Both Unit And Heater Kit					Separate Power Supply For Unit And Heater Kit				
		No. of Sequence Steps	Rated Heater kW @ 480 V	Heater KBTU/Hr @ 480 V	Heater Amp. @ 480 V	Unit Min. Ckt Ampacity @ 480 V	Over Current Protective Device Size Min/Max @ 480 V	Heater Kit Min. Ckt. Ampacity 480 V	Heater Kit Max. Fuse Size 480 V	Air Conditioner Min. Ckt. Ampacity 480 V	Air Conditioner Over Current Protective Device Size Min/Max @ 480 V
RLPL-A036DK	No Heat	—	—	—	—	11	15/15	—	—	11	15/15
	A06D	1	5.6	19.1	6.7	11	15/15	—	9	15	11/0
	A10D	1	9.6	32.75	11.6	18	20/20	—	15	15	11/0
	A12D	1	11.2	38.21	13.5	20	20/20	—	17	20	11/0
	A15D	1	14.4	49.13	17.4	25	25/25	—	22	25	11/0
RLPL-A042DK	A20D	1	19.2	65.5	23.3	32	35/35	—	30	30	11/0
	No Heat	—	—	—	—	12	15/15	—	—	12	15/15
	A06D	1	5.6	19.1	6.7	13	15/15	—	9	15	12/0
	A10D	1	9.6	32.75	11.6	19	20/20	—	15	15	12/0
	A12D	1	11.2	38.21	13.5	21	25/25	—	17	20	12/0
RLPL-A048DK	A15D	1	14.4	49.13	17.4	26	30/30	—	22	25	12/0
	A20D	1	19.2	65.5	23.3	34	35/35	—	30	30	12/0
	No Heat	—	—	—	—	12	15/15	—	—	12	15/15
	A06D	1	5.6	19.1	6.7	13	15/15	—	9	15	12/0
	A10D	1	9.6	32.75	11.6	19	20/20	—	15	15	12/0
RLPL-A060DK	A12D	1	11.2	38.21	13.5	21	25/25	—	17	20	12/0
	A15D	1	14.4	49.13	17.4	26	30/30	—	22	25	12/0
	A20D	1	19.2	65.5	23.3	34	35/35	—	30	30	12/0
	No Heat	—	—	—	—	15	20/20	—	—	15	20/20
	A06D	1	5.6	19.1	6.7	15	20/20	—	—	15	20/20
RLPL-A060DK	A10D	1	9.6	32.75	11.6	20	20/20	—	9	15	15/0
	A12D	1	11.2	38.21	13.5	22	25/25	—	17	20	15/0
	A15D	1	14.4	49.13	17.4	27	30/30	—	22	25	15/0
	A20D	1	19.2	65.5	23.3	35	35/35	—	30	30	15/0

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION–RLPL

460 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION											
RHEEM Model No.	RXJJ Heater Kit Nominal kW	Single Power Supply For Both Unit And Heater Kit					Separate Power Supply For Unit And Heater Kit				
		No. of Sequence Steps	Rated Heater kW @ 480 V	Heater BTU/Hr @ 480 V	Heater Amp. @ 480 V	Unit Min. Ckt Ampacity @ 480 V	Over Current Protective Device Size Min/Max @ 480 V	Heater Kit Min. Ckt. Ampacity 480 V	Heater Kit Max. Fuse Size 480 V	Air Conditioner Min. Ckt. Ampacity 480 V	Air Conditioner Over Current Protective Device Size Min/Max @ 480 V
RLPL-A036DL	No Heat	—	—	—	—	10	15/15	—	—	10	15/15
	A06D	1	5.6	19.1	6.7	11	15/15	—	9	15	10/0
	A10D	1	9.6	32.75	11.6	17	20/20	—	15	20	10/0
	A12D	1	11.2	38.21	13.5	19	20/20	—	17	22	10/0
	A15D	1	14.4	49.13	17.4	24	25/25	—	22	25	10/0
RLPL-A042DL	A20D	1	19.2	65.5	23.3	31	35/35	—	30	30	10/0
	No Heat	—	—	—	—	10	15/15	—	—	10	15/15
	A06D	1	5.6	19.1	6.7	11	15/15	—	9	15	10/0
	A10D	1	9.6	32.75	11.6	17	20/20	—	15	20	10/0
	A12D	1	11.2	38.21	13.5	19	20/20	—	17	22	10/0
RLPL-A048DL	A15D	1	14.4	49.13	17.4	24	25/25	—	22	25	10/0
	A20D	1	19.2	65.5	23.3	31	35/35	—	30	30	10/0
	No Heat	—	—	—	—	11	15/15	—	—	11	15/15
	A06D	1	5.6	19.1	6.7	11	15/15	—	9	15	11/0
	A10D	1	9.6	32.75	11.6	17	20/20	—	15	20	11/0
RLPL-A060DL	A12D	1	11.2	38.21	13.5	19	20/20	—	17	22	11/0
	A15D	1	14.4	49.13	17.4	24	25/25	—	22	25	11/0
	A20D	1	19.2	65.5	23.3	31	35/35	—	30	30	11/0
	No Heat	—	—	—	—	13	15/20	—	—	13	15/20
	A06D	1	5.6	19.1	6.7	13	15/20	—	9	15	13/0
RLPL-A060DL	A10D	1	9.6	32.75	11.6	17	20/20	—	15	20	13/0
	A12D	1	11.2	38.21	13.5	19	20/20	—	17	22	13/0
	A15D	1	14.4	49.13	17.4	24	25/25	—	22	25	13/0
	A20D	1	19.2	65.5	23.3	32	35/35	—	30	30	13/0
RLPL-A060DL	A24D	1	24	81.88	28.9	39	40/40	—	37	40	13/0
											15/20

## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION—RLPL

### **460 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION**

RHEEM Model No.	RXJJ Heater Kit Nominal kW	Single Power Supply For Both Unit And Heater Kit				Separate Power Supply For Unit And Heater Kit			
		No. of Sequence Steps	Rated Heater kW @ 208-480 V	Heater BTU/Hr @ 480 V	Heater Amp. @ 480 V	Unit Min. Ckt Ampacity @ 480 V	Over Current Protective Device Size Min/Max @ 480 V	Heater Kit Min. Ckt. Ampacity 480 V	Air Conditioner Min. Ckt. Ampacity 480 V
RLPL-A036DM	No Heat	—	—	—	—	10	15/15	—	—
	A06D	1	5.6	19.1	6.7	11	15/15	9	15
	A10D	1	9.6	32.75	11.6	17	20/20	—	15
	A12D	1	11.2	38.21	13.5	19	20/20	—	20
	A15D	1	14.4	49.13	17.4	24	25/25	—	22
	A20D	1	19.2	65.5	23.3	32	35/35	—	30
	No Heat	—	—	—	—	11	15/15	—	—
RLPL-A042DM	A06D	1	5.6	19.1	6.7	11	15/15	9	15
	A10D	1	9.6	32.75	11.6	17	20/20	—	15
	A12D	1	11.2	38.21	13.5	19	20/20	—	20
	A15D	1	14.4	49.13	17.4	24	25/25	—	22
	A20D	1	19.2	65.5	23.3	32	35/35	—	30
	No Heat	—	—	—	—	11	15/15	—	—
	A06D	1	5.6	19.1	6.7	11	15/15	9	15
RLPL-A048DM	A10D	1	9.6	32.75	11.6	17	20/20	—	15
	A12D	1	11.2	38.21	13.5	19	20/20	—	17
	A15D	1	14.4	49.13	17.4	24	25/25	—	22
	A20D	1	19.2	65.5	23.3	32	35/35	—	30
	No Heat	—	—	—	—	13	15/20	—	—
	A06D	1	5.6	19.1	6.7	13	15/20	—	9
	A10D	1	9.6	32.75	11.6	17	20/20	—	15
RLPL-A060DM	A12D	1	11.2	38.21	13.5	20	20/20	—	17
	A15D	1	14.4	49.13	17.4	25	25/25	—	22
	A20D	1	19.2	65.5	23.3	32	35/35	—	30
	A24D	1	24	81.88	28.9	39	40/40	—	37
								40	130


## AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION–RLPL

**208-240 VOLT, SINGLE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION**

RHEEM Model No.	Single Power Supply For Both Unit And Heater Kit					Separate Power Supply For Unit And Heater Kit					
	RXXJ Heater Kit Nominal kW	No. of Sequence Steps	Rated Heater kW @ 208/240 V	KBTU/Hr @ 208/240 V	Heater Amp. @ 208/240 V	Unit Min. Ckt Ampacity @ 208/240V	Unit Max. Ckt Ampacity @ 208/240V	Over Current Protective Device Size Min/Max @ 240V	Heater Kit Min. Ckt. Ampacity 208/240 V	Air Conditioner Min. Ckt. Ampacity 208/240 V	Air Conditioner Over Current Protective Device Size Min/Max @ 240V
RLPL-A036JK	No Heat	—	—	—	—	27/27	35/40	—	—	27/27	35/40
	A06J	1	4.2/5.6	14.33/19.1	20.2/23.3	31/35	35/40	26/30	30/30	27/27	35/40
	A10J	1	7.2/9.6	24.56/32.75	34.6/40	49/56	50/50	60/60	44/50	27/27	35/40
	A12J	1	8.4/11.2	28.66/38.21	40.4/46.7	56/64	60/60	70/70	51/59	27/27	35/40
	A15J	1	10.8/14.4	36.84/49.13	51.9/60	71/81	70/70	90/90	65/75	27/27	35/40
	A20J	1	14.4/19.2	49.13/65.5	69.3/80	92/106	100/100	110/110	87/100	90/100	27/27
RLPL-A042JK	No Heat	—	—	—	—	30/30	35/45	—	—	30/30	35/45
	A06J	1	4.2/5.6	14.33/19.1	20.2/23.3	33/37	35/45	40/45	26/30	30/30	35/45
	A10J	1	7.2/9.6	24.56/32.75	34.6/40	51/58	60/60	60/60	44/50	30/30	35/45
	A12J	1	8.4/11.2	28.66/38.21	40.4/46.7	59/66	60/60	70/70	51/59	30/30	35/45
	A15J	1	10.8/14.4	36.84/49.13	51.9/60	73/83	80/80	90/90	65/75	70/80	30/30
	A20J	1	14.4/19.2	49.13/65.5	69.3/80	95/108	100/100	110/110	87/100	90/100	30/30
RLPL-A048JK	No Heat	—	—	—	—	35/35	45/50	—	—	35/35	45/50
	A06J	1	4.2/5.6	14.33/19.1	20.2/23.3	35/37	45/50	45/50	26/30	30/30	35/35
	A10J	1	7.2/9.6	24.56/32.75	34.6/40	51/58	60/60	60/60	44/50	35/50	45/50
	A12J	1	8.4/11.2	28.66/38.21	40.4/46.7	59/66	60/60	70/70	51/59	60/60	35/50
	A15J	1	10.8/14.4	36.84/49.13	51.9/60	73/83	80/80	90/90	65/75	70/80	35/50
	A20J	1	14.4/19.2	49.13/65.5	69.3/80	95/108	100/100	110/110	87/100	90/100	35/50
RLPL-A060JK	No Heat	—	—	—	—	—	—	—	—	—	—
	A06J	1	4.2/5.6	14.33/19.1	20.2/23.3	43/43	50/60	—	—	43/43	50/60
	A10J	1	7.2/9.6	24.56/32.75	34.6/40	53/60	60/60	60/60	44/50	35/50	45/50
	A12J	1	8.4/11.2	28.66/38.21	40.4/46.7	61/68	60/60	70/70	51/59	60/60	43/43
	A15J	1	10.8/14.4	36.84/49.13	51.9/60	75/85	80/80	90/90	65/75	70/80	43/43
	A20J	1	14.4/19.2	49.13/65.5	69.3/80	97/110	100/100	110/110	87/100	90/100	43/43


## **FIGURE 15**

### **WIRING DIAGRAM**

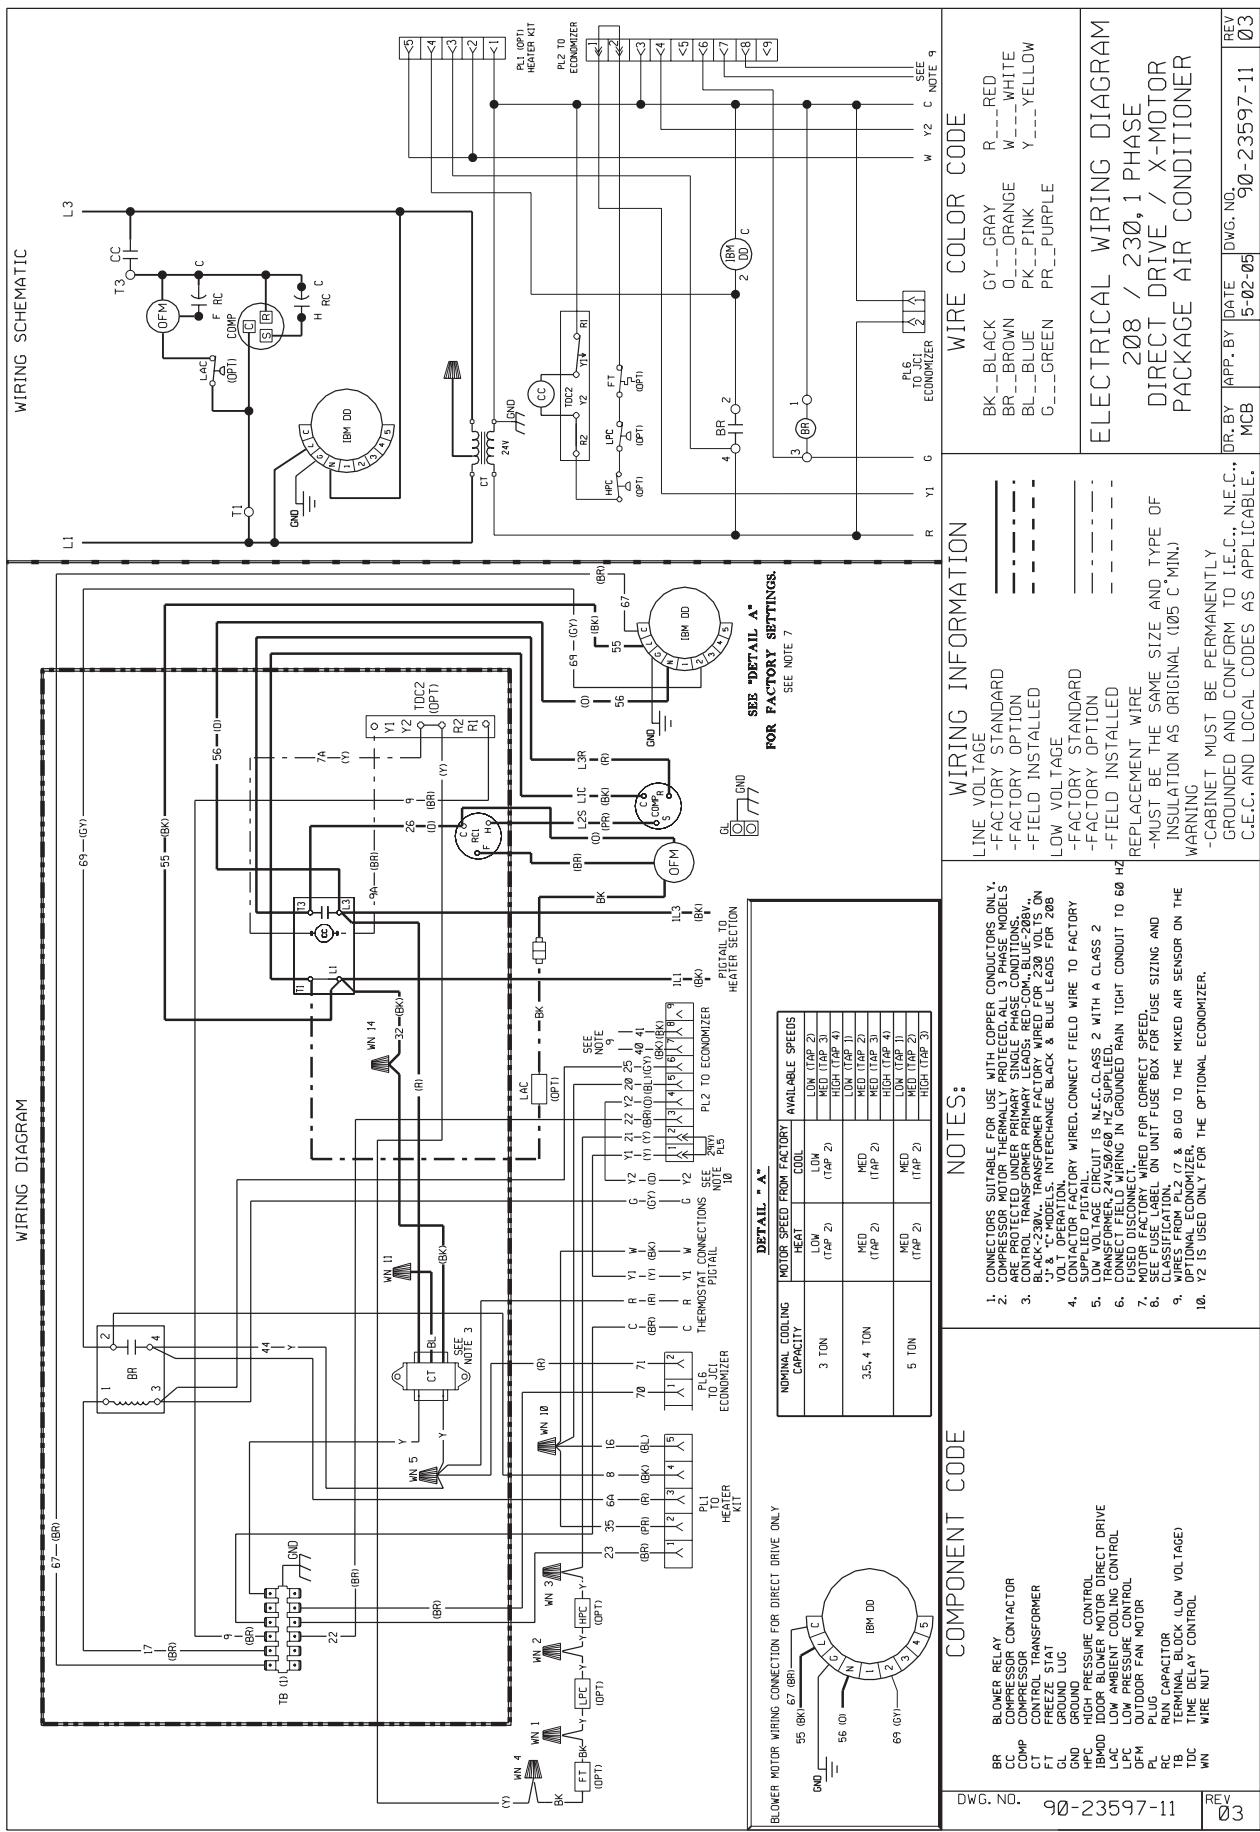


## **FIGURE 16**


### **WIRING DIAGRAM**

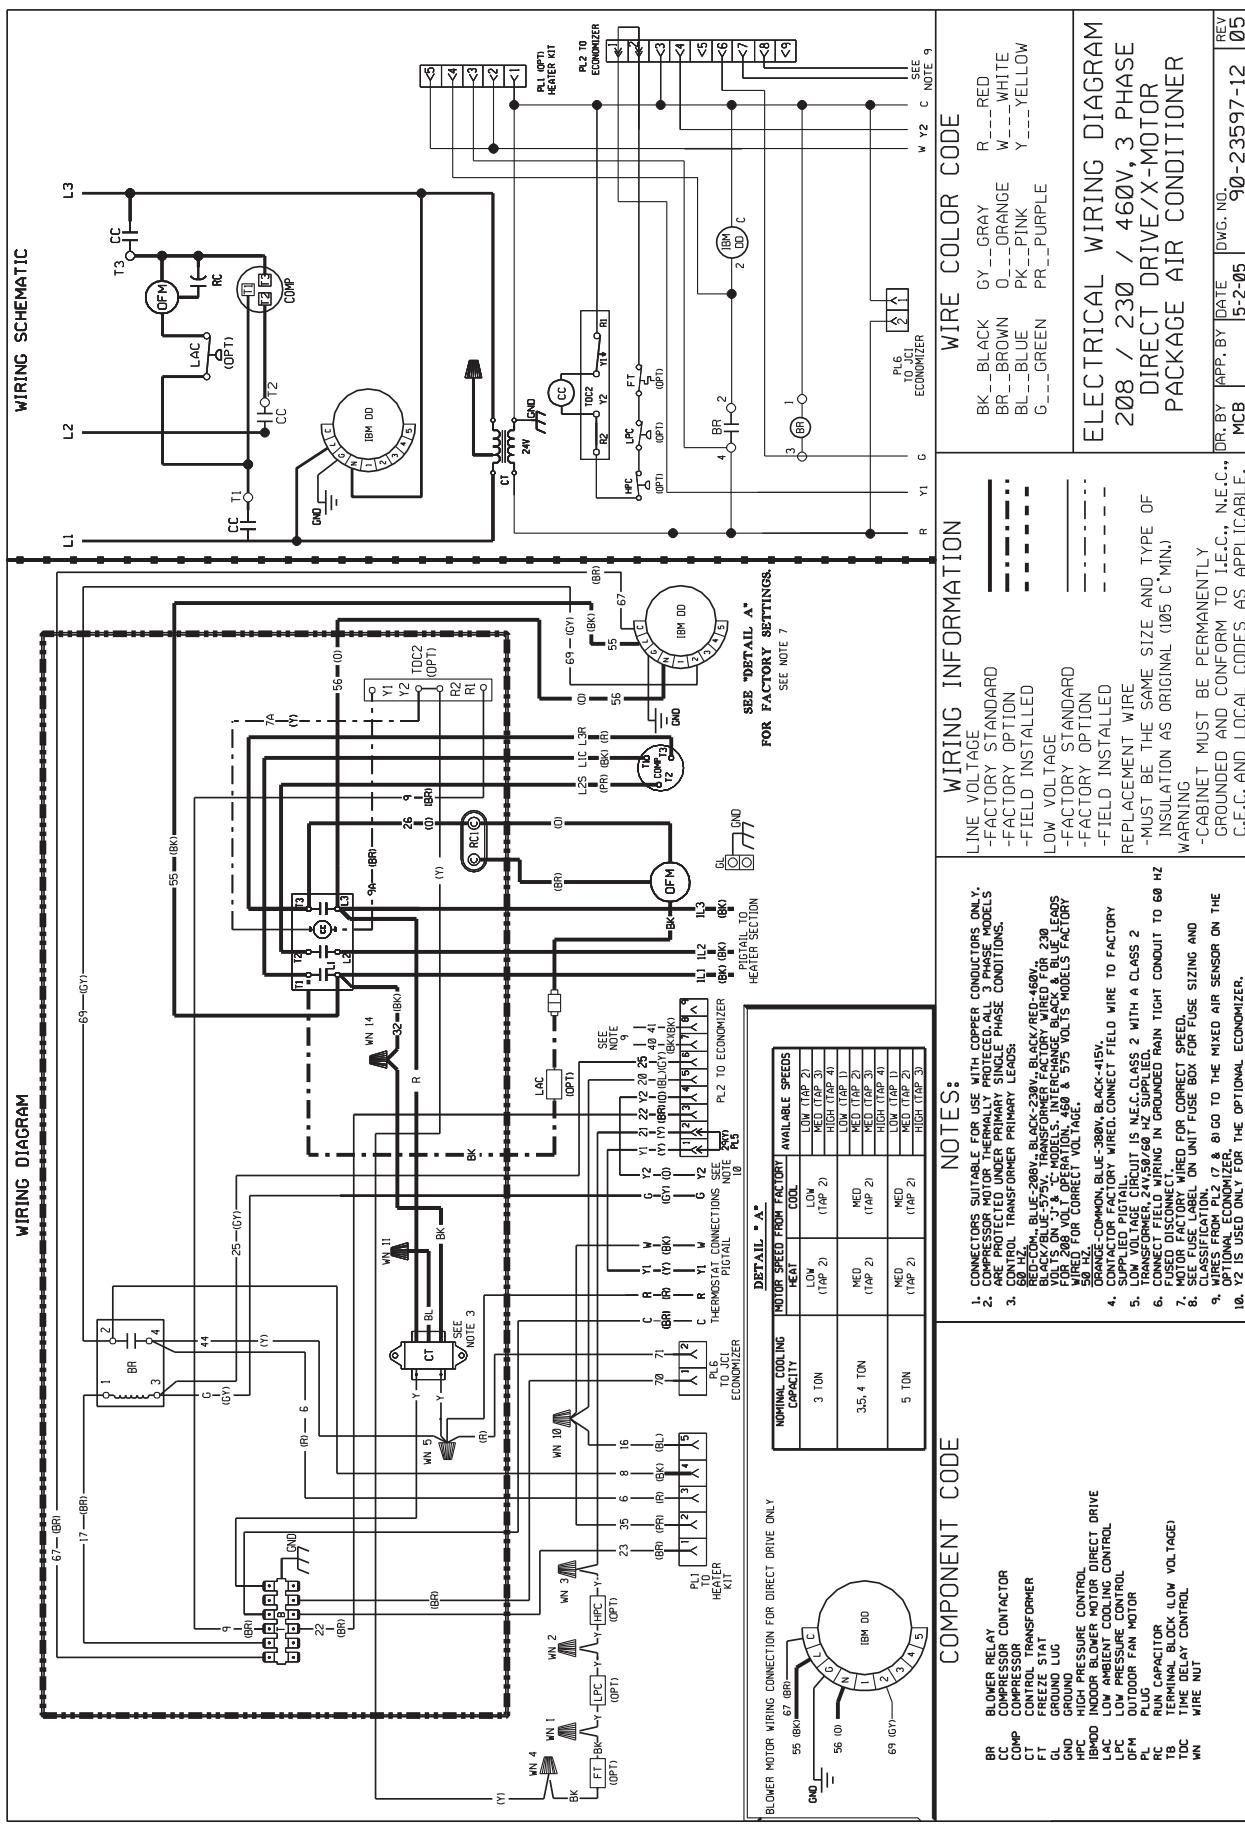

**FIGURE 17**  
WIRING DIAGRAM

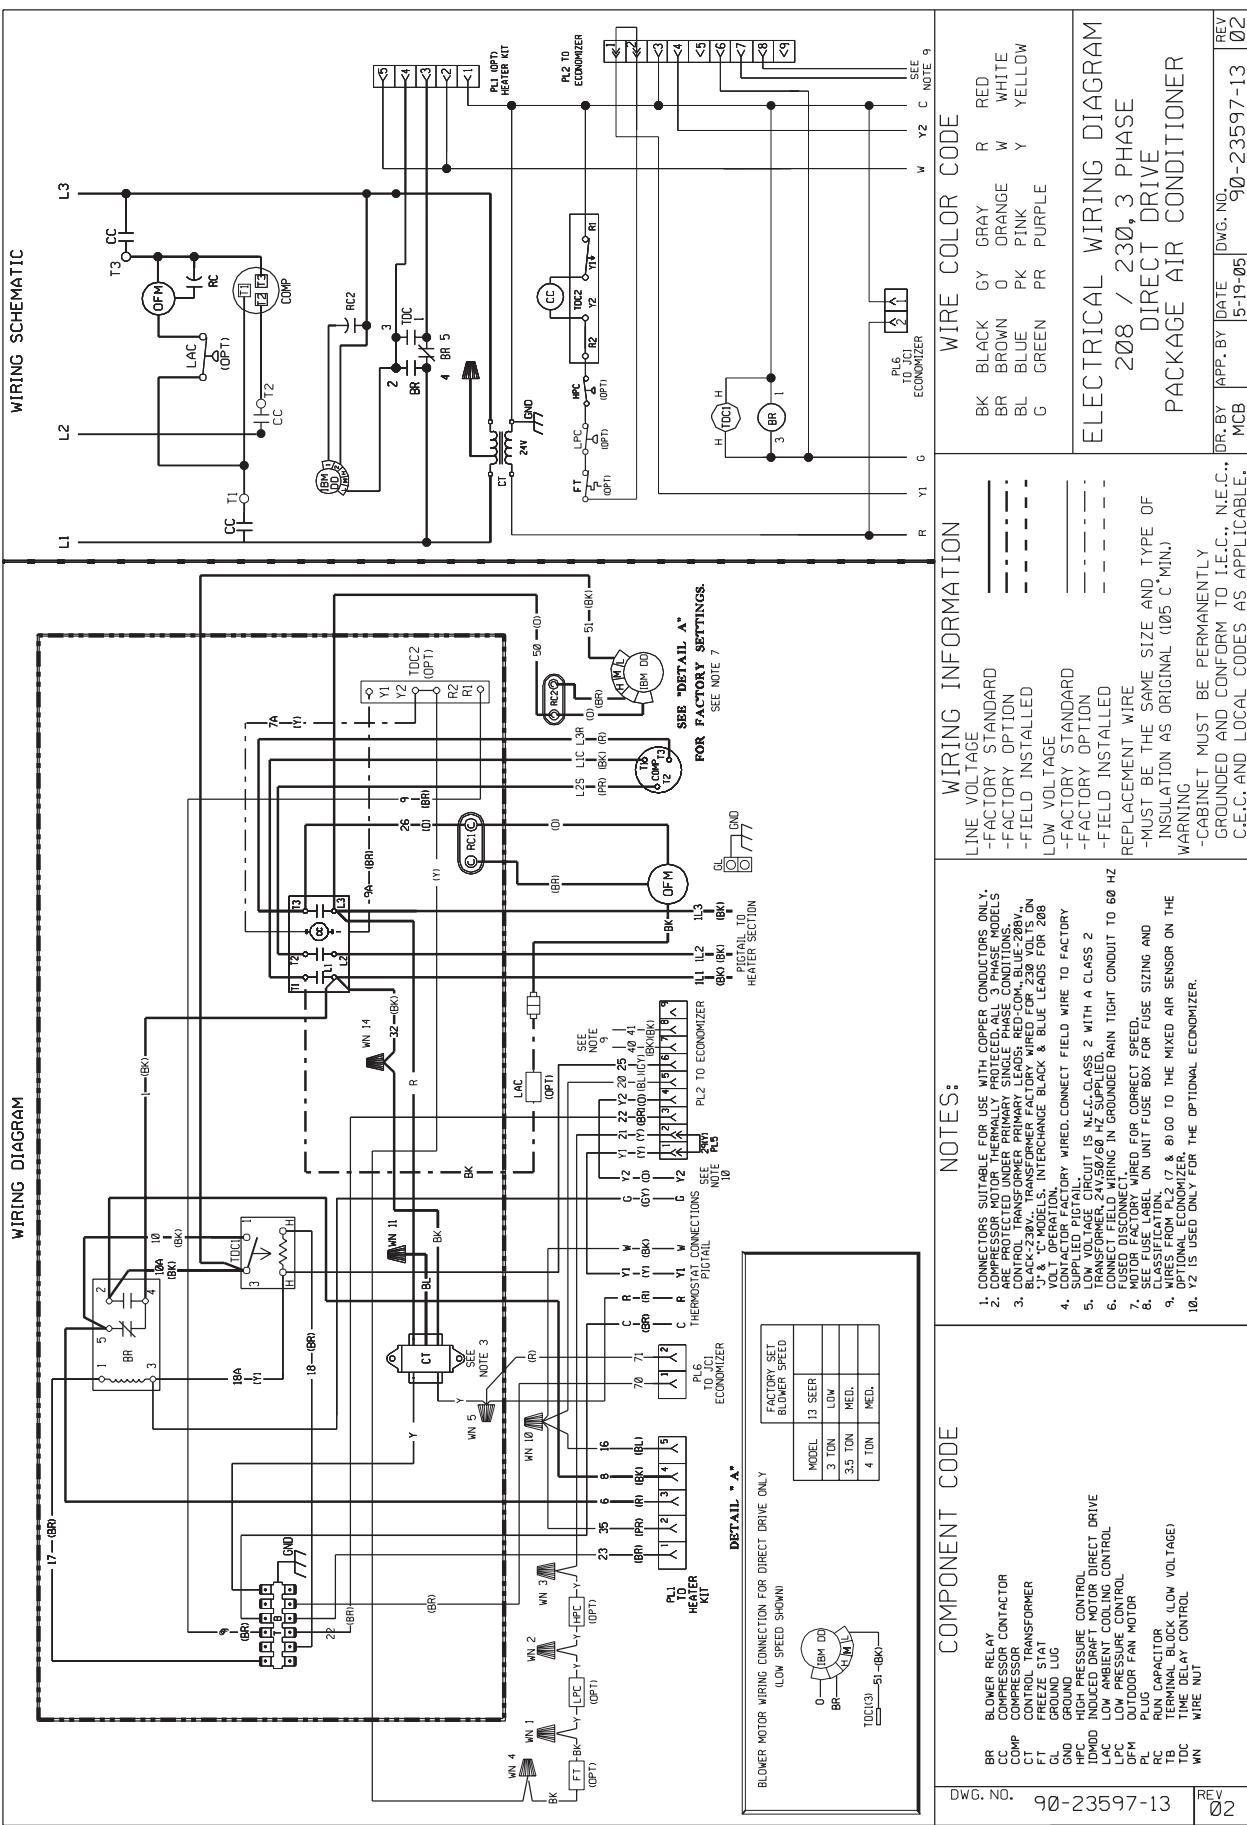


**FIGURE 18**  
WIRING DIAGRAM

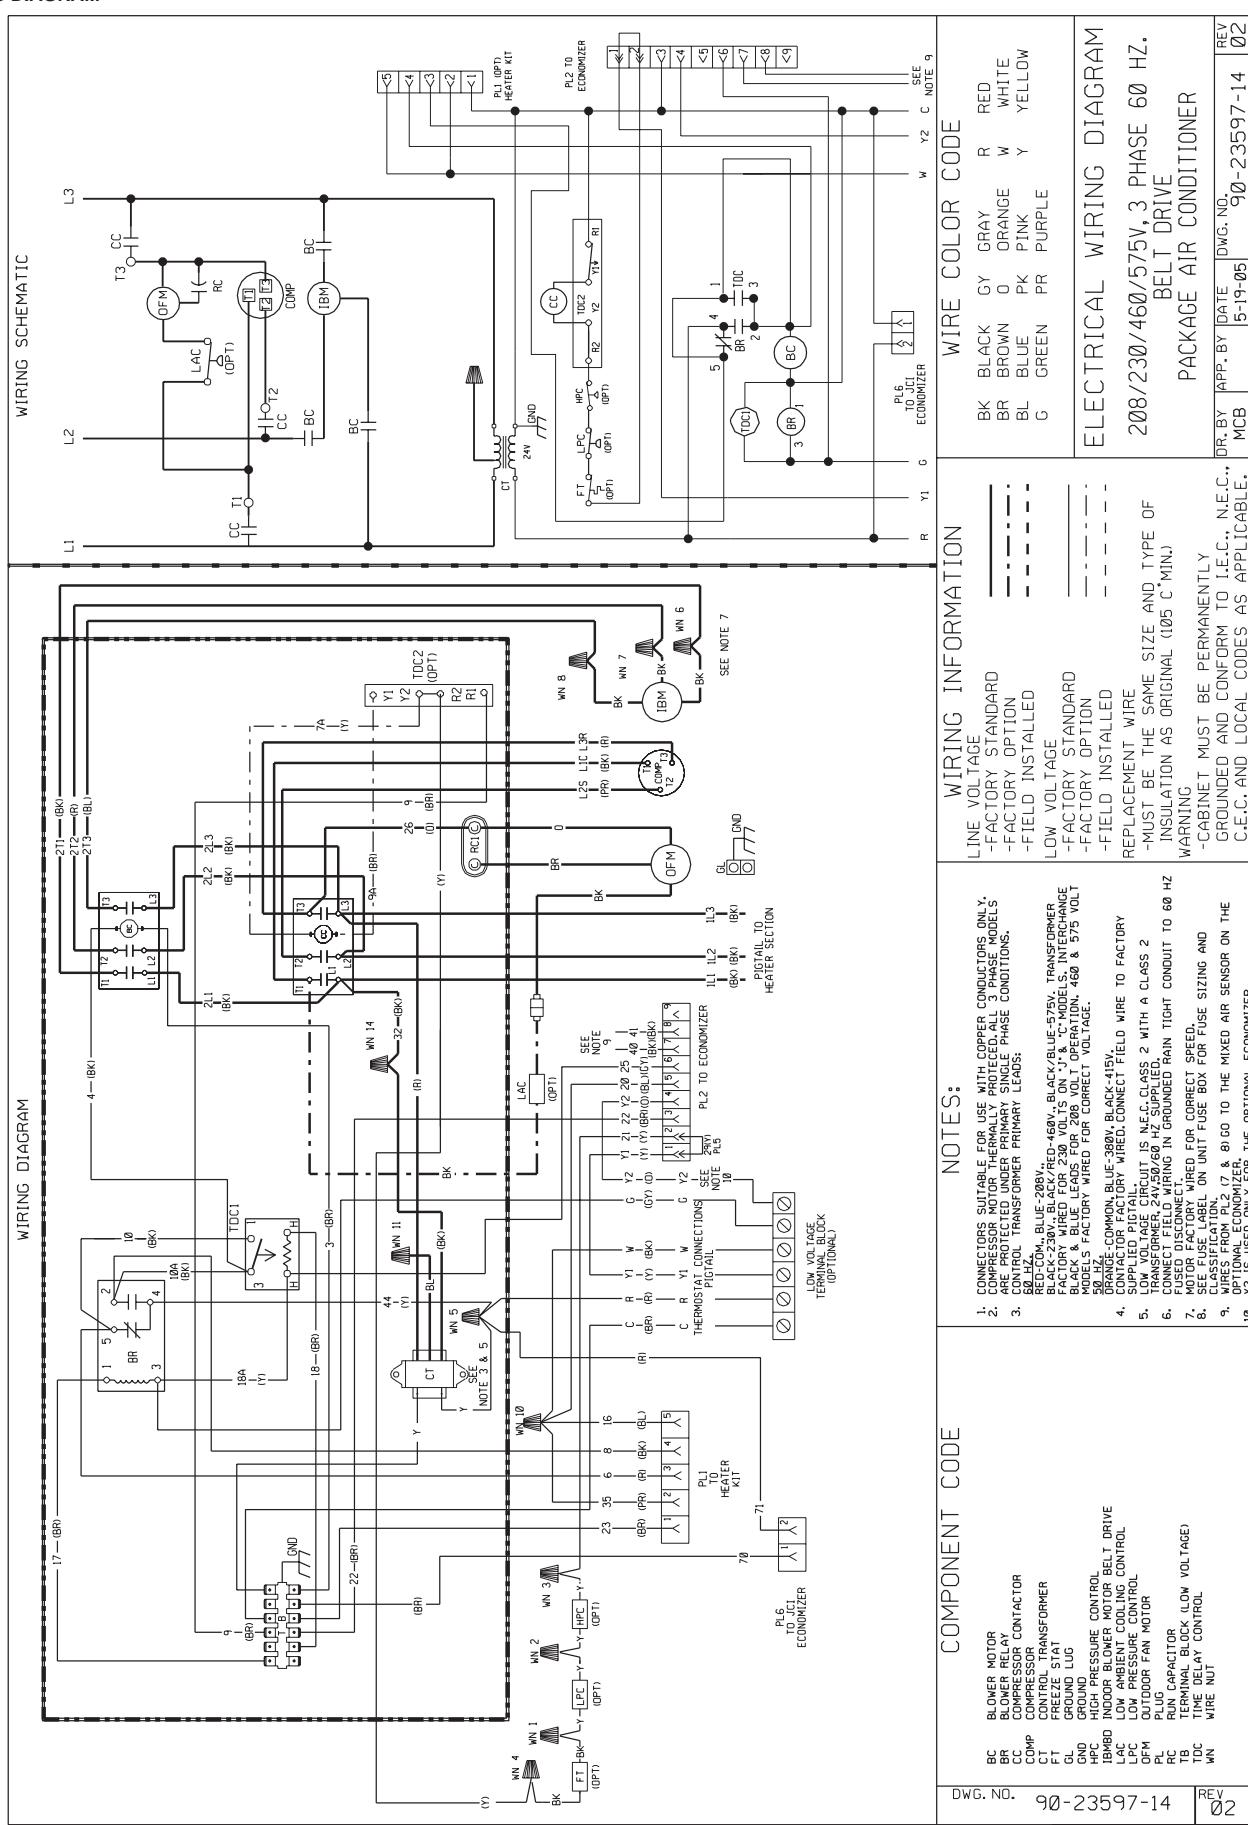


## **FIGURE 19**

### **WIRING DIAGRAM**

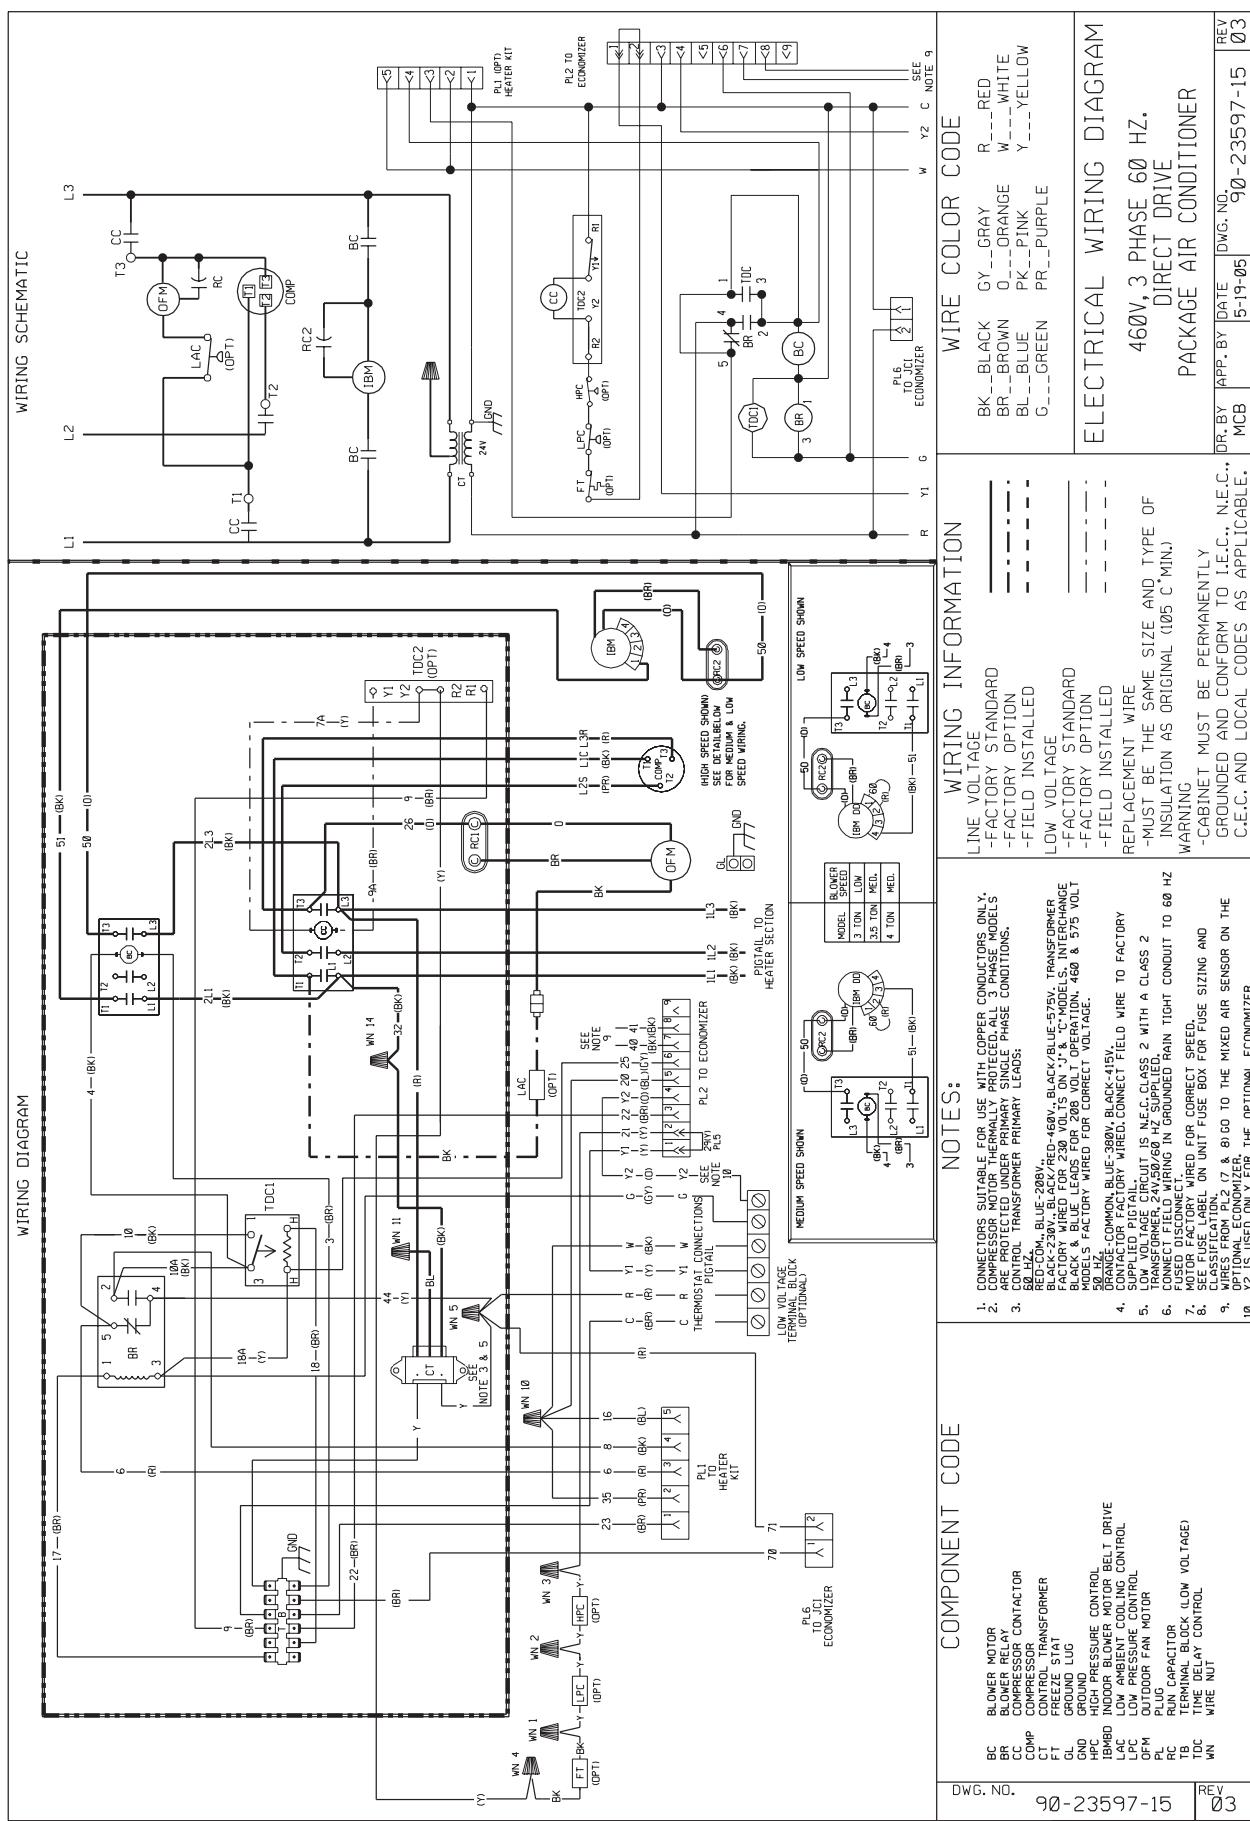

**FIGURE 20**  
WIRING DIAGRAM

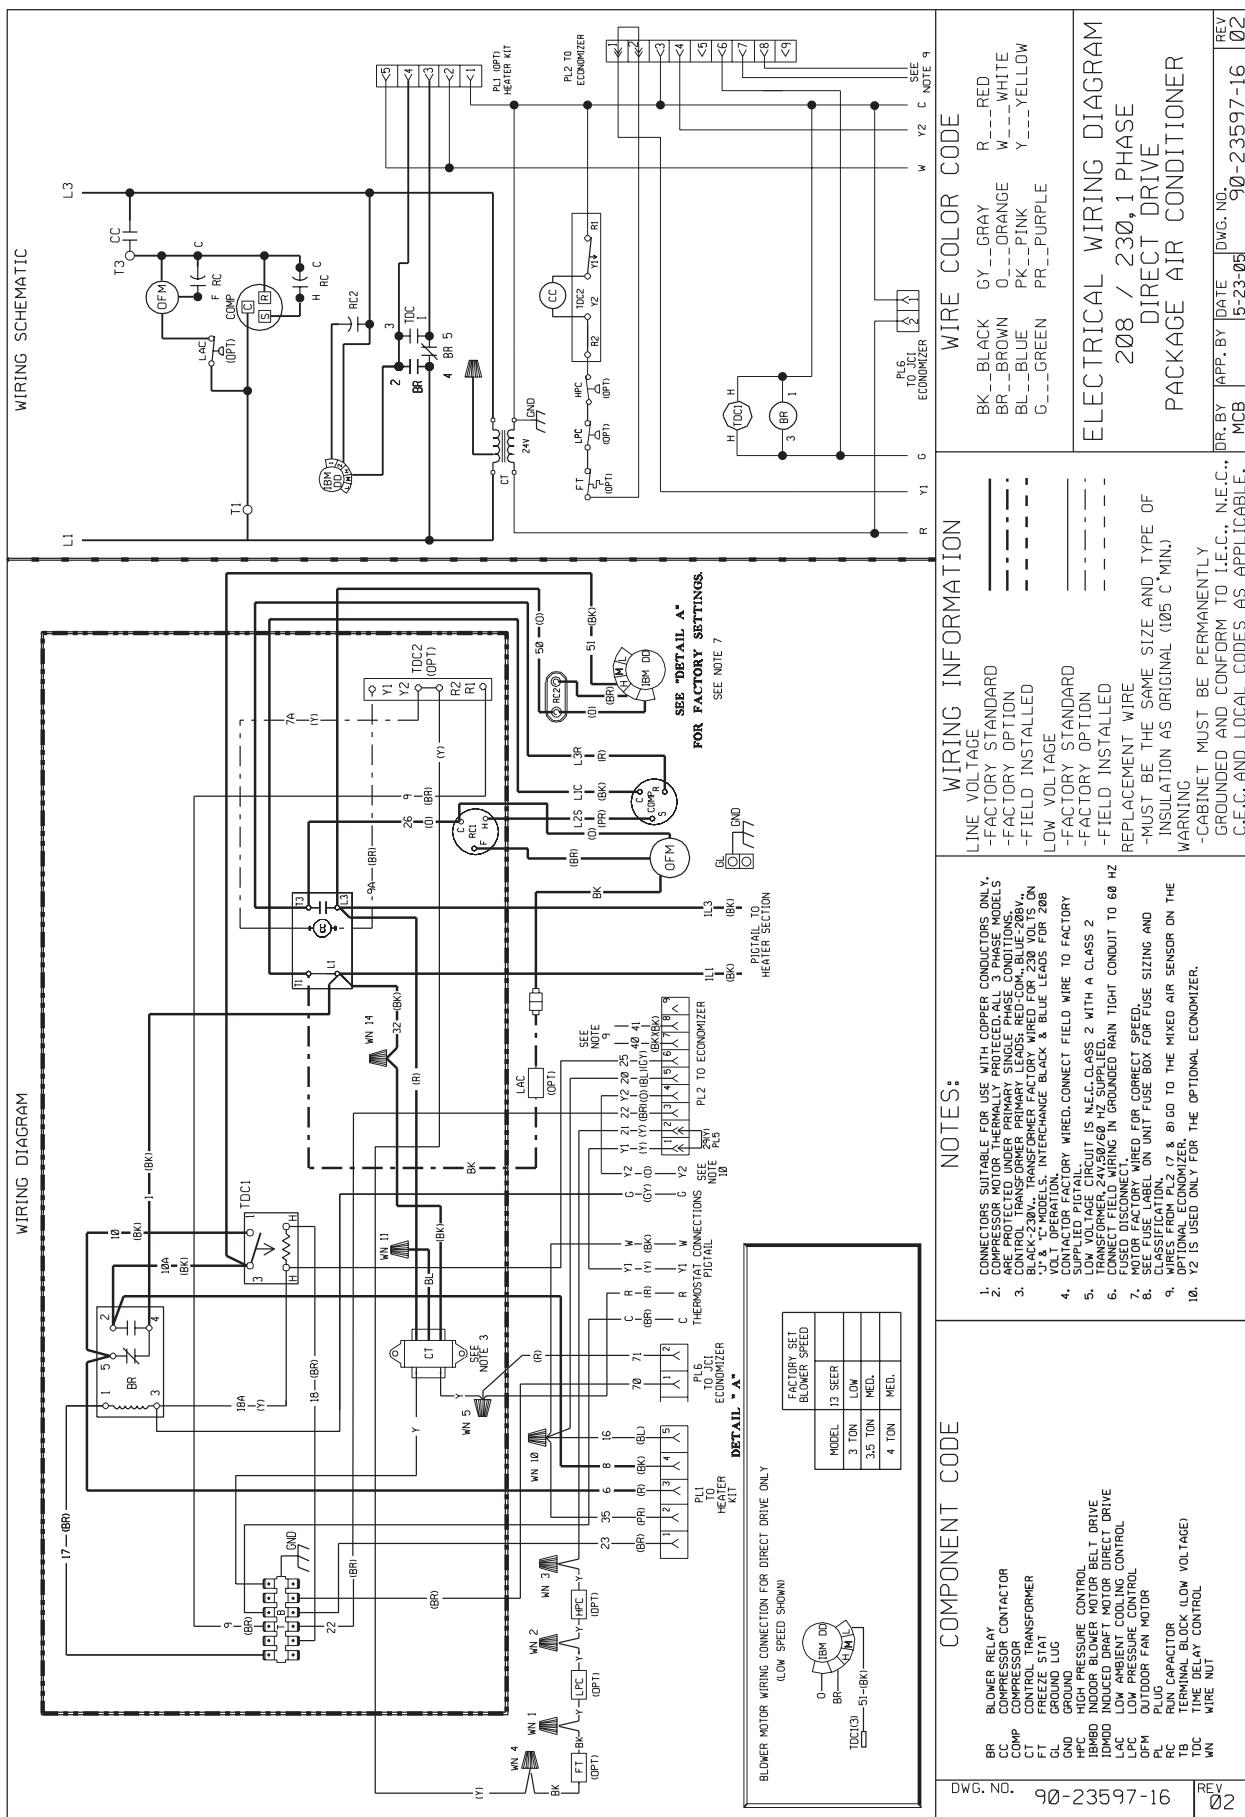


## 3 TON AIR CONDITIONER - 13 & 14 SEER

### SYSTEM CHARGE CHART - REFRIGERANT 410A 3 TON, 13 & 14 SEER

**CAUTION:** 1. RETURN AIR TEMPERATURE MUST BE WITHIN COMFORT CONDITIONS BEFORE FINAL REFRIGERANT CHECK!

**INSTRUCTIONS:** 1. MEASURE PRESSURE AT COMPRESSOR SUCTION AND LIQUID.  
2. MEASURE OUTDOOR AMBIENT TO UNIT.  
3. PLACE (X) ON CHART WHERE SUCTION AND LIQUID INTERSECT.  
4. IF (X) IS BELOW OUTDOOR AMBIENT LINE, ADD CHARGE AND REPEAT STEP 3.  
5. IF (X) IS ABOVE OUTDOOR AMBIENT LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3.

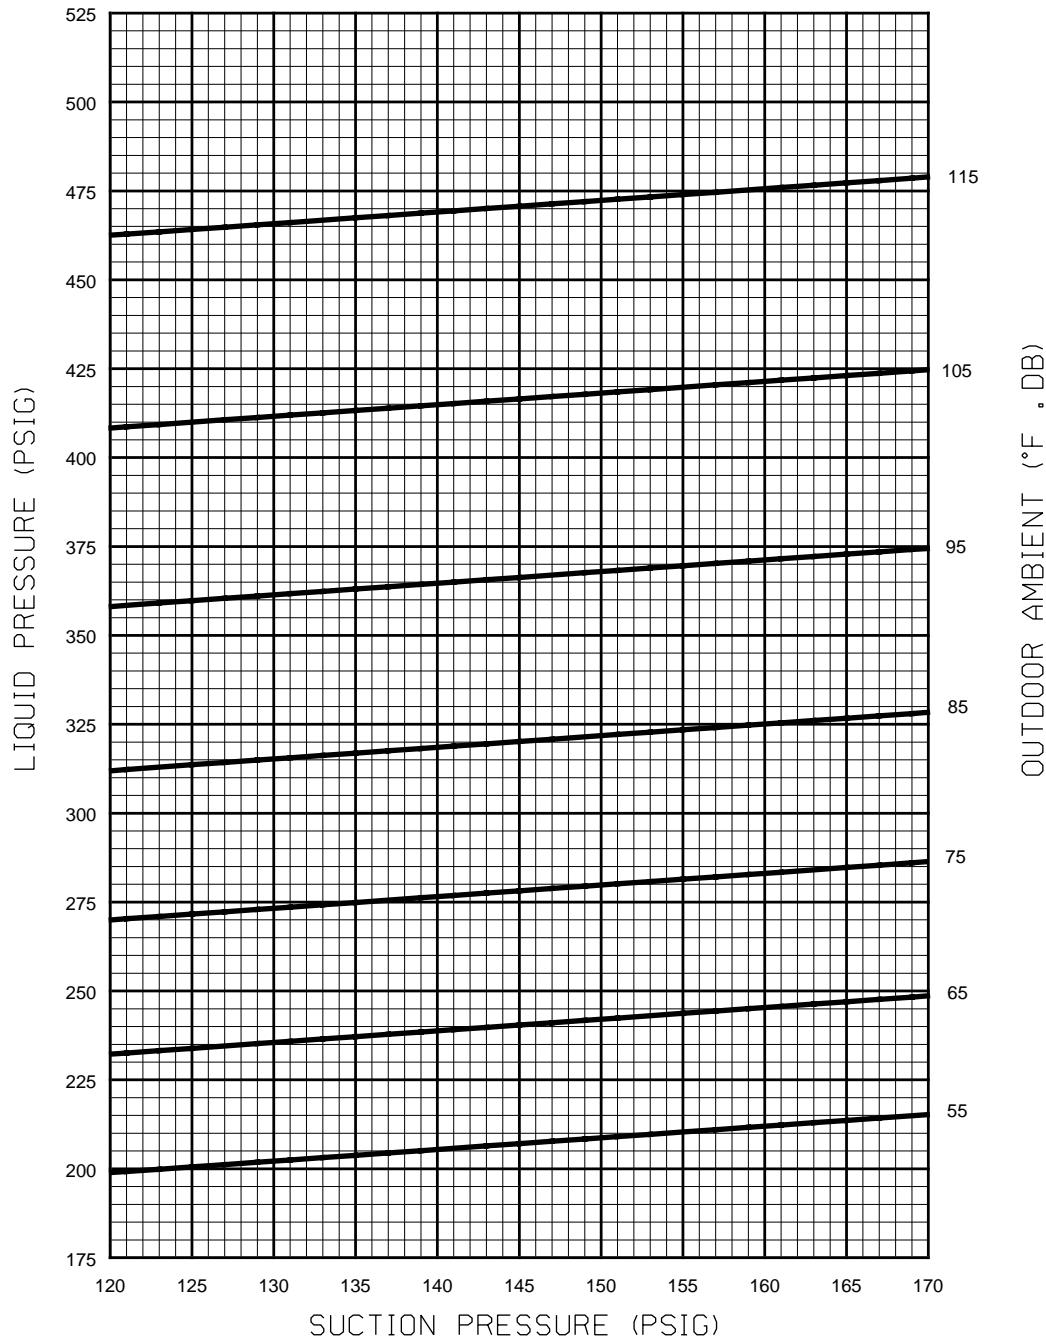


## 3.5 TON AIR CONDITIONER - 13 & 14 SEER

### SYSTEM CHARGE CHART - REFRIGERANT 410A 3.5 TON, 13 & 14 SEER

**CAUTION:** 1. RETURN AIR TEMPERATURE MUST BE WITHIN COMFORT CONDITIONS BEFORE FINAL REFRIGERANT CHECK!

**INSTRUCTIONS:** 1. MEASURE PRESSURE AT COMPRESSOR SUCTION AND LIQUID.  
2. MEASURE OUTDOOR AMBIENT TO UNIT.  
3. PLACE (X) ON CHART WHERE SUCTION AND LIQUID INTERSECT.  
4. IF (X) IS BELOW OUTDOOR AMBIENT LINE, ADD CHARGE AND REPEAT STEP 3.  
5. IF (X) IS ABOVE OUTDOOR AMBIENT LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3.

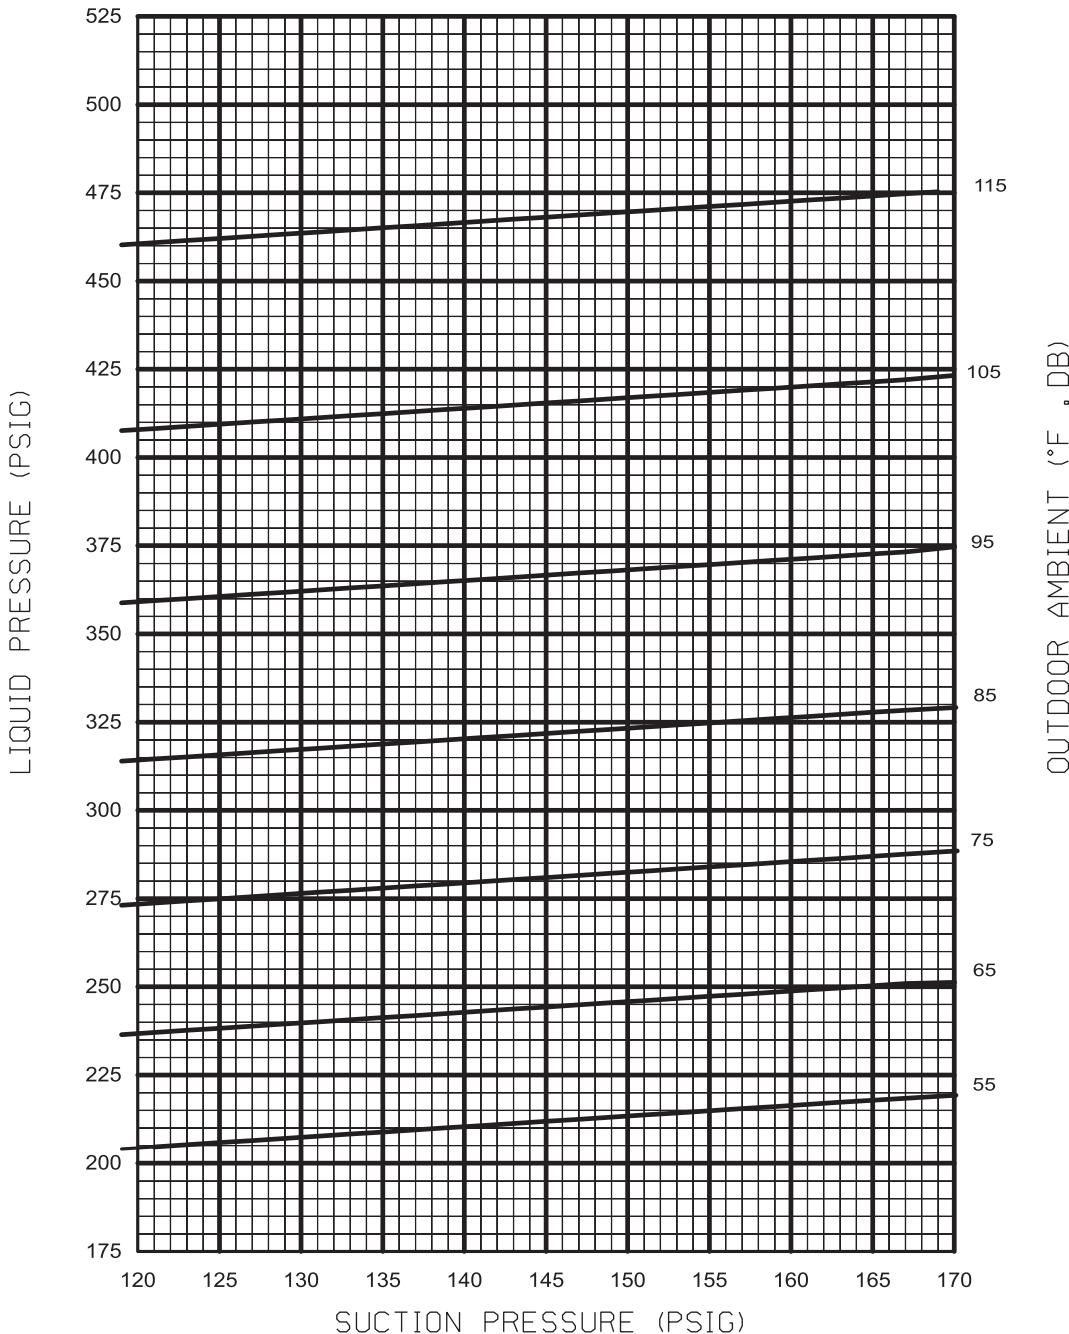


92-102259-02-00

## 4 TON AIR CONDITIONER - 13 & 14 SEER

### SYSTEM CHARGE CHART - REFRIGERANT 410A 4 TON, 13 & 14 SEER

**CAUTION:** 1. RETURN AIR TEMPERATURE MUST BE WITHIN COMFORT CONDITIONS BEFORE FINAL REFRIGERANT CHECK!

**INSTRUCTIONS:** 1. MEASURE PRESSURE AT COMPRESSOR SUCTION AND LIQUID.  
2. MEASURE OUTDOOR AMBIENT TO UNIT.  
3. PLACE (X) ON CHART WHERE SUCTION AND LIQUID INTERSECT.  
4. IF (X) IS BELOW OUTDOOR AMBIENT LINE, ADD CHARGE AND REPEAT STEP 3.  
5. IF (X) IS ABOVE OUTDOOR AMBIENT LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3.

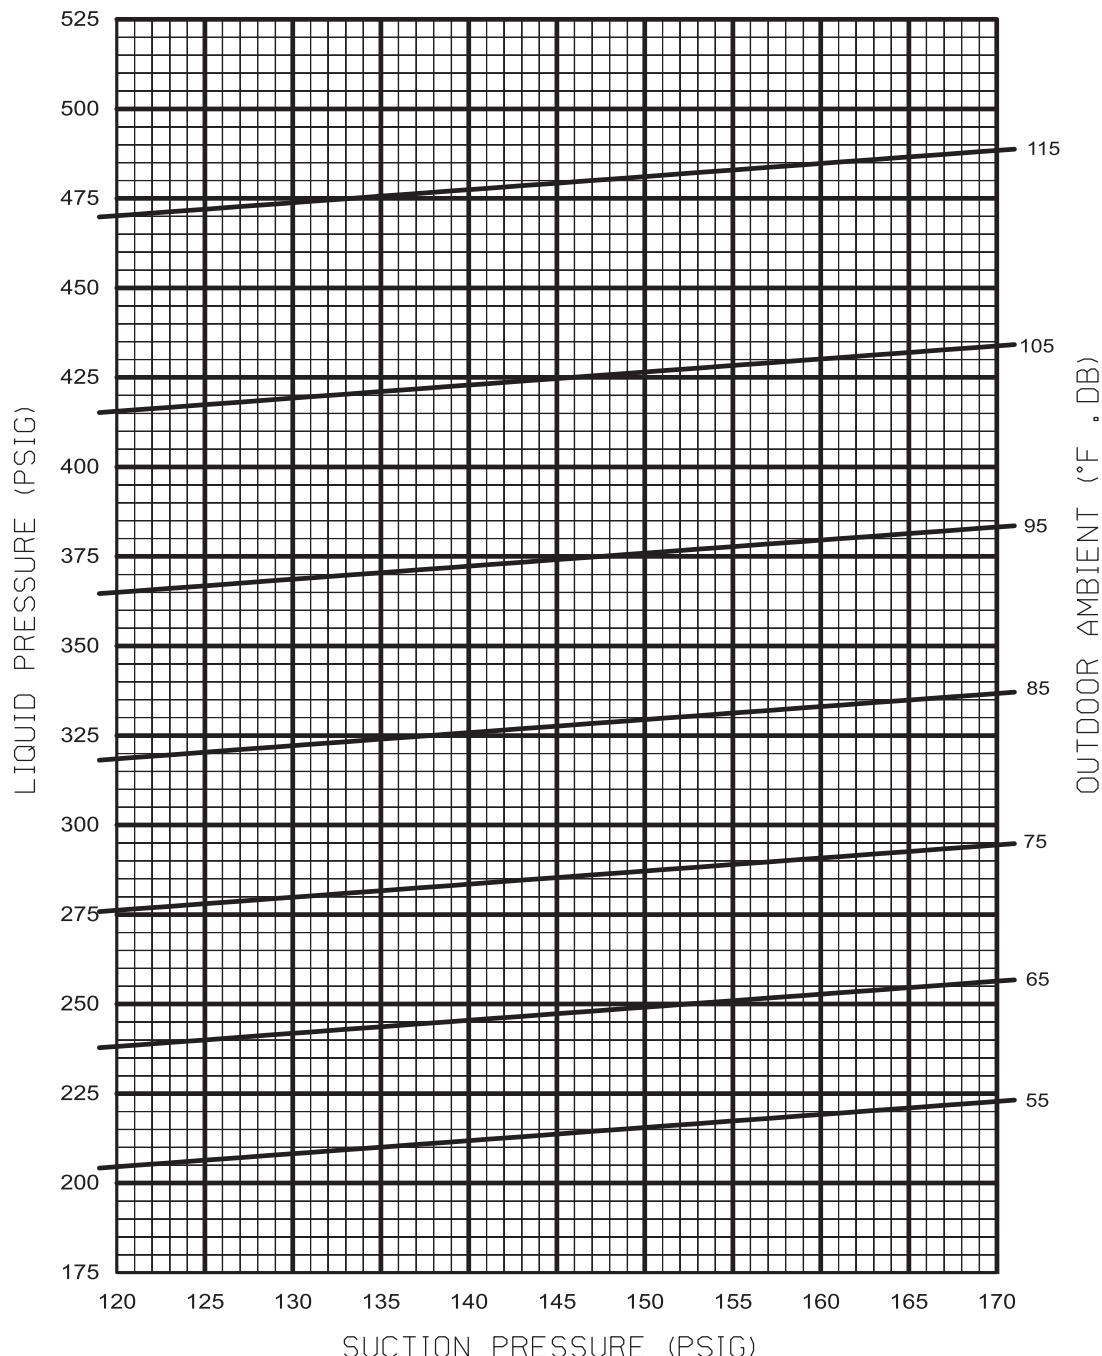


92-102259-03-00

## 5 TON AIR CONDITIONER - 13 SEER

### SYSTEM CHARGE CHART - REFRIGERANT 410A 5 TON, 13 SEER

**CAUTION:** 1. RETURN AIR TEMPERATURE MUST BE WITHIN COMFORT CONDITIONS BEFORE FINAL REFRIGERANT CHECK!

**INSTRUCTIONS:** 1. MEASURE PRESSURE AT COMPRESSOR SUCTION AND LIQUID.  
2. MEASURE OUTDOOR AMBIENT TO UNIT.  
3. PLACE (X) ON CHART WHERE SUCTION AND LIQUID INTERSECT.  
4. IF (X) IS BELOW OUTDOOR AMBIENT LINE, ADD CHARGE AND REPEAT STEP 3.  
5. IF (X) IS ABOVE OUTDOOR AMBIENT LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3.

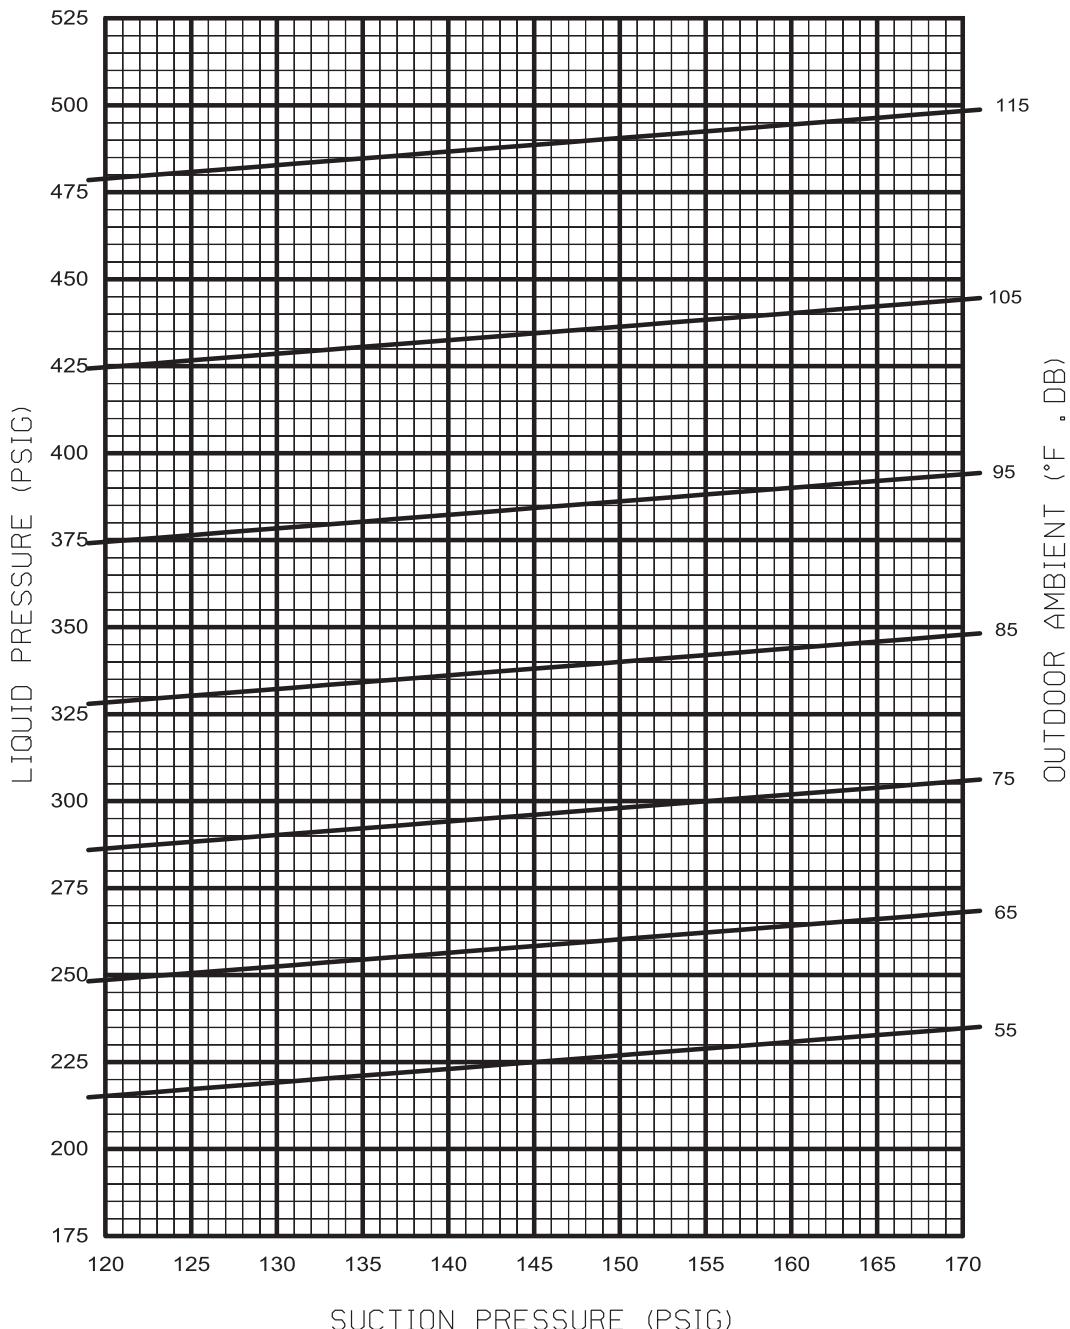


92-102259-04-00

# 5 TON AIR CONDITIONER - 14 SEER

## SYSTEM CHARGE CHART - REFRIGERANT 410A 5 TON, 14 SEER

**CAUTION:** 1. RETURN AIR TEMPERATURE MUST BE WITHIN COMFORT CONDITIONS BEFORE FINAL REFRIGERANT CHECK!

**INSTRUCTIONS:** 1. MEASURE PRESSURE AT COMPRESSOR SUCTION AND LIQUID.  
2. MEASURE OUTDOOR AMBIENT TO UNIT.  
3. PLACE (X) ON CHART WHERE SUCTION AND LIQUID INTERSECT.  
4. IF (X) IS BELOW OUTDOOR AMBIENT LINE, ADD CHARGE AND REPEAT STEP 3.  
5. IF (X) IS ABOVE OUTDOOR AMBIENT LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3.

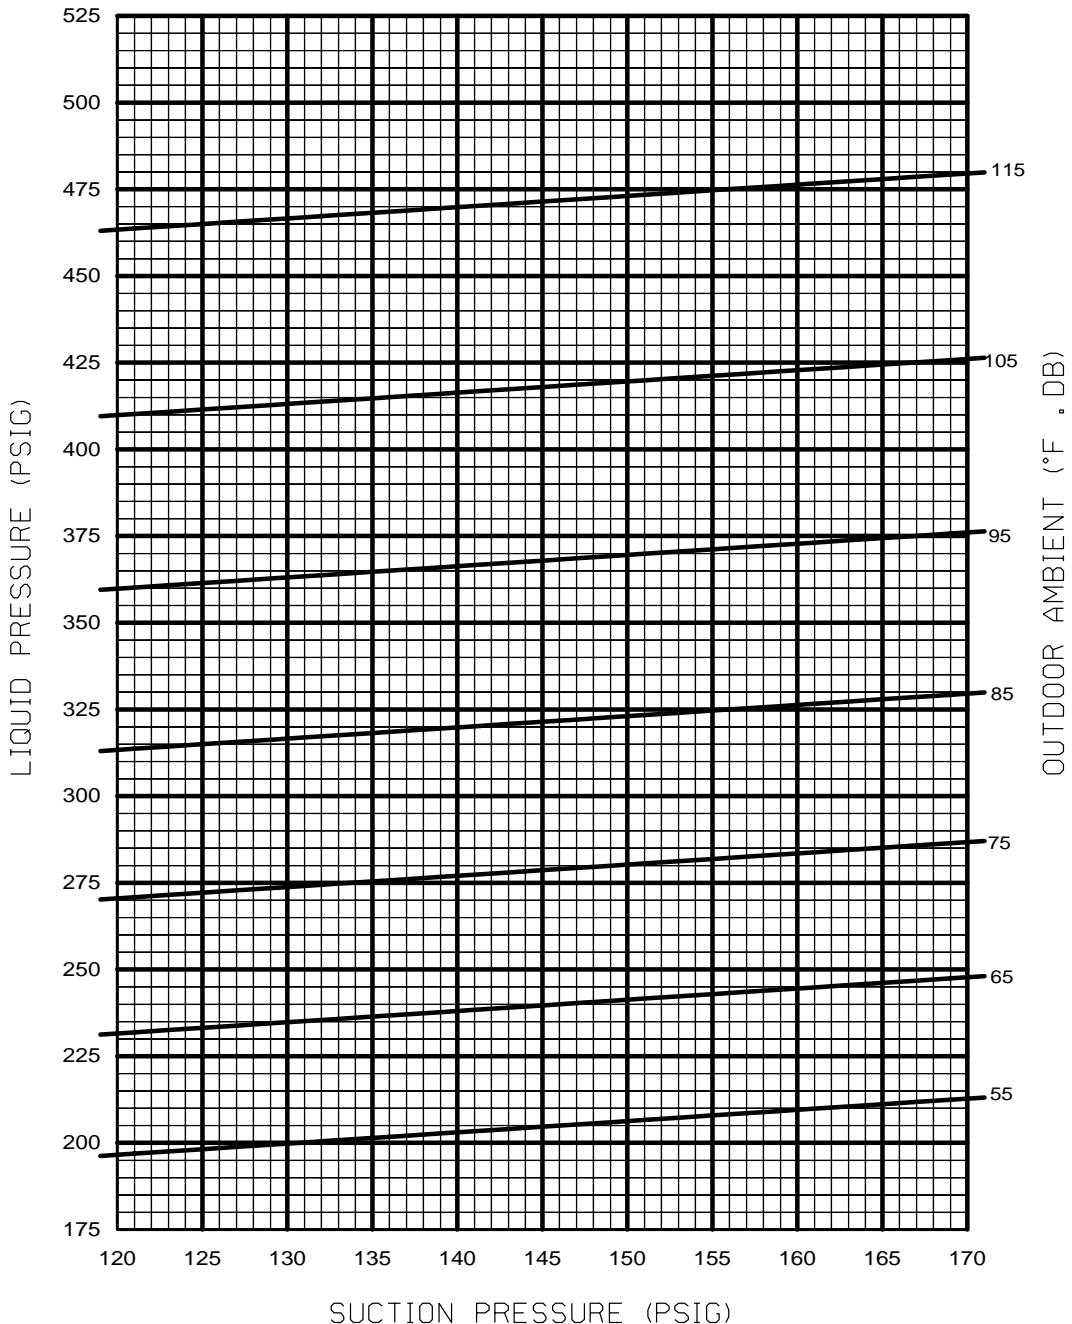

92-102259-05-00

# TROUBLE SHOOTING CHART

## **WARNING**

DISCONNECT ALL POWER TO UNIT BEFORE SERVICING. CONTACTOR MAY BREAK ONLY ONE SIDE. FAILURE TO SHUT OFF POWER CAN CAUSE ELECTRICAL SHOCK RESULTING IN PERSONAL INJURY OR DEATH.

SYMPTOM	POSSIBLE CAUSE	REMEDY
Unit will not run	<ul style="list-style-type: none"> <li>• Power off or loose electrical connection</li> <li>• Thermostat out of calibration-set too high</li> <li>• Defective contactor</li>   <li>• Blown fuses</li> <li>• Transformer defective</li> <li>• High pressure control open (if provided)</li>   <li>• Interconnecting low voltage wiring damaged</li> </ul>	<ul style="list-style-type: none"> <li>• Check for correct voltage at compressor contactor in control box</li> <li>• Reset</li> <li>• Check for 24 volts at contactor coil - replace if contacts are open</li> <li>• Replace fuses</li> <li>• Check wiring-replace transformer</li> <li>• Reset-also see high head pressure remedy-The high pressure control opens at 610 PSIG</li> <li>• Replace thermostat wiring</li> </ul>
Condenser fan runs, compressor doesn't	<ul style="list-style-type: none"> <li>• Run capacitor defective (single phase only)</li> <li>• Start relay defective (single phase on;y)</li> <li>• Loose connection</li>   <li>• Compressor stuck, grounded or open motor winding, open internal overload.</li> <li>• Low voltage condition</li>   <li>• Low voltage condition</li> </ul>	<ul style="list-style-type: none"> <li>• Replace</li> <li>• Replace</li> <li>• Check for correct voltage at compressor - check &amp; tighten all connections</li> <li>• Wait at least 2 hours for overload to reset. If still open, replace the compressor.</li> <li>• At compressor terminals, voltage must be within 10% of rating plate volts when unit is operating</li> <li>• Add start kit components</li> </ul>
Insufficient cooling	<ul style="list-style-type: none"> <li>• Improperly sized unit</li> <li>• Improper airflow</li> <li>• Incorrect refrigerant charge</li> <li>• Air, non-condensibles or moisture in system</li> <li>• Incorrect voltage</li> </ul>	<ul style="list-style-type: none"> <li>• Recalculate load</li> <li>• Check - should be approximately 400 CFM per ton.</li> <li>• Charge per procedure attached to unit service panel</li> <li>• Recover refrigerant, evacuate &amp; recharge, add filter drier</li> <li>• At compressor terminals, voltage must be within 10% of rating plate volts when unit is operating.</li> </ul>
Compressor short cycles	<ul style="list-style-type: none"> <li>• Incorrect voltage</li>   <li>• Defective overload protector</li> <li>• Refrigerant undercharge</li> </ul>	<ul style="list-style-type: none"> <li>• At compressor terminals, voltage must be <math>\pm 10\%</math> of nameplate marking when unit is operating.</li> <li>• Replace - check for correct voltage</li> <li>• Add refrigerant</li> </ul>
Registers sweat	<ul style="list-style-type: none"> <li>• Low evaporator airflow</li> </ul>	<ul style="list-style-type: none"> <li>• Increase speed of blower or reduce restriction - replace air filter</li> </ul>
High head-low vapor pressures	<ul style="list-style-type: none"> <li>• Restriction in liquid line, expansion device or filter drier</li> <li>• Flow check piston size too small</li> <li>• Incorrect capillary tubes</li> <li>• TXV does not open</li> </ul>	<ul style="list-style-type: none"> <li>• Remove or replace defective component</li> <li>• Change to correct size piston</li> <li>• Change coil assembly</li> <li>• Replace TXV</li> </ul>
High head-high or normal vapor pressure - Cooling mode	<ul style="list-style-type: none"> <li>• Dirty condenser coil</li> <li>• Refrigerant overcharge</li> <li>• Condenser fan not running</li> <li>• Air or non-condensibles in system</li> </ul>	<ul style="list-style-type: none"> <li>• Clean coil</li> <li>• Correct system charge</li> <li>• Repair or replace</li> <li>• Recover refrigerant, evacuate &amp; recharge</li> </ul>
Low head-high vapor pressures	<ul style="list-style-type: none"> <li>• Flow check piston size too large</li> <li>• Defective Compressor valves</li> <li>• Incorrect capillary tubes</li> </ul>	<ul style="list-style-type: none"> <li>• Change to correct size piston</li> <li>• Replace compressor</li> <li>• Replace coil assembly</li> </ul>
Low vapor - cool compressor - iced evaporator coil	<ul style="list-style-type: none"> <li>• Low evaporator airflow</li>   <li>• Operating below 65°F outdoors</li> <li>• Moisture in system</li> <li>• TXV limiting refrigerant flow</li> </ul>	<ul style="list-style-type: none"> <li>• Increase speed of blower or reduce restriction - replace air filter</li> <li>• Add Low Ambient Kit</li> <li>• Recover refrigerant - evacuate &amp; recharge - add filter drier</li> <li>• Replace TXV</li> </ul>
High vapor pressure	<ul style="list-style-type: none"> <li>• Excessive load</li> <li>• Defective compressor</li> </ul>	<ul style="list-style-type: none"> <li>• Recheck load calculation</li> <li>• Replace</li> </ul>
Fluctuating head & vapor pressures	<ul style="list-style-type: none"> <li>• TXV hunting</li>   <li>• Air or non-condensate in system</li> </ul>	<ul style="list-style-type: none"> <li>• Check TXV bulb clamp - check air distribution on coil - replace TXV</li> <li>• Recover refrigerant, evacuate &amp; recharge</li> </ul>
Gurgle or pulsing noise at expansion device or liquid line	<ul style="list-style-type: none"> <li>• Air or non-condensibles in system</li> </ul>	<ul style="list-style-type: none"> <li>• Recover refrigerant, evacuate &amp; recharge</li> </ul>





