

INSTALLATION INSTRUCTIONS

GFCI CONVENIENCE OUTLET

7½, 8½, 10, 12½, 15 AND 20 TON ROOFTOP AND PACKAGED A/C

▲ WARNING

THESE INSTRUCTIONS ARE INTENDED AS AN AID TO QUALIFIED SERVICE PERSONNEL FOR PROPER INSTALLATION, ADJUSTMENT, AND OPERATION OF THIS KIT. READ THESE INSTRUCTIONS THOROUGHLY BEFORE ATTEMPTING INSTALLATION, ADJUSTMENT, OR OPERATION. FAILURE TO FOLLOW THESE INSTRUCTIONS CAN RESULT IN IMPROPER INSTALLATION, ADJUSTMENT, SERVICE OR MAINTENANCE, POSSIBLY RESULTING IN FIRE, ELECTRICAL SHOCK, PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.

PARTS LIST

Description	Part Number	Quantity
Receptacle/Ground Fault	45-41954-01	1
Cover	45-41953-02	1
Outlet Box	45-41952-02	1
Wire	AS-50217-25-AH	1
Wire	AS-50221-25-AH	1
Wire	AS-50519-25-AH	1
Strain Relief	45-18753-01	1
Wire Tie	64-17606-01	2

▲ WARNING

BEFORE BEGINNING ANY MODIFICATION, BE SURE MAIN DISCONNECT SWITCH IS IN THE "OFF" POSITION. FAILURE TO DO SO CAN CAUSE ELECTRICAL SHOCK RESULTING IN PROPERTY DAMAGE, PERSONAL INJURY OR DEATH. TAG DISCONNECT WITH A SUITABLE WARNING LABEL.

INSTALLATION PROCEDURE

1. Connect the 3 wires to the receptacle.
2. Remove convenience outlet mounting hole cover plate and gasket and discard.
3. Use (2) screws to attach convenience outlet outdoor cover, gasket, GFCI convenience outlet with wires, and convenience outlet box.
4. Connect the three wires to an external 110 volt power source.

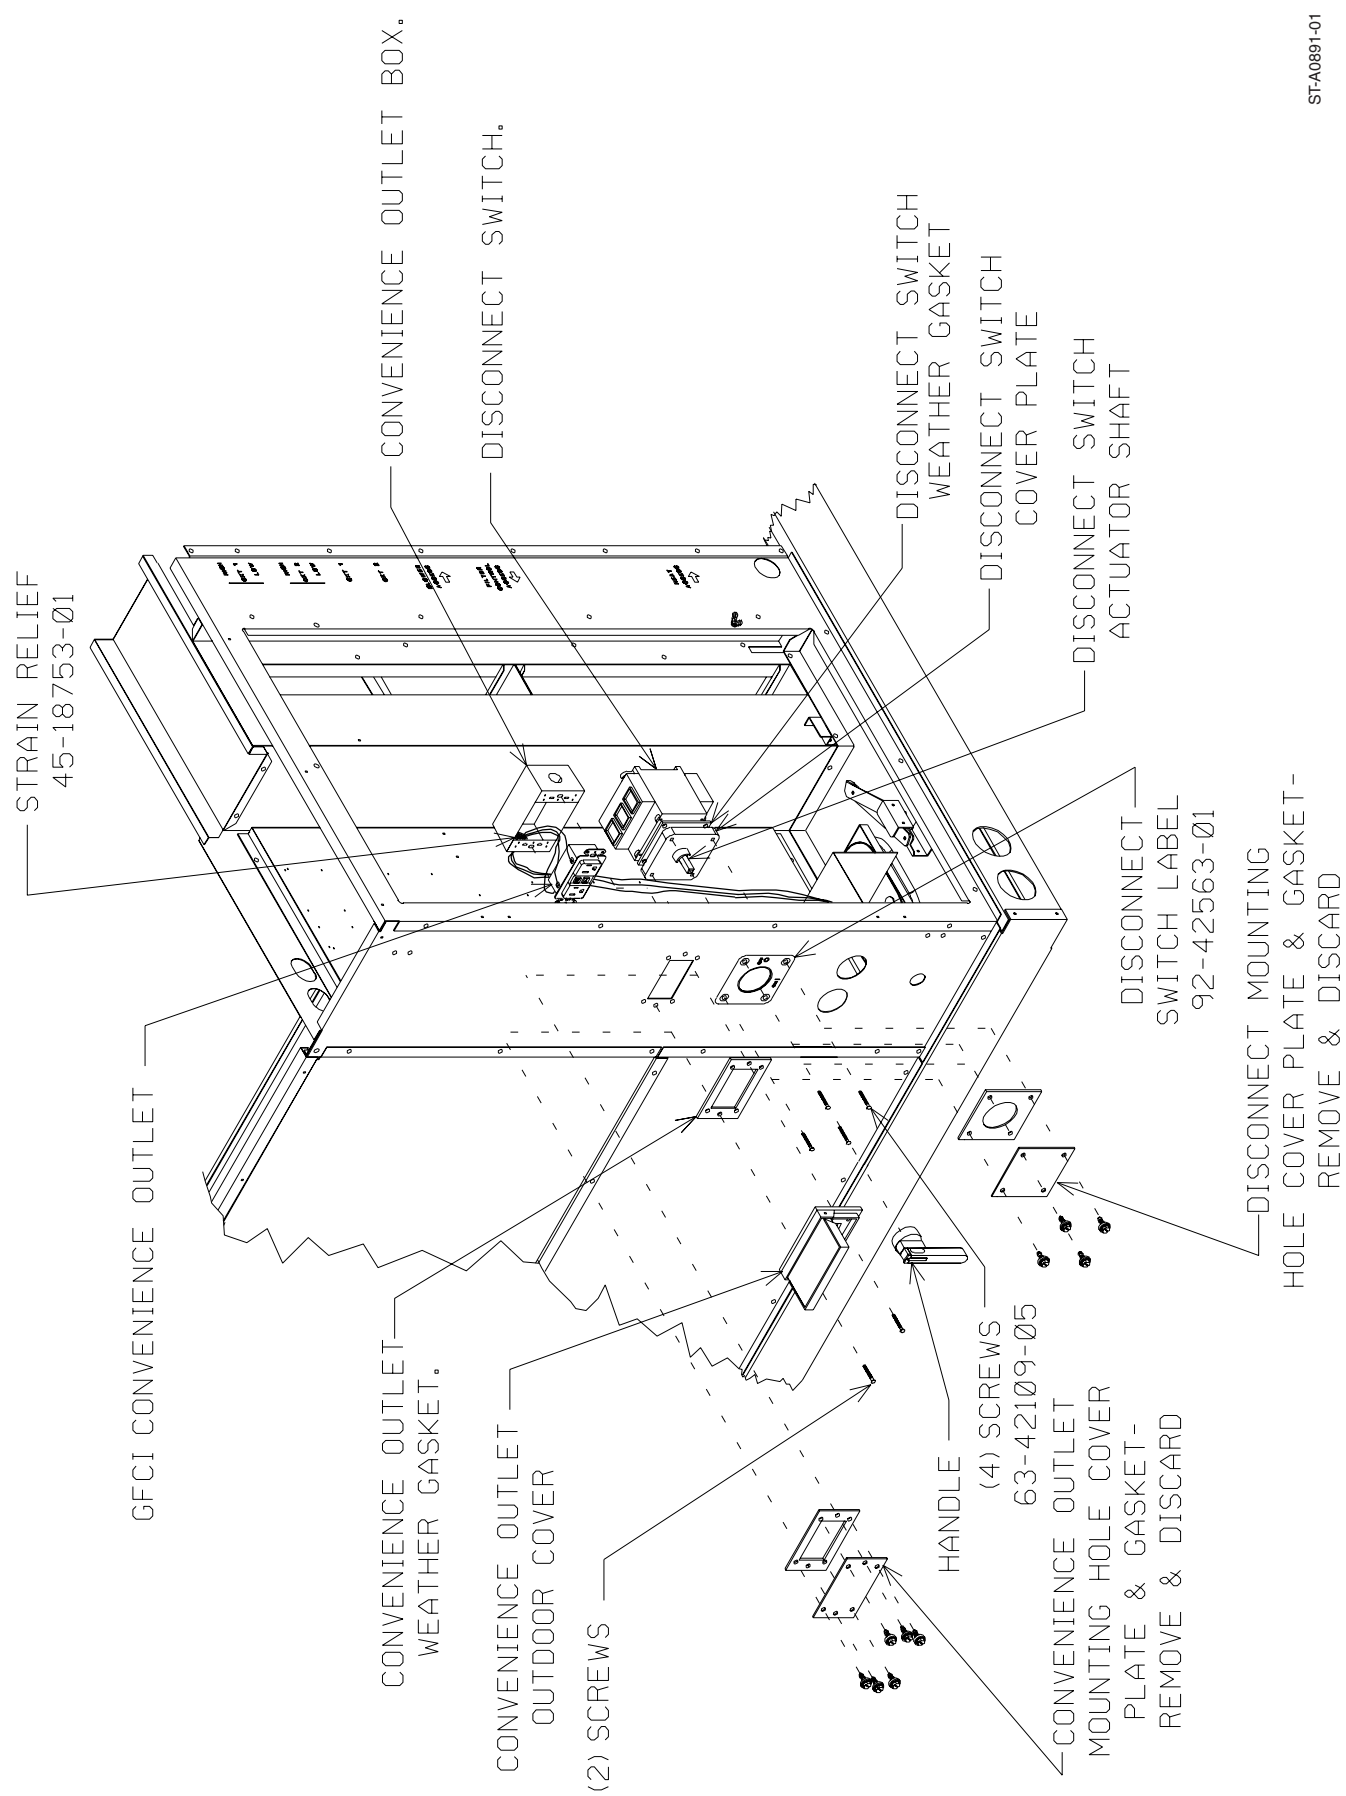


FIGURE 1

ST-A0891-01