

EFFICIENT 13 SEER AIR CONDITIONER

1½ THRU 5 TONS SPLIT SYSTEM

208 / 230 Volt, 1-phase, 60 Hz

REFRIGERATION CIRCUIT

- Copeland Scroll™ compressors on all models
- Copper tube / aluminum fin coil

EASY TO INSTALL AND SERVICE

- Easy Access service valves on all models
- External high and low refrigerant service ports
- Only two screws to access control panel
- Factory charged with R-22 refrigerant

BUILT TO LAST

- Pre-painted cabinet finish over galvanized steel
- Coated inlet grille with 2" spacing standard, alternate models available with ¾" grille spacing for extra protection

WARRANTY


- 5 year parts limited warranty (including compressor and coil)



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to www.ahrirectory.org.




Model Number	Size (tons)	Nominal BTU/hr	Min. Circuit Ampacity	Max. Fuse or Breaker	Operating Dimensions height x width x depth (in)	Ship / Operating Weight (lbs)
R2A318AKC	1½	18,000	10.1	15	24 ¹³ / ₁₆ x 23 ¹ / ₈ x 23 ¹ / ₈	120 / 105
18GKC	same model with ¾" spacing inlet grille					124 / 109
R2A324AKC	2	24,000	13.6	20	28 ⁷ / ₁₆ x 23 ¹ / ₈ x 23 ¹ / ₈	123 / 109
24GKC	same model with ¾" spacing inlet grille					128 / 113
R2A330AKC	2½	30,000	18.4	30	28 ⁷ / ₁₆ x 23 ¹ / ₈ x 23 ¹ / ₈	127 / 113
30GKC	same model with ¾" spacing inlet grille					131 / 117
R2A336AKC	3	36,000	19.1	30	24 ¹³ / ₁₆ x 31 ³ / ₁₆ x 31 ³ / ₁₆	157 / 135
36GKC	same model with ¾" spacing inlet grille					163 / 141
R2A342AKC	3½	42,000	25.4	40	31 ¹³ / ₁₆ x 31 ³ / ₁₆ x 31 ³ / ₁₆	188 / 165
42GKC	same model with ¾" spacing inlet grille					195 / 172
R2A348AKC	4	48,000	26.7	40	42 x 31 ³ / ₁₆ x 31 ³ / ₁₆	208 / 174
48GKC	same model with ¾" spacing inlet grille					219 / 184
R2A360AKC	5	60,000	33.1	50	35 ³ / ₁₆ x 31 ³ / ₁₆ x 31 ³ / ₁₆	233 / 208
60GKC	same model with ¾" spacing inlet grille					240 / 217

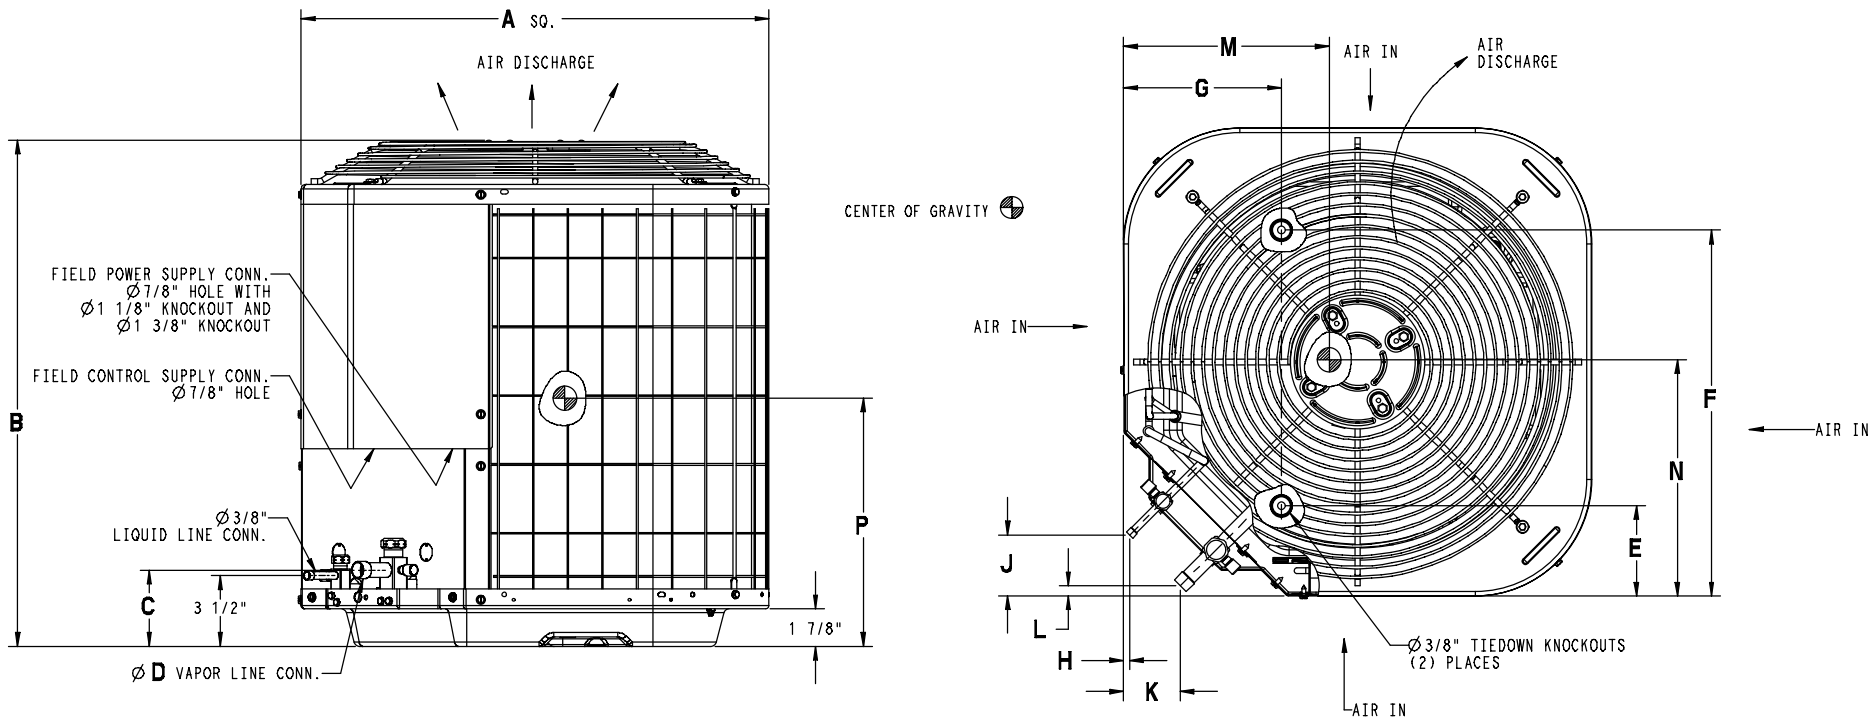

All Dimensions Inches

Model	All Dimensions Inches														Minimum Mounting Pad Size	Crated Dimensions B(h) x A(w) x A(d)
	A	B	C	D	E	F	G	H	J	K	L	M	N	P		
R2A318AKC	23 $\frac{3}{8}$	24 $\frac{13}{16}$	3 $\frac{3}{4}$	$\frac{3}{4}$	4 $\frac{7}{16}$	18 $\frac{1}{16}$	7 $\frac{13}{16}$	$\frac{5}{16}$	3	2 $\frac{13}{16}$	$\frac{1}{2}$	12	11 $\frac{3}{4}$	11 $\frac{7}{8}$	23 $\frac{1}{2}$ x 23 $\frac{1}{2}$	27 $\frac{3}{16}$ x 24 $\frac{1}{8}$ x 24 $\frac{1}{8}$
R2A324AKC	23 $\frac{3}{8}$	28 $\frac{7}{16}$	3 $\frac{3}{4}$	$\frac{3}{4}$	4 $\frac{7}{16}$	18 $\frac{1}{16}$	7 $\frac{13}{16}$	$\frac{5}{16}$	3	2 $\frac{13}{16}$	$\frac{1}{2}$	12	11 $\frac{3}{4}$	12 $\frac{1}{2}$	23 $\frac{1}{2}$ x 23 $\frac{1}{2}$	30 $\frac{5}{8}$ x 24 $\frac{1}{8}$ x 24 $\frac{1}{8}$
R2A330AKC	23 $\frac{3}{8}$	28 $\frac{7}{16}$	3 $\frac{3}{4}$	$\frac{3}{4}$	4 $\frac{7}{16}$	18 $\frac{1}{16}$	7 $\frac{13}{16}$	$\frac{5}{16}$	3	2 $\frac{13}{16}$	$\frac{1}{2}$	12	11 $\frac{3}{4}$	12 $\frac{7}{8}$	23 $\frac{1}{2}$ x 23 $\frac{1}{2}$	30 $\frac{5}{8}$ x 24 $\frac{1}{8}$ x 24 $\frac{1}{8}$
R2A336AKC	31 $\frac{3}{16}$	24 $\frac{13}{16}$	3 $\frac{7}{8}$	$\frac{7}{8}$	6 $\frac{9}{16}$	24 $\frac{11}{16}$	9 $\frac{1}{8}$	$\frac{5}{16}$	3	2 $\frac{15}{16}$	$\frac{5}{8}$	16	15 $\frac{1}{2}$	11 $\frac{5}{8}$	31 $\frac{1}{2}$ x 31 $\frac{1}{2}$	27 $\frac{3}{16}$ x 32 $\frac{3}{16}$ x 32 $\frac{3}{16}$
R2A342AKC	31 $\frac{3}{16}$	31 $\frac{13}{16}$	3 $\frac{7}{8}$	$\frac{7}{8}$	6 $\frac{9}{16}$	24 $\frac{11}{16}$	9 $\frac{1}{8}$	$\frac{5}{16}$	3	2 $\frac{15}{16}$	$\frac{5}{8}$	16	15 $\frac{1}{2}$	13 $\frac{3}{4}$	31 $\frac{1}{2}$ x 31 $\frac{1}{2}$	34 x 32 $\frac{3}{16}$ x 32 $\frac{3}{16}$
R2A348AKC	31 $\frac{3}{16}$	42	3 $\frac{7}{8}$	$\frac{7}{8}$	6 $\frac{9}{16}$	24 $\frac{11}{16}$	9 $\frac{1}{8}$	$\frac{5}{16}$	3	2 $\frac{15}{16}$	$\frac{5}{8}$	16	15 $\frac{1}{2}$	17	31 $\frac{1}{2}$ x 31 $\frac{1}{2}$	44 $\frac{1}{4}$ x 32 $\frac{3}{16}$ x 32 $\frac{3}{16}$
R2A360AKC	31 $\frac{3}{16}$	35 $\frac{3}{16}$	3 $\frac{7}{8}$	$\frac{7}{8}$	6 $\frac{9}{16}$	24 $\frac{11}{16}$	9 $\frac{1}{8}$	$\frac{5}{16}$	3	2 $\frac{15}{16}$	$\frac{5}{8}$	16	15 $\frac{1}{2}$	15 $\frac{1}{4}$	31 $\frac{1}{2}$ x 31 $\frac{1}{2}$	37 $\frac{3}{16}$ x 32 $\frac{3}{16}$ x 32 $\frac{3}{16}$

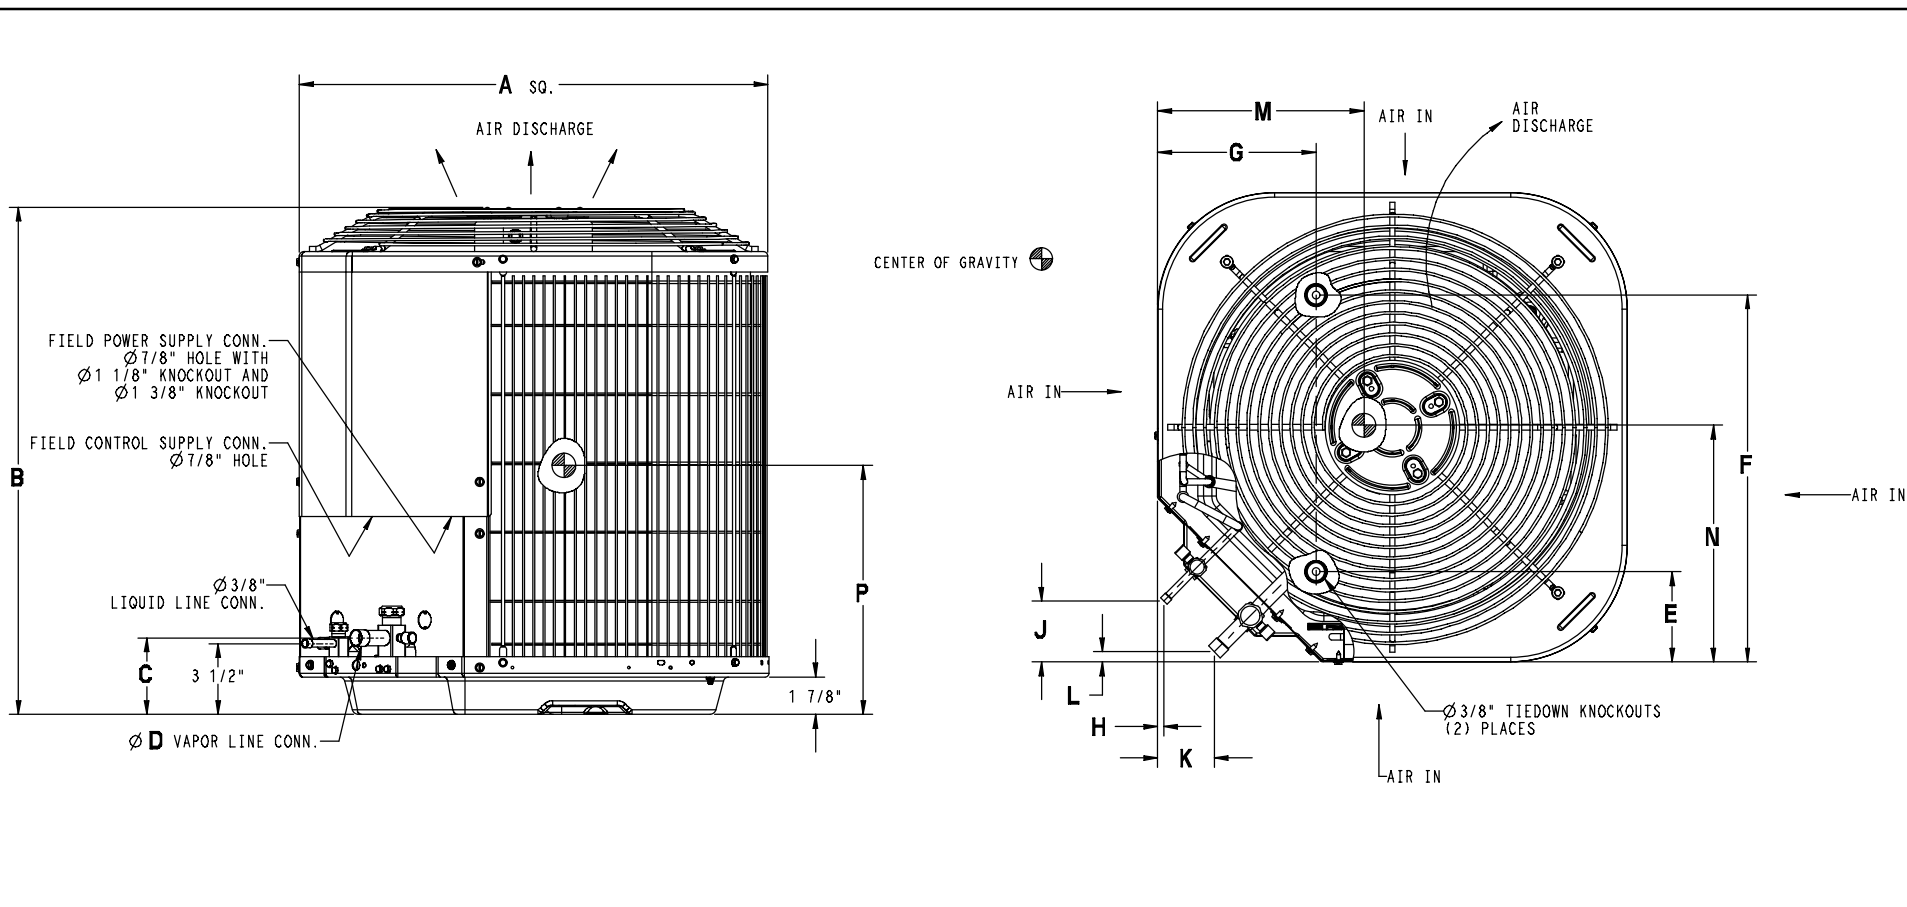

Model	All Dimensions Inches														Minimum Mounting Pad Size	Crated Dimensions B(h) x A(w) x A(d)
	A	B	C	D	E	F	G	H	J	K	L	M	N	P		
R2A318GKC	23 $\frac{1}{8}$	24 $\frac{13}{16}$	3 $\frac{3}{4}$	$\frac{3}{4}$	4 $\frac{7}{16}$	18 $\frac{1}{16}$	7 $\frac{13}{16}$	$\frac{5}{16}$	3	2 $\frac{13}{16}$	$\frac{1}{2}$	12	11 $\frac{3}{4}$	11 $\frac{7}{8}$	23 $\frac{1}{2}$ x 23 $\frac{1}{2}$	27 $\frac{3}{16}$ x 24 $\frac{1}{8}$ x 24 $\frac{1}{8}$
R2A324GKC	23 $\frac{1}{8}$	28 $\frac{7}{16}$	3 $\frac{3}{4}$	$\frac{3}{4}$	4 $\frac{7}{16}$	18 $\frac{1}{16}$	7 $\frac{13}{16}$	$\frac{5}{16}$	3	2 $\frac{13}{16}$	$\frac{1}{2}$	12	11 $\frac{3}{4}$	12 $\frac{1}{2}$	23 $\frac{1}{2}$ x 23 $\frac{1}{2}$	30 $\frac{5}{8}$ x 24 $\frac{1}{8}$ x 24 $\frac{1}{8}$
R2A330GKC	23 $\frac{1}{8}$	28 $\frac{7}{16}$	3 $\frac{3}{4}$	$\frac{3}{4}$	4 $\frac{7}{16}$	18 $\frac{1}{16}$	7 $\frac{13}{16}$	$\frac{5}{16}$	3	2 $\frac{13}{16}$	$\frac{1}{2}$	12	11 $\frac{3}{4}$	12 $\frac{7}{8}$	23 $\frac{1}{2}$ x 23 $\frac{1}{2}$	30 $\frac{5}{8}$ x 24 $\frac{1}{8}$ x 24 $\frac{1}{8}$
R2A336GKC	31 $\frac{3}{16}$	24 $\frac{13}{16}$	3 $\frac{7}{8}$	$\frac{7}{8}$	6 $\frac{9}{16}$	24 $\frac{1}{16}$	9 $\frac{1}{8}$	$\frac{5}{16}$	3	2 $\frac{15}{16}$	$\frac{5}{8}$	16	15 $\frac{1}{2}$	11 $\frac{5}{8}$	31 $\frac{1}{2}$ x 31 $\frac{1}{2}$	27 $\frac{3}{16}$ x 32 $\frac{3}{16}$ x 32 $\frac{3}{16}$
R2A342GKC	31 $\frac{3}{16}$	31 $\frac{13}{16}$	3 $\frac{7}{8}$	$\frac{7}{8}$	6 $\frac{9}{16}$	24 $\frac{1}{16}$	9 $\frac{1}{8}$	$\frac{5}{16}$	3	2 $\frac{15}{16}$	$\frac{5}{8}$	16	15 $\frac{1}{2}$	13 $\frac{3}{4}$	31 $\frac{1}{2}$ x 31 $\frac{1}{2}$	34 x 32 $\frac{3}{16}$ x 32 $\frac{3}{16}$
R2A348GKC	31 $\frac{3}{16}$	42	3 $\frac{7}{8}$	$\frac{7}{8}$	6 $\frac{9}{16}$	24 $\frac{1}{16}$	9 $\frac{1}{8}$	$\frac{5}{16}$	3	2 $\frac{15}{16}$	$\frac{5}{8}$	16	15 $\frac{1}{2}$	17	31 $\frac{1}{2}$ x 31 $\frac{1}{2}$	44 $\frac{1}{4}$ x 32 $\frac{3}{16}$ x 32 $\frac{3}{16}$
R2A360GKC	31 $\frac{3}{16}$	35 $\frac{3}{16}$	3 $\frac{7}{8}$	$\frac{7}{8}$	6 $\frac{9}{16}$	24 $\frac{1}{16}$	9 $\frac{1}{8}$	$\frac{5}{16}$	3	2 $\frac{15}{16}$	$\frac{5}{8}$	16	15 $\frac{1}{2}$	15 $\frac{1}{4}$	31 $\frac{1}{2}$ x 31 $\frac{1}{2}$	37 $\frac{7}{16}$ x 32 $\frac{3}{16}$ x 32 $\frac{3}{16}$

PHYSICAL DATA							
Model Size	18	24	30	36	42	48	60
Nominal Cooling Capacity (BTU/hr)	18,000	24,000	30,000	36,000	42,000	48,000	60,000
Nominal SEER	13.0	13.0	13.0	13.0	13.0	13.0	13.0
Sound Rating (dBA)**	76	76	77	76	80	80	80
PSC Fan Motor HP	1/12	1/12	1/10	1/5	1/4	1/4	1/4
Fan RPM (single speed)	1100	1100	1100	1100	1100	1100	1100
Fan CFM	1700	1700	2000	3100	3400	3400	3400
Coil Face Area (ft ²)	8.40	9.80	9.80	12.98	17.30	23.79	19.47
Coil Rows – fins per inch	1 – 25	1 – 25	1 – 25	1 – 25	1 – 25	1 – 25	2 – 20
Liquid Line Connection Size (in.)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Vapor Line Connection Size (in.)	3/4	3/4	3/4	7/8	7/8	7/8	7/8
Recommended Line Set Liquid Tube Diameter (in.)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Recommended Line Set Vapor Tube Diameter (in.)	3/4 *	3/4	3/4 *	7/8 *	7/8 *	1 1/8 *	1 1/8 *
* Recommended Vapor Tube Line size is for standard installations. These recommendations may not apply to “Long Line” installations. When the total equivalent line length exceeds 80 feet or there is more than 20 feet vertical separation between indoor and outdoor units, consult the Long Line Application Guideline document before purchasing/installing line sets.							
Factory Charge R-22 (lbs.)	3.56	4.08	4.11	5.35	7.01	8.88	10.52
Required Subcooling (°F)	8	10	10	10	10	10	10
Models AKC	Weight, shipping (lbs.)	120	123	127	157	188	233
	Weight, operating (lbs.)	105	109	113	135	165	208
Models GKC	Weight, shipping (lbs.)	124	128	131	163	195	240
	Weight, operating (lbs.)	109	113	117	141	172	217

ELECTRICAL DATA (208/230-1-60, voltage range 197V – 253V)							
Model Size	18	24	30	36	42	48	60
Minimum Circuit Ampacity – MCA (amps)	10.1	13.6	18.4	19.1	25.4	26.7	33.1
Maximum OverCurrent Protective device – MOCP (amps)	15	20	30	30	40	40	50
Compressor RLA (Rated Load Amps) LRA (Locked Rotor Amps)	7.7 40.3	10.4 54.0	14.1 68.0	14.4 77.0	19.2 104.0	20.2 137.0	25.3 141.0
Fan Motor FLA (Full Load Amps)	.5	.5	.77	1.1	1.4	1.4	1.4

**Sound Rating tested in accordance with ARI Standard 270-95 (not listed with ARI).

R-410A COOLING CAPACITY LOSS FOR VARIOUS LINE LENGTHS & TUBE DIAMETERS

Model Size	Liquid Line in.(mm)	Acceptable Vapor Line Sizes in. (mm)	Cooling Capacity Loss (%) at Total Equivalent Line Length, feet (m) Refer to Long Line Application Guideline to calculate equivalent length										
			Standard Application			Long Line Application (Requires Accessories)							
			25' (7.6)	50' (15.2)	80' (24.4)	81' (24.7)	100' (30.5)	125' (38.1)	150' (45.7)	175' (53.3)	200' (61)	225' (68.6)	250' (76.2)
18	3/8	5/8	0	1	1	1	2	3	3	4	5	5	6
		3/4	0	0	0	0	0	1	1	1	1	2	2
24		5/8	0	1	3	3	3	5	6	7	8	9	10
		3/4	0	0	0	0	1	1	1	2	2	3	3
30		3/4	0	1	1	1	2	3	3	4	5	5	6
		7/8	0	0	0	0	1	1	1	2	2	2	3
36		3/4	0	1	2	2	3	4	5	6	7	8	9
		7/8	0	0	1	1	1	2	2	3	3	4	4
42		3/4	1	2	3	3	4	5	7	8	9	10	11
		7/8	0	1	1	1	2	2	3	4	4	5	5
48		3/4	1	2	4	4	5	7	8	10	11	13	14
		7/8	0	1	2	2	2	3	4	5	5	6	7
	1 1/8	0	0	0	0	0	0	1	1	1	1	1	
60	7/8	1	2	3	3	4	5	7	8	9	10	11	
	1 1/8	0	0	1	1	1	1	2	2	2	3	3	

* Applications are considered “Long Line” if the total equivalent tubing length exceeds 80 feet or there is more than 20 foot vertical separation between indoor and outdoor units). These applications require additional accessories and system modifications for reliable system operation.

Applications in shaded area may have height restrictions that limit allowable total equivalent length when outdoor unit is below indoor unit.

ACCESSORY USAGE GUIDELINES

Accessory	REQUIRED FOR LOW-AMBIENT APPLICATIONS (Below 55° F)	REQUIRED FOR LONG-LINE APPLICATIONS* (Over 80 ft.)
Crankcase Heater	Yes	Yes
Evaporator Freeze Thermostat	Yes	No
Winter Start Control	Yes **	No
Hard Start Kit (Capacitor & Relay)	Yes	Yes
Low Ambient Kit (Pressure Switch)	Yes	No
Support Feet, 4” tall	Recommended	No
Liquid Line Solenoid Valve	No	See Long-Line Application Guideline

* For Line Set lengths between 80 and 200 ft horizontal, or more than 20 ft indoor-outdoor vertical separation, refer to the Long Line Application Guideline document.

** Can only be installed in conjunction with Low Pressure Switch.

ACCESSORIES		
Part Number	Description	Used On Model Size
NASA003CH	Crankcase Heater for Compressor	18, 24, 30, 36
NASA001CH	Crankcase Heater for Compressor	42, 48, 60
NASA001SC	Start Component – PTC Device	ALL
NASA001FS	Evaporator Freeze Thermostat	ALL
NASA203PS	Low Pressure Switch	ALL
NASA204PS	High Pressure Switch	ALL
NASA201LS	Liquid Line Solenoid Valve	ALL
NASA001TD	Time Delay Relay, Indoor Blower	ALL
NASA001WS	Winter Start Control	ALL
NASA001AC	Anti-Cycle Timer (5 minute delay)	ALL
NASA201LA	Low Ambient Kit (Pressure Switch)	ALL
NASA003SC	Hard Start Kit (Capacitor & Relay)	18, 24, 36, 42, 48
NASA005SC	Hard Start Kit (Capacitor & Relay)	30, 60
NASA001SF	Support Feet, 4" tall	18, 24, 30, 36, 42
NASA001SJ	Sound Jacket, Compressor	18, 24, 30, 36, 42, 48
NASA003SJ	Sound Jacket, Compressor	60
AMF153TKB	TXV Kit, R-22 (converts R-22 piston coils to R-22 TXV)	18, 24, 30, 36
AMF355TKB	TXV Kit, R-22 (converts R-22 piston coils to R-22 TXV)	42, 48, 60

COOLING PERFORMANCE FOR COMBINATION RATINGS								
Indoor Models								
Outdoor Model	Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER	
				BTU/hr	S/T	EER	factory	w/ field TDR
R2A318AKC R2A318GKC	‡EB*2X24B**		TXV	17,000	0.76	11.00		13.00
	EB*2X18B**	*8MPV050	TDR&TXV	16,400	0.76	11.00	13.50	
	EB*2X18B**	MV08B15**B*	TDR&TXV	16,400	0.76	12.00	14.00	
	EB*2X18B**		TXV	16,400	0.76	11.00		13.00
	EB*2X24B**	*8MPV050	TDR&TXV	16,400	0.76	12.00	14.00	
	EB*2X24B**	MV08B15**B*	TDR&TXV	16,400	0.76	12.00	14.00	
	EB*2X24F**	*9MPV050	TDR&TXV	16,400	0.76	12.00	14.00	
	EB*2X24F**	*9MPV075	TDR&TXV	16,400	0.76	12.00	14.00	
	EB*2X24F**		TXV	17,000	0.76	11.00		13.00
	ED*2X18B**	*8MPV050	TDR&TXV	16,400	0.76	11.00	13.50	
	ED*2X18B**	MV08B15**B*	TDR&TXV	16,400	0.76	12.00	14.00	
	ED*2X18B**		TXV	16,400	0.76	11.00		13.00
	ED*2X24B**	*8MPV050	TDR&TXV	16,400	0.76	12.00	14.00	
	ED*2X24B**	MV08B15**B*	TDR&TXV	16,400	0.76	12.00	14.00	
	ED*2X24B**		TXV	17,000	0.76	11.00		13.00
	ED*2X24F**	*9MPV050	TDR&TXV	16,400	0.76	12.00	14.00	
	ED*2X24F**	*9MPV075	TDR&TXV	16,400	0.76	12.00	14.00	
	ED*2X24F**		TXV	17,000	0.76	11.00		13.00
	EHD2X24A**	*8MPV050	TDR&TXV	16,400	0.76	12.00	14.00	
	EHD2X24A**	*9MPV050	TDR&TXV	16,400	0.76	12.00	14.00	
	EHD2X24A**	*9MPV075	TDR&TXV	16,400	0.76	12.00	14.00	
	EHD2X24A**	MV08B15**B*	TDR&TXV	16,400	0.76	12.00	14.00	
	EHD2X24A**		TXV	17,000	0.76	11.00		13.00
	EMA2X24D**		TXV	17,000	0.76	11.00		13.00
	FEM2X18****		TDR&TXV	17,400	0.76	11.00	13.50	
	FEM2X24****		TDR&TXV	16,400	0.76	12.00	14.00	
	FS(M,U)2X24****		TDR&TXV	16,400	0.76	11.00	13.00	
FSA2X18****		TDR&TXV	16,400	0.76	11.00	13.00		
FSA2X24****		TDR&TXV	16,400	0.76	11.00	13.00		
FVM2X24****		TDR&TXV	16,400	0.76	12.00	14.00		
R2A324AKC R2A324GKC	‡EB*2X24B**		TXV	23,000	0.75	11.00		13.00
	EB*2X24B**	*8MPV050	TDR&TXV	23,000	0.75	11.00	13.50	
	EB*2X24B**	MV08B15**B*	TDR&TXV	23,000	0.75	12.00	14.00	
	EB*2X24F**	*8MPV075	TDR&TXV	23,000	0.75	12.00	14.00	
	EB*2X24F**	*9MPV050	TDR&TXV	23,000	0.75	11.00	13.50	
	EB*2X24F**	*9MPV075	TDR&TXV	23,000	0.75	11.00	13.50	
	EB*2X24F**	MV12F19**B*	TDR&TXV	23,000	0.75	12.00	14.00	
	EB*2X24F**		TXV	23,000	0.75	11.00		13.00
	EB*2X30B**	*8MPV050	TDR&TXV	23,000	0.75	11.00	13.50	
	EB*2X30B**	MV08B15**B*	TDR&TXV	23,000	0.75	12.00	14.00	
	EB*2X30B**		TXV	23,000	0.75	11.00		13.00
	EB*2X30F**	*8MPV075	TDR&TXV	23,000	0.75	12.00	14.00	
	EB*2X30F**	*9MPV050	TDR&TXV	23,000	0.75	11.00	13.50	
	EB*2X30F**	*9MPV075	TDR&TXV	23,000	0.75	11.00	13.50	
	EB*2X30F**	MV12F19**B*	TDR&TXV	23,000	0.75	12.00	14.00	
	EB*2X30F**		TXV	23,000	0.75	11.00		13.00
	ED*2X24B**	*8MPV050	TDR&TXV	23,000	0.75	11.00	13.50	
	ED*2X24B**	MV08B15**B*	TDR&TXV	23,000	0.75	12.00	14.00	
	ED*2X24B**		TXV	23,000	0.75	11.00		13.00
	ED*2X24F**	*8MPV075	TDR&TXV	23,000	0.75	12.00	14.00	
	ED*2X24F**	*9MPV050	TDR&TXV	23,000	0.75	11.00	13.50	
	ED*2X24F**	*9MPV075	TDR&TXV	23,000	0.75	11.00	13.50	
	ED*2X24F**	MV12F19**B*	TDR&TXV	23,000	0.75	12.00	14.00	
	ED*2X24F**		TXV	23,000	0.75	11.00		13.00
	ED*2X30B**	*8MPV050	TDR&TXV	23,000	0.75	11.00	13.50	

- continued on next page -

COOLING PERFORMANCE FOR COMBINATION RATINGS (continued)									
Indoor Models									
Outdoor Model	Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER		
				BTU/hr	S/T	EER	factory	w/ field TDR	
R2A324AKC R2A324GKC (continued)	ED*2X30B**	MV08B15**B*	TDR&TXV	23,000	0.75	12.00	14.00		
	ED*2X30B**		TXV	23,000	0.75	11.00		13.00	
	ED*2X30F**	*8MPV075	TDR&TXV	23,000	0.75	12.00	14.00		
	ED*2X30F**	*9MPV050	TDR&TXV	23,000	0.75	11.00	13.50		
	ED*2X30F**	*9MPV075	TDR&TXV	23,000	0.75	11.00	13.50		
	ED*2X30F**	MV12F19**B*	TDR&TXV	23,000	0.75	12.00	15.00		
	ED*2X30F**		TXV	23,000	0.75	11.00		13.00	
	EHD2X24A**	*8MPV050	TDR&TXV	23,000	0.75	11.00	13.50		
	EHD2X24A**	*8MPV075	TDR&TXV	23,000	0.75	11.00	13.50		
	EHD2X24A**	*8MPV100	TDR&TXV	23,000	0.75	12.00	14.00		
	EHD2X24A**	*8MPV125	TDR&TXV	23,000	0.75	12.00	14.00		
	EHD2X24A**	*9MPV050	TDR&TXV	23,000	0.75	11.00	13.50		
	EHD2X24A**	*9MPV075	TDR&TXV	23,000	0.75	11.00	13.50		
	EHD2X24A**	*9MPV100	TDR&TXV	23,000	0.75	11.00	13.50		
	EHD2X24A**	*9MPV125	TDR&TXV	23,000	0.75	11.00	13.50		
	EHD2X24A**	MV08B15**B*	TDR&TXV	23,000	0.75	12.00	14.00		
	EHD2X24A**	MV12F19**B*	TDR&TXV	23,000	0.75	12.00	14.00		
	EHD2X24A**		TXV	23,000	0.75	11.00		13.00	
	EHD2X30A**	*8MPV050	TDR&TXV	23,000	0.75	11.00	13.50		
	EHD2X30A**	*8MPV075	TDR&TXV	23,000	0.75	12.00	14.00		
	EHD2X30A**	*8MPV100	TDR&TXV	23,000	0.75	12.00	14.00		
	EHD2X30A**	*8MPV125	TDR&TXV	23,000	0.75	12.00	14.00		
	EHD2X30A**	*9MPV050	TDR&TXV	23,000	0.75	11.00	13.50		
	EHD2X30A**	*9MPV075	TDR&TXV	23,000	0.75	11.00	13.50		
	EHD2X30A**	*9MPV100	TDR&TXV	23,000	0.75	11.00	13.50		
	EHD2X30A**	*9MPV125	TDR&TXV	23,000	0.75	12.00	14.00		
	EHD2X30A**	MV08B15**B*	TDR&TXV	23,000	0.75	12.00	14.00		
	EHD2X30A**	MV12F19**B*	TDR&TXV	23,000	0.75	12.00	14.00		
	EHD2X30A**		TXV	23,000	0.75	11.00		13.00	
	EMA2X24D**		TXV	23,000	0.75	11.00		13.00	
	FEM2X24****		TDR&TXV	22,600	0.75	11.00	13.50		
	FEM2X30****		TDR&TXV	23,000	0.75	11.00	13.50		
	FS(M,U)2X24****		TDR&TXV	22,600	0.75	11.00	13.00		
	FS(M,U)2X30****		TDR&TXV	22,600	0.75	11.00	13.00		
	FSA2X24****		TDR&TXV	22,600	0.75	11.00	13.00		
	FSA2X30****		TDR&TXV	22,600	0.75	11.00	13.00		
	FVM2X24****		TDR&TXV	23,000	0.75	12.00	14.00		
	FVM2X36****		TDR&TXV	22,800	0.75	12.00	14.00		
	R2A330AKC R2A330GKC	‡EB*2X36F**		TXV	28,000	0.77	11.00		13.00
		EB*2X30B**	MV08B15**B*	TDR&TXV	28,000	0.77	11.00	13.50	
EB*2X30B**			TXV	27,000	0.77	11.00		13.00	
EB*2X30F**		*8MPV075	TDR&TXV	28,000	0.77	11.00	13.50		
EB*2X30F**		*9MPV050	TDR&TXV	27,000	0.77	11.00	13.50		
EB*2X30F**		*9MPV075	TDR&TXV	27,000	0.77	11.00	13.50		
EB*2X30F**		MV12F19**B*	TDR&TXV	28,000	0.77	12.00	14.00		
EB*2X30F**			TXV	27,000	0.77	11.00		13.00	
EB*2X36B**		MV08B15**B*	TDR&TXV	28,000	0.77	11.00	13.50		
EB*2X36B**			TXV	28,000	0.77	11.00		13.00	
EB*2X36F**		*8MPV075	TDR&TXV	28,000	0.77	11.00	13.50		
EB*2X36F**		*9MPV050	TDR&TXV	28,000	0.77	11.00	13.50		
EB*2X36F**		*9MPV075	TDR&TXV	28,000	0.77	11.00	13.50		
EB*2X36F**		MV12F19**B*	TDR&TXV	28,000	0.77	12.00	14.00		
EB*2X36J**		*8MPV100	TDR&TXV	28,000	0.77	11.00	13.50		
EB*2X36J**		*8MPV125	TDR&TXV	28,000	0.77	11.00	13.50		
EB*2X36J**		*9MPV100	TDR&TXV	28,000	0.77	11.00	13.50		

- continued on next page -

COOLING PERFORMANCE FOR COMBINATION RATINGS (continued)								
Indoor Models								
Outdoor Model	Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER	
				BTU/hr	S/T	EER	factory	w/ field TDR
R2A330AKC R2A330GKC (continued)	EB*2X36J**		TXV	28,000	0.77	11.00		13.00
	ED*2X30B**	MV08B15**B*	TDR&TXV	28,000	0.77	11.00	13.50	
	ED*2X30B**		TXV	27,000	0.77	11.00		13.00
	ED*2X30F**	*8MPV075	TDR&TXV	28,000	0.77	11.00	13.50	
	ED*2X30F**	*9MPV050	TDR&TXV	27,000	0.77	11.00	13.50	
	ED*2X30F**	*9MPV075	TDR&TXV	28,000	0.77	11.00	13.50	
	ED*2X30F**	MV12F19**B*	TDR&TXV	28,000	0.77	12.00	14.00	
	ED*2X30F**		TXV	27,000	0.77	11.00		13.00
	ED*2X36B**	MV08B15**B*	TDR&TXV	28,000	0.77	11.00	13.50	
	ED*2X36B**		TXV	28,000	0.77	11.00		13.00
	ED*2X36F**	*8MPV075	TDR&TXV	28,000	0.77	11.00	13.50	
	ED*2X36F**	*9MPV050	TDR&TXV	28,000	0.77	11.00	13.50	
	ED*2X36F**	*9MPV075	TDR&TXV	28,000	0.77	11.00	13.50	
	ED*2X36F**	MV12F19**B*	TDR&TXV	28,000	0.77	12.00	14.00	
	ED*2X36F**		TXV	28,000	0.77	11.00		13.00
	ED*2X36J**	*8MPV125	TDR&TXV	28,000	0.77	11.00	13.50	
	ED*2X36J**	*9MPV100	TDR&TXV	28,000	0.77	11.00	13.50	
	ED*2X36J**		TXV	28,000	0.77	11.00		13.00
	EHD2X30A**	*8MPV075	TDR&TXV	28,000	0.77	11.00	13.50	
	EHD2X30A**	*8MPV100	TDR&TXV	28,000	0.77	11.00	13.50	
	EHD2X30A**	*8MPV125	TDR&TXV	28,000	0.77	11.00	13.50	
	EHD2X30A**	*9MPV050	TDR&TXV	27,000	0.77	11.00	13.50	
	EHD2X30A**	*9MPV075	TDR&TXV	27,000	0.77	11.00	13.50	
	EHD2X30A**	*9MPV100	TDR&TXV	28,000	0.77	11.00	13.50	
	EHD2X30A**	*9MPV125	TDR&TXV	28,000	0.77	11.00	13.50	
	EHD2X30A**	MV08B15**B*	TDR&TXV	28,000	0.77	12.00	14.00	
	EHD2X30A**	MV12F19**B*	TDR&TXV	28,000	0.77	12.00	14.00	
	EHD2X30A**		TXV	27,000	0.77	11.00		13.00
	EHD2X36A**	*8MPV075	TDR&TXV	28,000	0.77	11.00	13.50	
	EHD2X36A**	*8MPV100	TDR&TXV	28,000	0.77	12.00	14.00	
	EHD2X36A**	*8MPV125	TDR&TXV	28,000	0.77	11.00	14.00	
	EHD2X36A**	*9MPV050	TDR&TXV	28,000	0.77	11.00	13.50	
	EHD2X36A**	*9MPV075	TDR&TXV	28,000	0.77	11.00	13.50	
	EHD2X36A**	*9MPV100	TDR&TXV	28,000	0.77	11.00	13.50	
	EHD2X36A**	*9MPV125	TDR&TXV	28,000	0.77	12.00	14.00	
	EHD2X36A**	MV08B15**B*	TDR&TXV	28,000	0.77	12.00	14.00	
	EHD2X36A**	MV12F19**B*	TDR&TXV	28,000	0.77	12.00	14.00	
	EHD2X36A**		TXV	28,000	0.77	11.00		13.00
	EMA2X36D**		TXV	28,000	0.77	11.00		13.00
	FEM2X30****		TDR&TXV	27,000	0.77	11.00	13.00	
FEM2X35****		TDR&TXV	28,000	0.77	11.00	13.50		
FEM2X36****		TDR&TXV	28,000	0.77	11.00	13.50		
FS(M,U)2X30****		TDR&TXV	27,000	0.77	11.00	13.00		
FSA2X30****		TDR&TXV	27,000	0.77	11.00	13.00		
FSA2X36****		TDR&TXV	28,000	0.77	11.00	13.00		
FSM2X36****		TDR&TXV	28,000	0.77	11.00	13.30		
FVM2X24****		TDR&TXV	28,000	0.77	11.00	13.50		
FVM2X36****		TDR&TXV	28,000	0.77	12.00	14.00		
FVM2X48****		TDR&TXV	28,000	0.77	12.00	14.00		
R2A336AKC R2A336GKC	‡EB*2X36F**		TXV	34,000	0.75	11.00		13.00
	EB*2X36B**	MV08B15**B*	TDR&TXV	34,000	0.75	11.00	13.50	
	EB*2X36B**		TXV	33,000	0.75	11.00		13.00
	EB*2X36F**	*8MPV075	TDR&TXV	34,000	0.75	11.00	13.50	
	EB*2X36F**	MV12F19**B*	TDR&TXV	34,000	0.75	11.00	13.50	
EB*2X36J**	*8MPV100	TDR&TXV	34,000	0.75	11.00	13.50		

- continued on next page -

COOLING PERFORMANCE FOR COMBINATION RATINGS (continued)								
Indoor Models								
Outdoor Model	Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER	
				BTU/hr	S/T	EER	factory	w/ field TDR
R2A336AKC R2A336GKC (continued)	EB*2X36J**	*8MPV125	TDR&TXV	34,000	0.75	11.00	13.50	
	EB*2X36J**	*9MPV100	TDR&TXV	34,000	0.75	11.00	13.50	
	EB*2X36J**	MV16J22**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	EB*2X36J**		TXV	34,000	0.75	11.00		13.00
	EB*2X42F**	*8MPV075	TDR&TXV	34,000	0.75	11.00	13.50	
	EB*2X42F**	MV12F19**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	EB*2X42F**		TXV	34,000	0.75	11.00		13.00
	EB*2X42J**	*8MPV100	TDR&TXV	34,000	0.75	11.00	13.50	
	EB*2X42J**	*8MPV125	TDR&TXV	34,000	0.75	11.00	13.50	
	EB*2X42J**	*9MPV100	TDR&TXV	34,000	0.75	11.00	13.50	
	EB*2X42J**	MV16J22**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	EB*2X42J**		TXV	34,000	0.75	11.00		13.00
	EB*2X42L**	*9MPV125	TDR&TXV	34,000	0.75	11.00	13.50	
	EB*2X42L**	MV20L24**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	EB*2X42L**		TXV	34,000	0.75	11.00		13.00
	ED*2X36B**	MV08B15**B*	TDR&TXV	34,000	0.75	11.00	13.50	
	ED*2X36B**		TXV	33,000	0.75	11.00		13.00
	ED*2X36F**	*8MPV075	TDR&TXV	34,000	0.75	11.00	13.50	
	ED*2X36F**	MV12F19**B*	TDR&TXV	34,000	0.75	11.00	13.50	
	ED*2X36F**		TXV	34,000	0.75	11.00		13.00
	ED*2X36J**	*8MPV100	TDR&TXV	34,000	0.75	11.00	13.50	
	ED*2X36J**	*8MPV125	TDR&TXV	34,000	0.75	11.00	13.50	
	ED*2X36J**	*9MPV100	TDR&TXV	34,000	0.75	11.00	13.50	
	ED*2X36J**	MV16J22**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	ED*2X36J**		TXV	34,000	0.75	11.00		13.00
	ED*2X42F**	*8MPV075	TDR&TXV	34,000	0.75	11.00	13.50	
	ED*2X42F**	MV12F19**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	ED*2X42F**		TXV	34,000	0.75	11.00		13.00
	ED*2X42J**	*8MPV100	TDR&TXV	34,000	0.75	11.00	13.50	
	ED*2X42J**	*8MPV125	TDR&TXV	34,000	0.75	11.00	13.50	
	ED*2X42J**	*9MPV100	TDR&TXV	34,000	0.75	11.00	13.50	
	ED*2X42J**	MV16J22**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	ED*2X42J**		TXV	34,000	0.75	11.00		13.00
	ED*2X42L**	*9MPV125	TDR&TXV	34,000	0.75	11.00	13.50	
	ED*2X42L**	MV20L24**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	ED*2X42L**		TXV	34,000	0.75	11.00		13.00
	EHD2X36A**	*8MPV075	TDR&TXV	34,000	0.75	11.00	13.50	
	EHD2X36A**	*8MPV100	TDR&TXV	34,000	0.75	11.00	13.50	
	EHD2X36A**	*8MPV125	TDR&TXV	34,000	0.75	11.00	13.50	
	EHD2X36A**	*9MPV050	TDR&TXV	34,000	0.75	11.00	13.50	
	EHD2X36A**	*9MPV075	TDR&TXV	34,000	0.75	11.00	13.50	
	EHD2X36A**	*9MPV100	TDR&TXV	34,000	0.75	11.00	13.50	
EHD2X36A**	*9MPV125	TDR&TXV	34,000	0.75	11.00	13.50		
EHD2X36A**	MV08B15**B*	TDR&TXV	34,000	0.75	12.00	14.00		
EHD2X36A**	MV12F19**B*	TDR&TXV	34,000	0.75	12.00	14.00		
EHD2X36A**	MV16J22**B*	TDR&TXV	34,000	0.75	12.00	14.00		
EHD2X36A**	MV20L24**B*	TDR&TXV	34,000	0.75	12.00	14.00		
EHD2X36A**		TXV	34,000	0.75	11.00		13.00	
EHD2X42A**	*8MPV075	TDR&TXV	34,000	0.75	11.00	13.50		
EHD2X42A**	*8MPV100	TDR&TXV	34,000	0.75	11.00	13.50		
EHD2X42A**	*8MPV125	TDR&TXV	34,000	0.75	12.00	14.00		
EHD2X42A**	*9MPV050	TDR&TXV	34,000	0.75	11.00	13.50		
EHD2X42A**	*9MPV075	TDR&TXV	34,000	0.75	11.00	13.50		
EHD2X42A**	*9MPV100	TDR&TXV	34,000	0.75	11.00	13.50		
EHD2X42A**	*9MPV125	TDR&TXV	34,000	0.75	11.00	13.50		

- continued on next page -

COOLING PERFORMANCE FOR COMBINATION RATINGS (continued)								
Indoor Models								
Outdoor Model	Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER	
				BTU/hr	S/T	EER	factory	w/ field TDR
R2A336AKC R2A336GKC (continued)	EHD2X42A**	MV08B15**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	EHD2X42A**	MV12F19**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	EHD2X42A**	MV16J22**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	EHD2X42A**	MV20L24**B*	TDR&TXV	34,000	0.75	12.00	14.00	
	EHD2X42A**		TXV	34,000	0.75	11.00		13.00
	EMA2X36D**		TXV	34,000	0.75	11.00		13.00
	FEM2X35****		TDR&TXV	34,000	0.75	11.00	13.50	
	FEM2X36****		TDR&TXV	34,000	0.75	11.00	13.50	
	FEM2X42****		TDR&TXV	34,000	0.75	11.00	13.50	
	FS(M,U)2X42****		TDR&TXV	34,000	0.75	11.00	13.00	
	FSA2X36****		TDR&TXV	34,000	0.75	11.00	13.00	
	FSM2X36****		TDR&TXV	34,000	0.75	11.00	13.00	
	FSU2X36****		TDR&TXV	34,000	0.75	11.00	13.00	
	FVM2X24****		TDR&TXV	33,000	0.75	11.00	13.50	
	FVM2X36****		TDR&TXV	34,000	0.75	12.00	14.00	
	FVM2X48****		TDR&TXV	34,000	0.75	12.00	14.00	
	FVM2X60****		TDR&TXV	34,000	0.75	12.00	14.00	
R2A342AKC R2A342GKC	‡EB*2X48J**		TXV	40,000	0.70	11.00		13.00
	EB*2X42F**	MV12F19**B*	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X42J**	*8MPV100	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X42J**	*8MPV125	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X42J**	MV16J22**B*	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X42L**	*9MPV125	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X42L**	MV20L24**B*	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X48F**	MV12F19**B*	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X48F**		TXV	40,000	0.70	11.00		13.00
	EB*2X48J**	*8MPV100	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X48J**	*8MPV125	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X48J**	*9MPV100	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X48J**	MV16J22**B*	TDR&TXV	39,000	0.70	12.00	14.00	
	EB*2X48L**	*9MPV125	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X48L**	MV20L24**B*	TDR&TXV	39,000	0.70	11.00	13.50	
	EB*2X48L**		TXV	40,000	0.70	11.00		13.00
	ED*2X42F**	MV12F19**B*	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X42J**	*8MPV100	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X42J**	*8MPV125	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X42J**	MV16J22**B*	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X42L**	*9MPV125	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X42L**	MV20L24**B*	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X48F**	MV12F19**B*	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X48F**		TXV	40,000	0.70	11.00		13.00
	ED*2X48J**	*8MPV100	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X48J**	*8MPV125	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X48J**	*9MPV100	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X48J**	MV16J22**B*	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X48J**		TXV	40,000	0.70	11.00		13.00
	ED*2X48L**	*9MPV125	TDR&TXV	39,000	0.70	11.00	13.50	
	ED*2X48L**	MV20L24**B*	TDR&TXV	39,000	0.70	12.00	14.00	
	ED*2X48L**		TXV	40,000	0.70	11.00		13.00
	EHD2X42A**	*8MPV100	TDR&TXV	39,000	0.70	11.00	13.50	
	EHD2X42A**	*8MPV125	TDR&TXV	39,000	0.70	11.00	13.50	
EHD2X42A**	*9MPV100	TDR&TXV	39,000	0.70	11.00	13.50		
EHD2X42A**	*9MPV125	TDR&TXV	39,000	0.70	11.00	13.50		
EHD2X42A**	MV12F19**B*	TDR&TXV	39,000	0.70	11.00	13.50		
EHD2X42A**	MV16J22**B*	TDR&TXV	39,000	0.70	11.00	13.50		

- continued on next page -

COOLING PERFORMANCE FOR COMBINATION RATINGS (continued)								
Indoor Models								
Outdoor Model	Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER	
				BTU/hr	S/T	EER	factory	w/ field TDR
R2A342AKC R2A342GKC (continued)	EHD2X42A**	MV20L24**B*	TDR&TXV	39,000	0.70	11.00	13.50	
	EHD2X48A**	*8MPV100	TDR&TXV	39,000	0.70	11.00	13.50	
	EHD2X48A**	*8MPV125	TDR&TXV	39,000	0.70	11.00	13.50	
	EHD2X48A**	*9MPV100	TDR&TXV	40,000	0.70	11.00	13.50	
	EHD2X48A**	*9MPV125	TDR&TXV	40,000	0.70	11.00	13.50	
	EHD2X48A**	MV12F19**B*	TDR&TXV	40,000	0.70	11.00	13.50	
	EHD2X48A**	MV16J22**B*	TDR&TXV	40,000	0.70	12.00	14.00	
	EHD2X48A**	MV20L24**B*	TDR&TXV	40,000	0.70	12.00	14.00	
	EMA2X48D**		TXV	39,000	0.70	11.00		13.00
	FEM2X48****		TDR&TXV	40,000	0.70	11.00	13.50	
	FS(M,U)2X48****		TDR&TXV	40,000	0.70	11.00	13.00	
	FVM2X36****		TDR&TXV	39,000	0.70	11.00	13.50	
	FVM2X48****		TDR&TXV	40,000	0.70	11.00	13.50	
	FVM2X60****		TDR&TXV	40,000	0.70	12.00	14.00	
R2A348AKC R2A348GKC	‡EB*2X60L**		TXV	46,000	0.76	11.00		13.00
	EB*2X48J**	MV16J22**B*	TDR&TXV	45,000	0.76	11.00	13.50	
	EB*2X48L**	MV20L24**B*	TDR&TXV	45,000	0.76	11.00	13.50	
	EB*2X60J**	*8MPV125	TDR&TXV	45,000	0.76	11.00	13.50	
	EB*2X60J**	MV16J22**B*	TDR&TXV	45,000	0.76	11.00	13.50	
	EB*2X60J**		TXV	46,000	0.76	11.00		13.00
	EB*2X60L**	MV20L24**B*	TDR&TXV	45,000	0.76	11.00	13.50	
	ED*2X48J**	MV16J22**B*	TDR&TXV	45,000	0.76	11.00	13.50	
	ED*2X48L**	MV20L24**B*	TDR&TXV	45,000	0.76	11.00	13.50	
	ED*2X60J**	*8MPV125	TDR&TXV	45,000	0.76	11.00	13.50	
	ED*2X60J**	MV16J22**B*	TDR&TXV	45,000	0.76	11.00	13.50	
	ED*2X60J**		TXV	46,000	0.76	11.00		13.00
	ED*2X60L**	MV20L24**B*	TDR&TXV	45,000	0.76	11.00	13.50	
	ED*2X60L**		TXV	46,000	0.76	11.00		13.00
	EHD2X48A**	MV16J22**B*	TDR&TXV	45,000	0.76	11.00	13.50	
	EHD2X48A**	MV20L24**B*	TDR&TXV	45,000	0.76	11.00	13.50	
	EHD2X60A**	*8MPV100	TDR&TXV	45,000	0.76	11.00	13.50	
	EHD2X60A**	*8MPV125	TDR&TXV	45,000	0.76	11.00	13.50	
	EHD2X60A**	MV16J22**B*	TDR&TXV	45,000	0.76	11.00	13.50	
	EHD2X60A**	MV20L24**B*	TDR&TXV	46,000	0.76	11.00	13.50	
	EHD2X60A**		TXV	46,000	0.76	11.00		13.00
	FEM2X60****		TDR&TXV	46,000	0.76	11.00	13.50	
	FS(M,U)2X60****		TDR&TXV	46,000	0.76	11.00	13.00	
	FVM2X60****		TDR&TXV	46,000	0.76	11.00	13.50	
R2A360AKC R2A360GKC	‡EB*2X60L**		TXV	57,000	0.77	11.00		13.00
	EB*2X60J**	MV16J22**B*	TDR&TXV	56,000	0.77	11.00	13.50	
	EB*2X60J**		TXV	56,000	0.77	11.00		13.00
	EB*2X60L**	MV20L24**B*	TDR&TXV	56,000	0.77	11.00	13.50	
	ED*2X60J**	MV16J22**B*	TDR&TXV	56,000	0.77	11.00	13.50	
	ED*2X60J**		TXV	56,000	0.77	11.00		13.00
	ED*2X60L**		TXV	57,000	0.77	11.00		13.00
	EHD2X60A**	MV16J22**B*	TDR&TXV	56,000	0.77	11.00	13.50	
	EHD2X60A**	MV20L24**B*	TDR&TXV	56,000	0.77	11.00	13.50	
	EHD2X60A**		TXV	57,000	0.77	11.00		13.00
	FEM2X60****		TDR&TXV	57,000	0.77	11.00	13.50	
	FS(M,U)2X60****		TDR&TXV	56,000	0.77	11.00	13.00	
	FVM2X60****		TDR&TXV	57,000	0.77	11.00	13.50	

OUTDOOR UNIT MODEL NUMBER IDENTIFICATION GUIDE (single phase)											
Digit Position:	1	2	3	4	5, 6	7	8	9	10	11	12
Example Part Number:	R	2	A	3	18	A	K	C	1	0	0
Product Family											
2 = R-22											
4 = R-410A	REFRIGERANT										
A = Air Conditioner											
H = Heat Pump			TYPE								
3 = 13 SEER											
4 = 14 SEER			NOMINAL EFFICIENCY								
18 = 18,000 BTUH = 1½ tons											
24 = 24,000 BTUH = 2 tons											
30 = 30,000 BTUH = 2½ tons											
36 = 36,000 BTUH = 3 tons											
42 = 42,000 BTUH = 3½ tons											
48 = 48,000 BTUH = 4 tons											
60 = 60,000 BTUH = 5 tons			NOMINAL CAPACITY								
A = Standard Grille											
G = Coil Guard Grille						FEATURES					
K = 208/230-1-60						VOLTAGE					
Sales Code											
Engineering Revision											
Extra Digit											
Extra Digit											

ACCESSORIES PART NUMBER IDENTIFICATION GUIDE									
Digit Position:	1	2	3	4	5	6, 7	8, 9	10, 11	
Example Part Number:	N	A	S	A	0	01	01	CH	
N = Non-Branded	BRANDING								
A = Accessory	PRODUCT GROUP								
S = Split System (AC & HP)			KIT USAGE						
A = Original									
B = 2nd Generation			MAJOR SERIES						
0 = Generic or Not Applicable									
2 = R-22									
4 = R-410A			REFRIGERANT						
Product Identifier Number									
Package Quantity									
Type of Kit (Example: CH = Crankcase Heater)									